

INACCESSIBLE
 13 KV
 FUTURE 23 KV
 23 KV
 SALT SPRAY



FPL Construction Symbols

- = Proposed UG Cable in 2" Conduit
- ◇ = Proposed 17" Handhole
- ◇ = Proposed 24" Handhole
- ◇ = Existing Handhole
- = Existing PM Transformer
- ▴ = Existing OH Transformer
- = Proposed Streetlight and Pole

PERMIT REQUIRED FOR ALL LOCATIONS


Construction Notes: (Customer installing conduit and handholes)

Customer to install 2" conduit and 17" HH and 24" HH. Call Locates before digging for each location
 Loc. 1-85: FPL contractor to install (85) GREEN WASHINGTON FOR SINGLE POST TOPS 18' 6" (14' 6" MH) POLE and (85)HOLOPHANE GRANVILLE GREEN/GREEN 39W 3000K 5,190L.
 Verify fixture is working correctly after installation.
 Check 120V to terminal blocks.
 'CHECK VOLTAGE – CONVERT 480V to 120V or 240V' On 480V circuits, change the relay prior to installing the lights. Verify the source and amount of lights on that relay. Contact the FPL PL to assist with this process.
 -All locations are 17"HH unless otherwise specified.
 -FPL crew to run #6 DPX UG cable to all locations shown in the drawing.
 -All facilities to be installed within utility easement.
 -Customer to contact FPL PL and coordinate staking of all locations prior LED installations. Customer is responsible for any restoration required.

FPL LED Representative: Gladys Reyes

AS-BUILT CREW PRINT		ALL REQUIRED GROUND RODS HAVE BEEN DRIVEN & VERIFIED TO BE WITHIN FPL STANDARDS. VALUES ARE SHOWN AT ALLOCATIONS.		JOB CERTIFIED COMPLETED AS SHOWN ON THIS AS-BUILT PRINT. MATERIAL CHANGES SHOWN ON ROS.		AS-BUILT COPY			
FOREMAN SIGNATURE _____ DATE _____		FOREMAN SIGNATURE _____ DATE _____		SUPERVISOR SIGNATURE _____ DATE _____		INITIALS _____ CERT. DATE _____			
Easement?	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	Survey/Stake?	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	Work with SMO?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	FPL City of Delray- Along Barwick Rd Install 85 Green Holophane Post and 85 Poles			
Tree Work?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	Designer/Stake?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	CT/Special Mtr?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>				
PERMIT REQ'D	City _____ County Rd. _____ County Air _____ State Road _____ FAA _____	WMD _____ RR Xing _____ DR. Dist. _____ Transm. _____	Tele. Attachment Per _____ Telephone Co. Job No. _____		Designed by:	Jesufane Mentor	Date:	12/20/22	
Requested Tel. Co. Set Poles?	YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	Requested Tel. Co. Transfer?	YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	Request CAVT Transfer?	YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	Drawn by:	JJM	Check by:	Dwg No. 1 OF 11
POLE LINE FEET	0'	DUCT BANK FT.	0'	Rural Location Sec.	09	TWP.	28	S, RGE.	37 E.
POLE LINE FT. ON TRANSM. POLES	0'	TRENCH FT.	0'	SCALE:	N.T.S.	St. Lt MAP No.	MAP#	Pri Map No.	CC0709
TLM/LDS MODEL No.	-	Map Posting?	YES <input checked="" type="checkbox"/> NO <input type="checkbox"/>	Posted by:	WR	XXXXXXXX	M/A	BV	

INACCESSIBLE
 13 kV
 FUTURE 23 kV
 23 kV
 SALT SPRAY

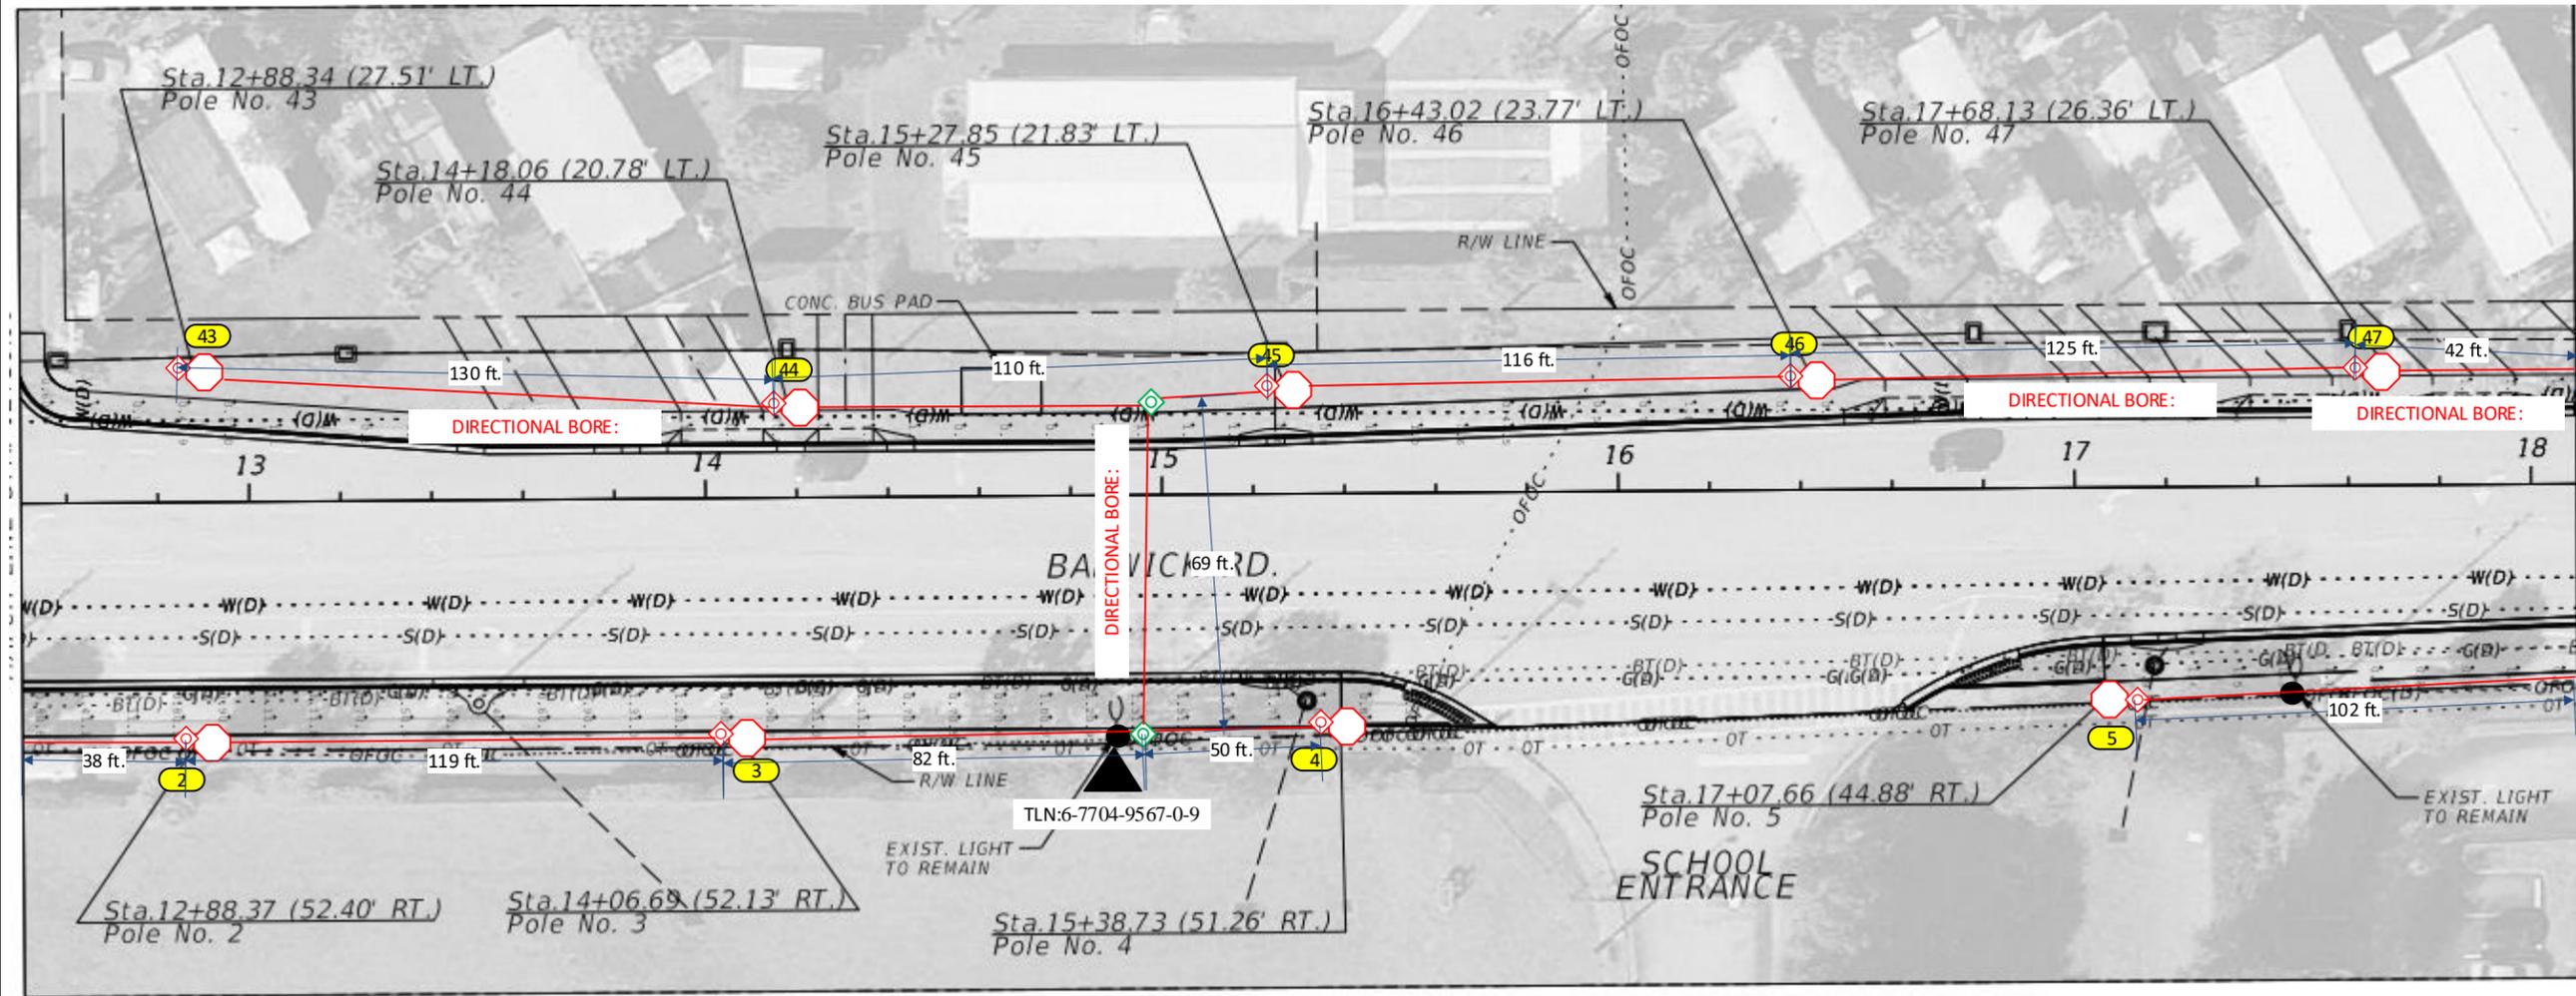

- FPL Construction Symbols**
- = Proposed UG Cable in 2" Conduit
 - ◊ = Proposed 17" Handhole
 - ◊ = Proposed 24" Handhole
 - ◊ = Existing Handhole
 - ▼ = Existing PM Transformer
 - ▼ = Existing OH Transformer
 - ◊ = Proposed Streetlight and Pole


PERMIT REQUIRED FOR ALL LOCATIONS

Construction Notes: (Customer installing conduit and handoles)

Customer to install 2" conduit and 17" HH and 24" HH. Call Locates before digging for each location
 Loc. 1-85: FPL contractor to install (85) GREEN WASHINGTON FOR SINGLE POST TOPS 18' 6" (14' 6" MH) POLE and (85)HOLOPHANE GRANVILLE GREEN/GREEN 39W 3000K 5,190L.
 Verify fixture is working correctly after installation.
 Check 120V to terminal blocks.
 'CHECK VOLTAGE – CONVERT 480V to 120V or 240V' On 480V circuits, change the relay prior to installing the lights. Verify the source and amount of lights on that relay. Contact the FPL PL to assist with this process.
 -All locations are 17"HH unless otherwise specified.
 -FPL crew to run #6 DPX UG cable to all locations shown in the drawing.
 -All facilities to be installed within utility easement.
 -Customer to contact FPL PL and coordinate staking of all locations prior LED installations. Customer is responsible for any restoration required.

FPL LED Representative: Gladys Reyes

AS-BUILT CREW PRINT		<small>ALL REQUIRED GROUND RODS HAVE BEEN DRIVEN & VERIFIED TO BE WITHIN FPL STANDARDS. VALUES ARE SHOWN AT ALLOCATIONS.</small>		<small>JOB CERTIFIED COMPLETED AS SHOWN ON THIS AS-BUILT PRINT. MATERIAL CHANGES SHOWN ON ROS.</small>		AS-BUILT COPY	
FOREMAN SIGNATURE _____ DATE _____		FOREMAN SIGNATURE _____ DATE _____		SUPERVISOR SIGNATURE _____ DATE _____		INITIALS _____ CERT. DATE _____	
Easement?	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	Survey/Stake?	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	Work with SMO?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	FPL City of Delray- Along Barwick Rd Install 85 Green Holophane Post and 85 Poles	
Tree Work?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	Designer/Stake?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	CT/Special Mtr?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>		
PERMIT REQ'D	City _____ County Rd. _____ County Air _____ State Road _____ FAA _____	WMD _____ RR Xing _____ DR. Dist. _____ Transm. _____	Requested Tel. Co. Set Poles? YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>		Designed by: Jesufane Mentor		Date: 12/20/22
	Requested Tel. Co. Transfer? YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	Request CAVT Transfer? YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	Tele. Attachment Per _____ Telephone Co. Job No. _____		Drawn by: JJM		Check by: _____ Dwg No. 2 OF 11
POLE LINE FEET	0'	DUCT BANK FT.	0'		Rural Location Sec. 09 TWP. 28 S, RGE. 37 E.		
POLE LINE FT. ON TRANSM. POLES	0'	TRENCH FT.	0'		SCALE: N.T.S.	St. Lt MAP No. MAP#	Pri Map No. CC0709
TLM/LDS MODEL No.	-	Map Posting?	YES <input checked="" type="checkbox"/> NO <input type="checkbox"/>	Posted by:	WR	XXXXXXX	M/A BV

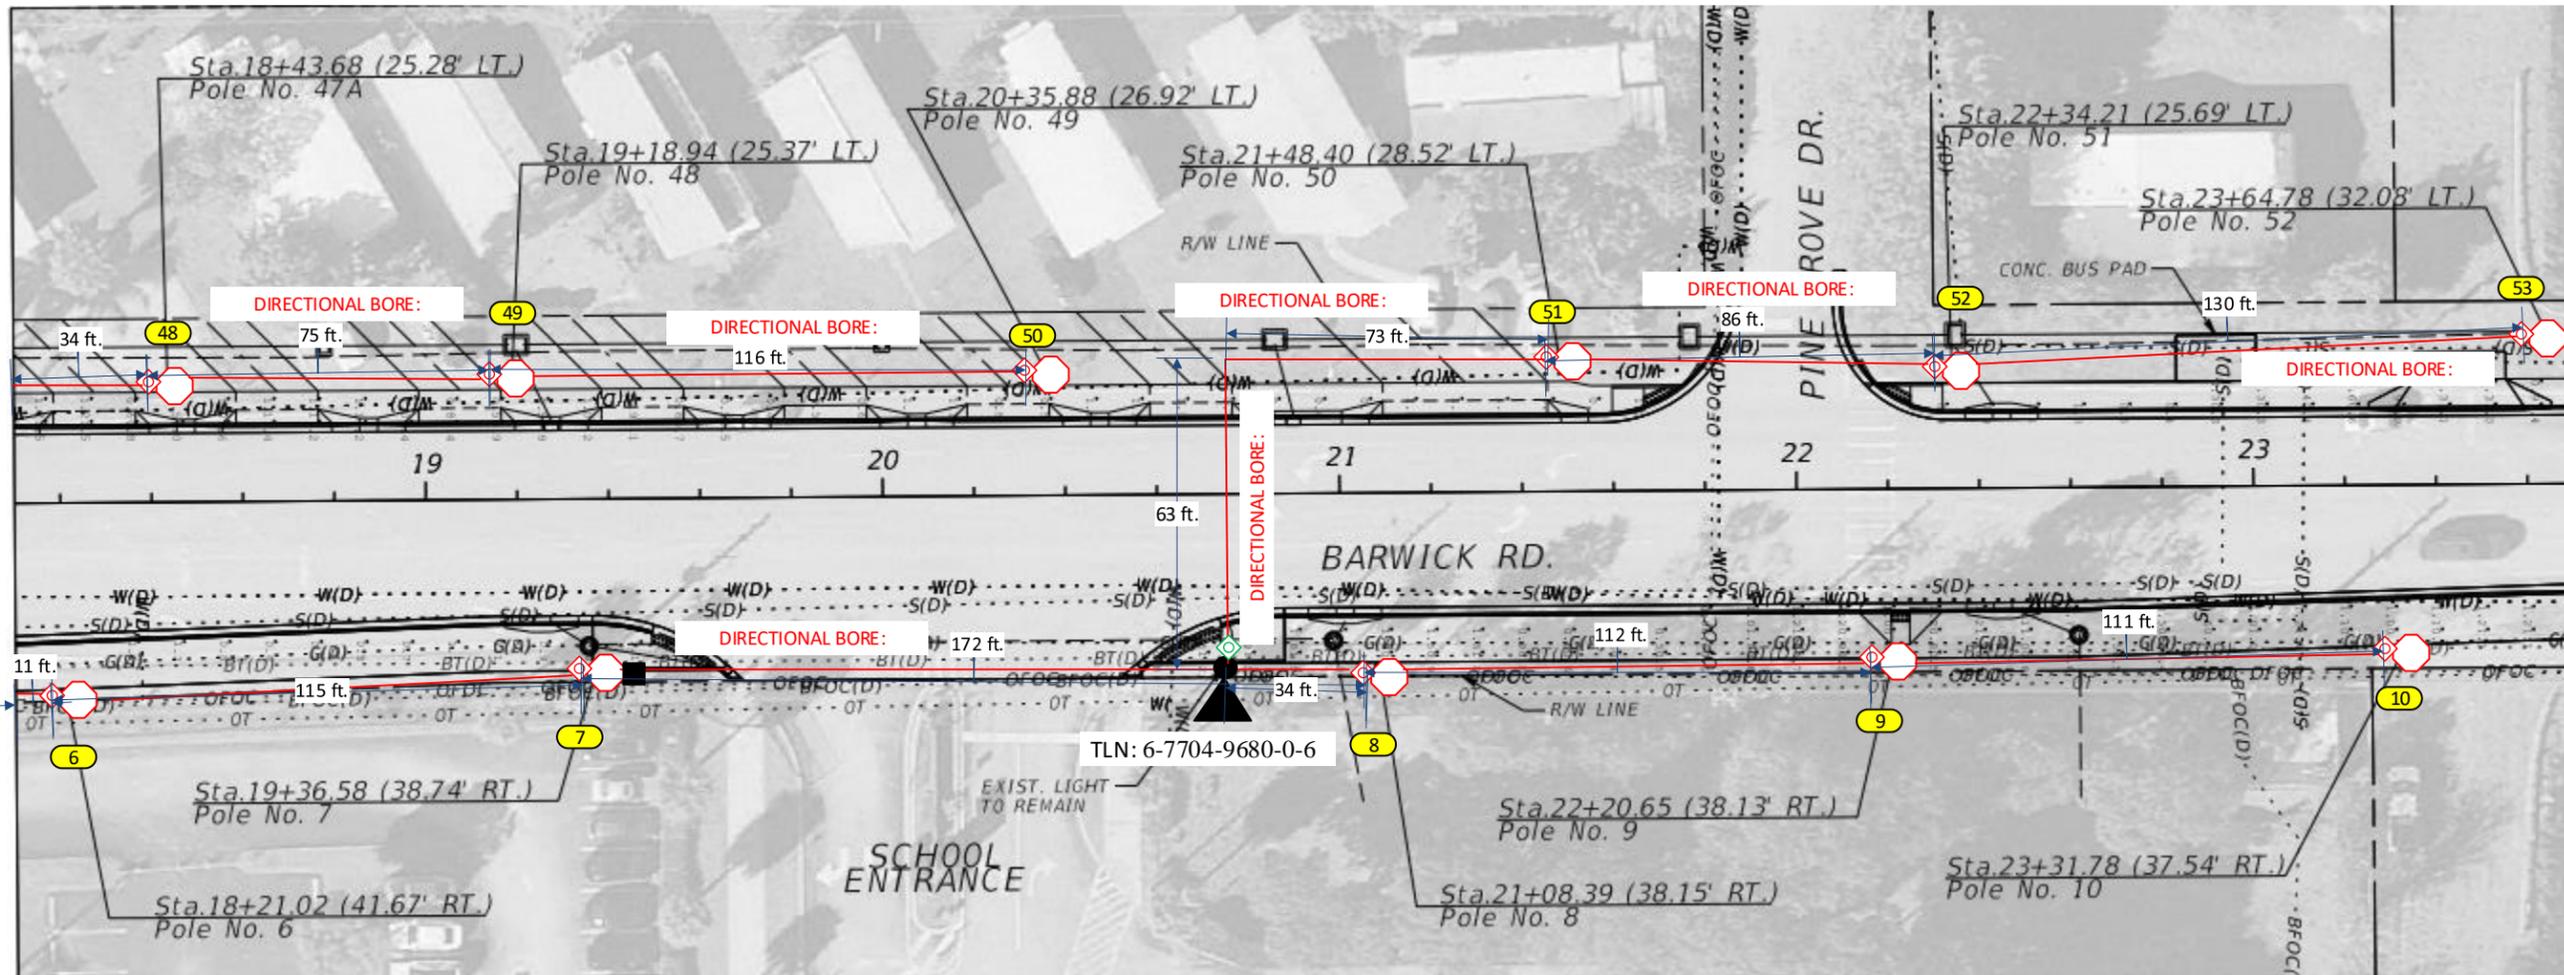

- FPL Construction Symbols
- = Proposed UG Cable in 2" Conduit
 - = Proposed 17" Handhole
 - = Proposed 24" Handhole
 - = Existing Handhole
 - = Existing PM Transformer
 - = Existing OH Transformer
 - = Proposed Streetlight and Pole



PERMIT REQUIRED FOR ALL LOCATIONS

Construction Notes: (Customer installing conduit and handholes)
 Customer to install 2" conduit and 17" HH and 24" HH. Call Locates before digging for each location
 Loc. 1-85: FPL contractor to install (85) GREEN WASHINGTON FOR SINGLE POST TOPS 18' 6" (14' 6" MH) POLE and (85)HOLOPHANE GRANVILLE GREEN/GREEN 39W 3000K 5,190L.
 Verify fixture is working correctly after installation.
 Check 120V to terminal blocks.
 'CHECK VOLTAGE – CONVERT 480V to 120V or 240V' On 480V circuits, change the relay prior to installing the lights. Verify the source and amount of lights on that relay. Contact the FPL PL to assist with this process.
 -All locations are 17"HH unless otherwise specified.
 -FPL crew to run #6 DPX UG cable to all locations shown in the drawing.
 -All facilities to be installed within utility easement.
 -Customer to contact FPL PL and coordinate staking of all locations prior LED installations. Customer is responsible for any restoration required.

FPL LED Representative: Gladys Reyes

AS-BUILT CREW PRINT		ALL REQUIRED GROUND RODS HAVE BEEN DRIVEN & VERIFIED TO BE WITHIN FPL STANDARDS, VALUES SHOWN AT ALLOCATIONS.		JOB CERTIFIED COMPLETED AS SHOWN ON THIS AS-BUILT PRINT. MATERIAL CHANGES SHOWN ON ROS.		AS-BUILT COPY	
FOREMAN SIGNATURE _____ DATE _____		FOREMAN SIGNATURE _____ DATE _____		SUPERVISOR SIGNATURE _____ DATE _____		INITIALS _____ CERT. DATE _____	
Easement?	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	Survey/Stake?	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	Work with SMO?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	FPL	
Tree Work?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	Designer/Stake?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	CT/Special Mtr?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>		
PERMIT REQ'D	City	County Rd.	County Air	State Road	FAA	City of Delray- Along Barwick Rd Install 85 Green Holophane Post and 85 Poles	
	WMD	RR Xing	DR. Dist.	Transm.			
Requested Tel. Co. Set Poles?	YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	Requested Tel. Co. Transfer?	YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	Request CAVT Transfer?	YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	Designed by:	Jesufane Mentor
Tele. Attachment Per _____ Telephone Co. Job No. _____						Date:	12/20/22
POLE LINE FEET	0'	DUCT BANK FT.	0'	POLE LINE FT. ON TRANSM. POLES	0'	Drawn by:	JJM
		TRENCH FT.	0'			Check by:	
TLM/LDS MODEL No.	-	Map Posting?	YES <input checked="" type="checkbox"/> NO <input type="checkbox"/>	Posted by:		Dwg No.	3 OF 11
						Rural Location Sec.	09 TWP. 28 S, RGE. 37 E.
						SCALE:	N.T.S.
						St. Lt MAP No.	MAP#
						Pri Map No.	CC0709
						WR	XXXXXXXX
						M/A	BV

INACCESSIBLE 13 kV FUTURE 23 kV 23 kV SALT SPRAY

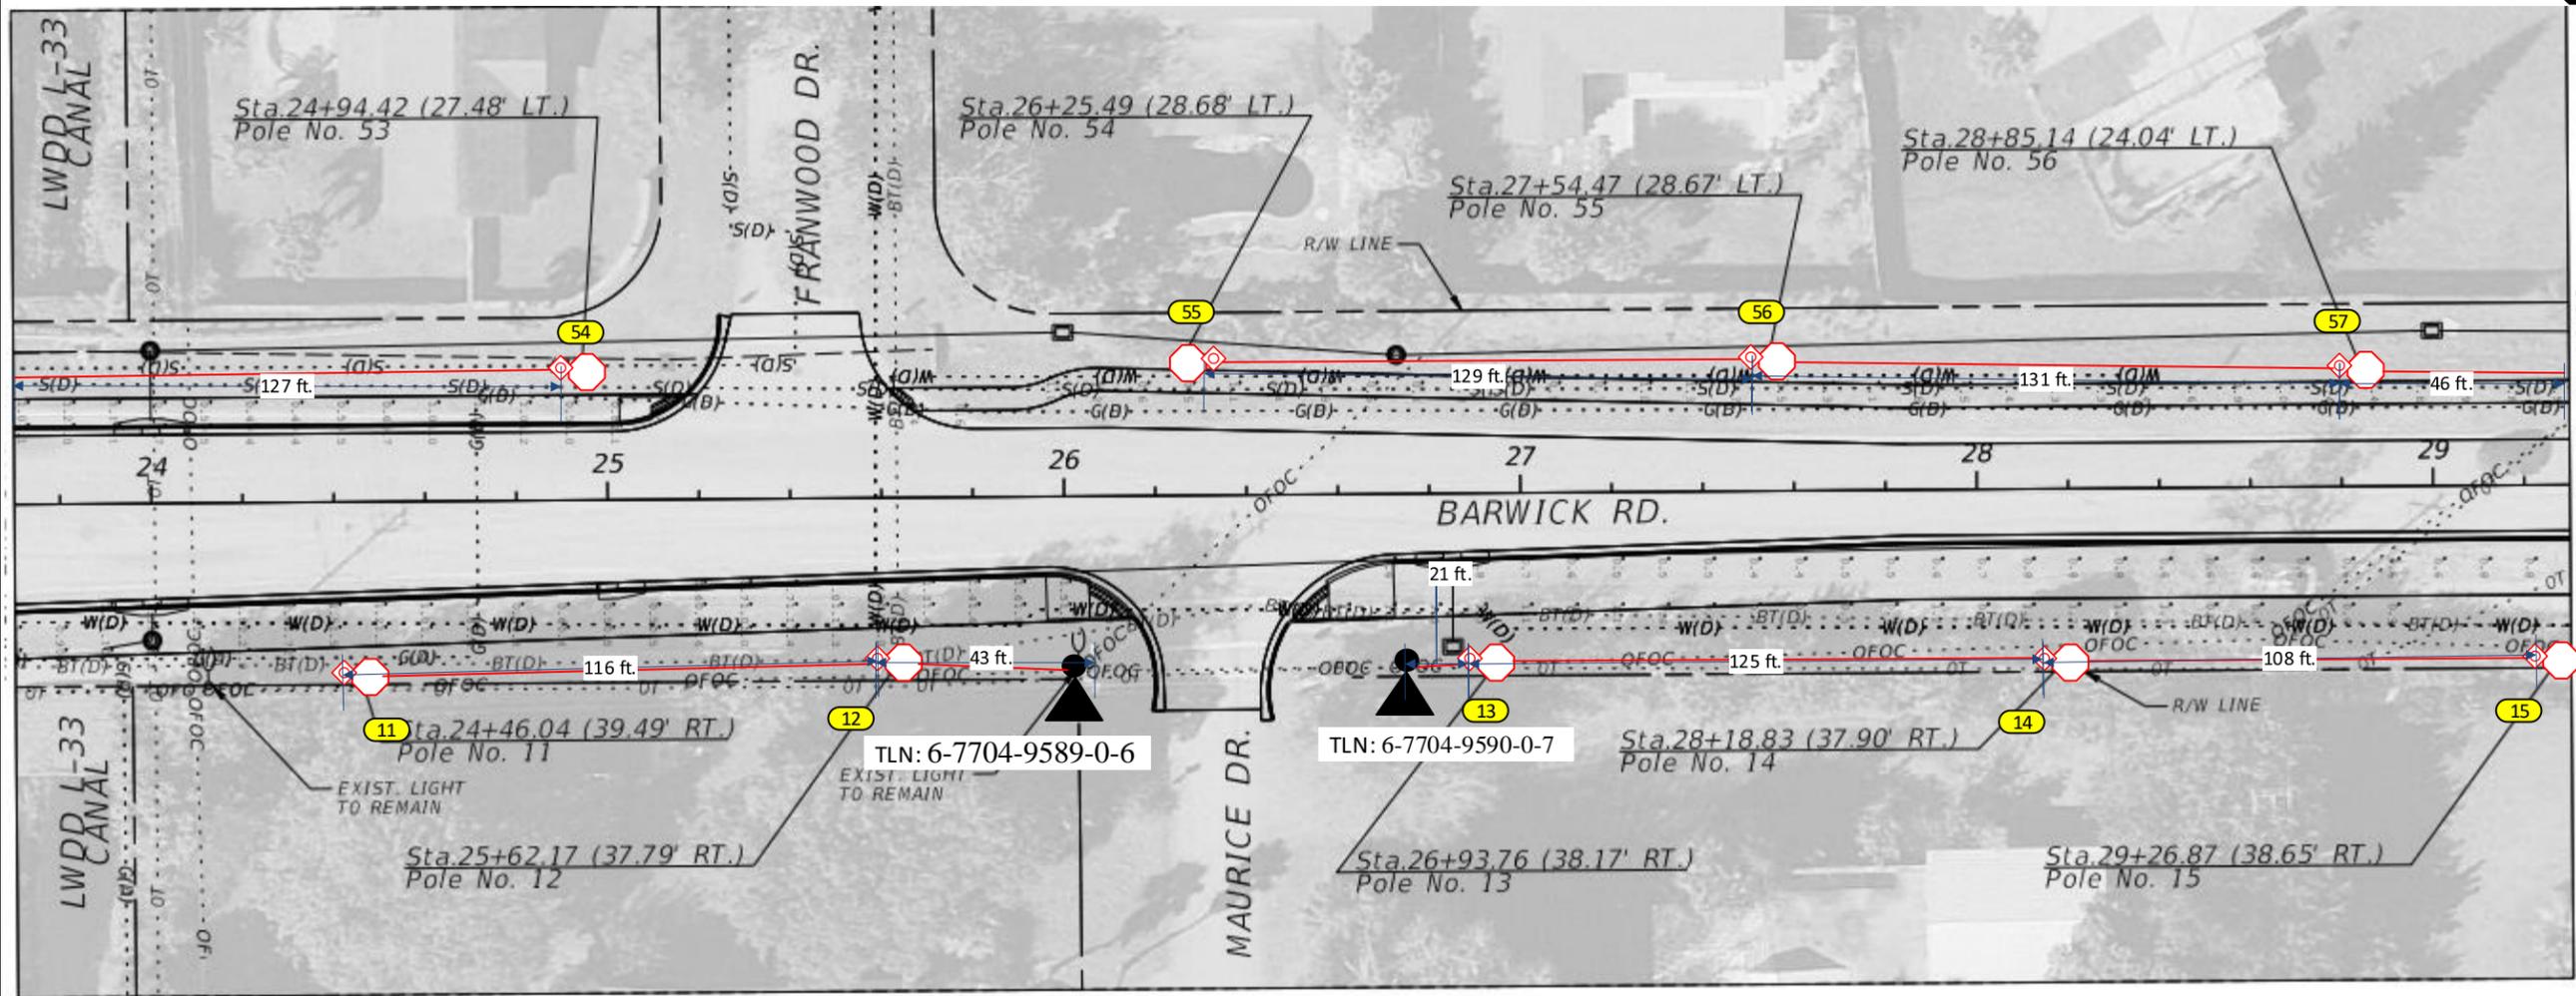

- FPL Construction Symbols**
- = Proposed UG Cable in 2" Conduit
 - ◇ = Proposed 17" Handhole
 - ◇ = Proposed 24" Handhole
 - ◆ = Existing Handhole
 - ▾ = Existing PM Transformer
 - ▲ = Existing OH Transformer
 - = Proposed Streetlight and Pole

PERMIT REQUIRED FOR ALL LOCATIONS


Construction Notes: (Customer installing conduit and handholes)

Customer to install 2" conduit and 17" HH and 24" HH. Call Locates before digging for each location
 Loc. 1-85: FPL contractor to install (85) GREEN WASHINGTON FOR SINGLE POST TOPS 18' 6" (14' 6" MH) POLE and (85)HOLOPHANE GRANVILLE GREEN/GREEN 39W 3000K 5,190L.
 Verify fixture is working correctly after installation.
 Check 120V to terminal blocks.
 'CHECK VOLTAGE – CONVERT 480V to 120V or 240V' On 480V circuits, change the relay prior to installing the lights. Verify the source and amount of lights on that relay. Contact the FPL PL to assist with this process.
 -All locations are 17"HH unless otherwise specified.
 -FPL crew to run #6 DPX UG cable to all locations shown in the drawing.
 -All facilities to be installed within utility easement.
 -Customer to contact FPL PL and coordinate staking of all locations prior LED installations. Customer is responsible for any restoration required.

FPL LED Representative: Gladys Reyes

AS-BUILT CREW PRINT		<small>ALL REQUIRED GROUND RODS HAVE BEEN DRIVEN & VERIFIED TO BE WITHIN FPL STANDARDS. VALUES ARE SHOWN AT ALLOCATIONS.</small>		<small>JOB CERTIFIED COMPLETED AS SHOWN ON THIS AS-BUILT PRINT. MATERIAL CHANGES SHOWN ON RDS.</small>		AS-BUILT COPY	
FOREMAN SIGNATURE _____ DATE _____		FOREMAN SIGNATURE _____ DATE _____		SUPERVISOR SIGNATURE _____ DATE _____		INITIALS _____ CERT. DATE _____	
Easement?	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	Survey/Stake?	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	Work with SMO?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	FPL City of Delray- Along Barwick Rd Install 85 Green Holophane Post and 85 Poles	
Tree Work?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	Designer/Stake?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	CT/Special Mtr?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>		
PERMIT REQ'D	City	County Rd.	County Air	State Road	FAA	Designed by: Jesufane Mentor Date: 12/20/22	
	WMD	RR Xing	DR. Dist.	Transm.			
Requested Tel. Co. Set Poles?	YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	Tele. Attachment Per		Telephone Co. Job No.		Rural Location Sec. 09 TWP. 28 S, RGE. 37 E.	
Requested Tel. Co. Transfer?	YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	POLE LINE FEET 0'		DUCT BANK FT. 0'		SCALE: N.T.S. St. Lt MAP No. MAP# Pri Map No. CC0709	
Request CAVT Transfer?	YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	POLE LINE FT. ON TRANSM. POLES 0'		TRENCH FT. 0'		WR XXXXXXXX M/A BV	
TLM/LDS MODEL No.	-	Map Posting? YES <input checked="" type="checkbox"/> NO <input type="checkbox"/>		Posted by:			

INACCESSIBLE 13 kV FUTURE 23 kV 23 kV SALT SPRAY

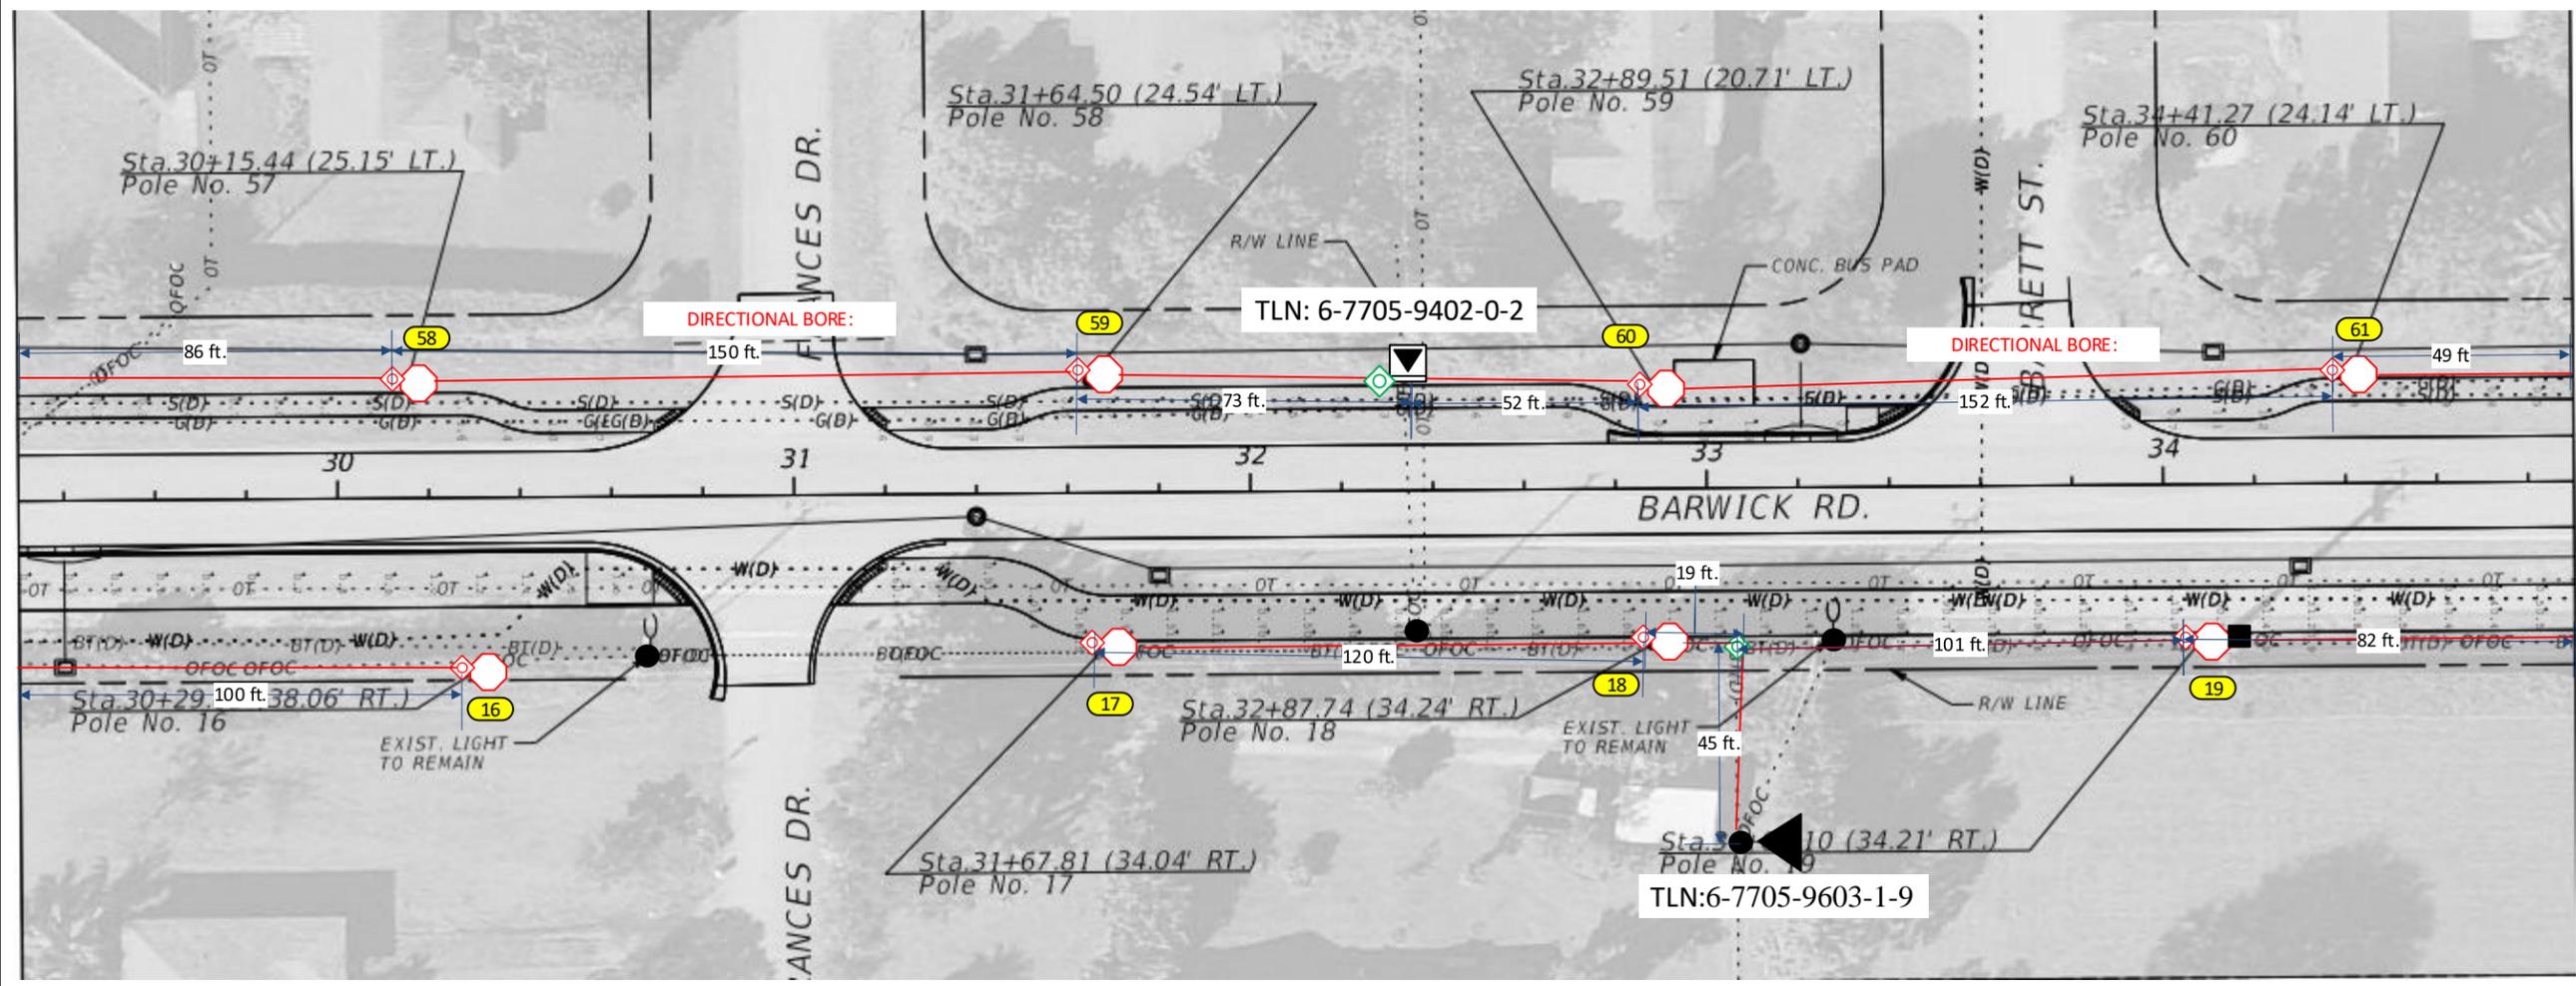

- FPL Construction Symbols**
- = Proposed UG Cable in 2" Conduit
 - ◇ = Proposed 17" Handhole
 - ◇ = Proposed 24" Handhole
 - ◊ = Existing Handhole
 - ▾ = Existing PM Transformer
 - ▾ = Existing OH Transformer
 - = Proposed Streetlight and Pole

PERMIT REQUIRED FOR ALL LOCATIONS


Construction Notes: (Customer installing conduit and handoles)

Customer to install 2" conduit and 17" HH and 24" HH. Call Locates before digging for each location
 Loc. 1-85: FPL contractor to install (85) GREEN WASHINGTON FOR SINGLE POST TOPS 18' 6" (14' 6" MH) POLE and (85)HOLOPHANE GRANVILLE GREEN/GREEN 39W 3000K 5,190L.
 Verify fixture is working correctly after installation.
 Check 120V to terminal blocks.
 'CHECK VOLTAGE – CONVERT 480V to 120V or 240V' On 480V circuits, change the relay prior to installing the lights. Verify the source and amount of lights on that relay. Contact the FPL PL to assist with this process.
 -All locations are 17"HH unless otherwise specified.
 -FPL crew to run #6 DPX UG cable to all locations shown in the drawing.
 -All facilities to be installed within utility easement.
 -Customer to contact FPL PL and coordinate staking of all locations prior LED installations. Customer is responsible for any restoration required.

FPL LED Representative: Gladys Reyes

AS-BUILT CREW PRINT		ALL REQUIRED GROUND RODS HAVE BEEN DRIVEN & VERIFIED TO BE WITHIN FPL STANDARDS. VALUES ARE SHOWN AT ALLOCATIONS.		JOB CERTIFIED COMPLETED AS SHOWN ON THIS AS-BUILT PRINT. MATERIAL CHANGES SHOWN ON RODS.		AS-BUILT COPY	
FOREMAN SIGNATURE _____ DATE _____		FOREMAN SIGNATURE _____ DATE _____		SUPERVISOR SIGNATURE _____ DATE _____		INITIALS _____ CERT. DATE _____	
Easement? Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	Survey/Stake? Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	Work with SMO? Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	FPL				
Tree Work? Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	Designer/Stake? Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	CT/Special Mtr? Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	City of Delray- Along Barwick Rd				
PERMIT REQ'D: City _____ County Rd. _____ County Air _____ State Road _____ FAA _____			Install 85 Green Holophane Post and 85 Poles				
WMD _____ RR Xing _____ DR. Dist. _____ Transm. _____			Designed by: Jesufane Mentor		Date: 12/20/22		
Requested Tel. Co. Set Poles? YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>			Requested Tel. Co. Transfer? YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>		Drawn by: JJM Check by: _____ Dwg No. 5 OF 11		
Request CAVT Transfer? YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>			Tele. Attachment Per _____ Telephone Co. Job No. _____		Rural Location Sec. 09 TWP. 28 S, RGE. 37 E.		
POLE LINE FEET 0'	DUCT BANK FT. 0'	SCALE: N.T.S. St. Lt MAP No. MAP# Pri Map No. CC0709					
POLE LINE FT. ON TRANSM. POLES 0'	TRENCH FT. 0'	WR XXXXXXXX					
TLM/LDS MODEL No. -	Map Posting? YES <input checked="" type="checkbox"/> NO <input type="checkbox"/>	Posted by: _____		M/A BV			

INACCESSIBLE 13 kV FUTURE 23 kV 23 kV SALT SPRAY

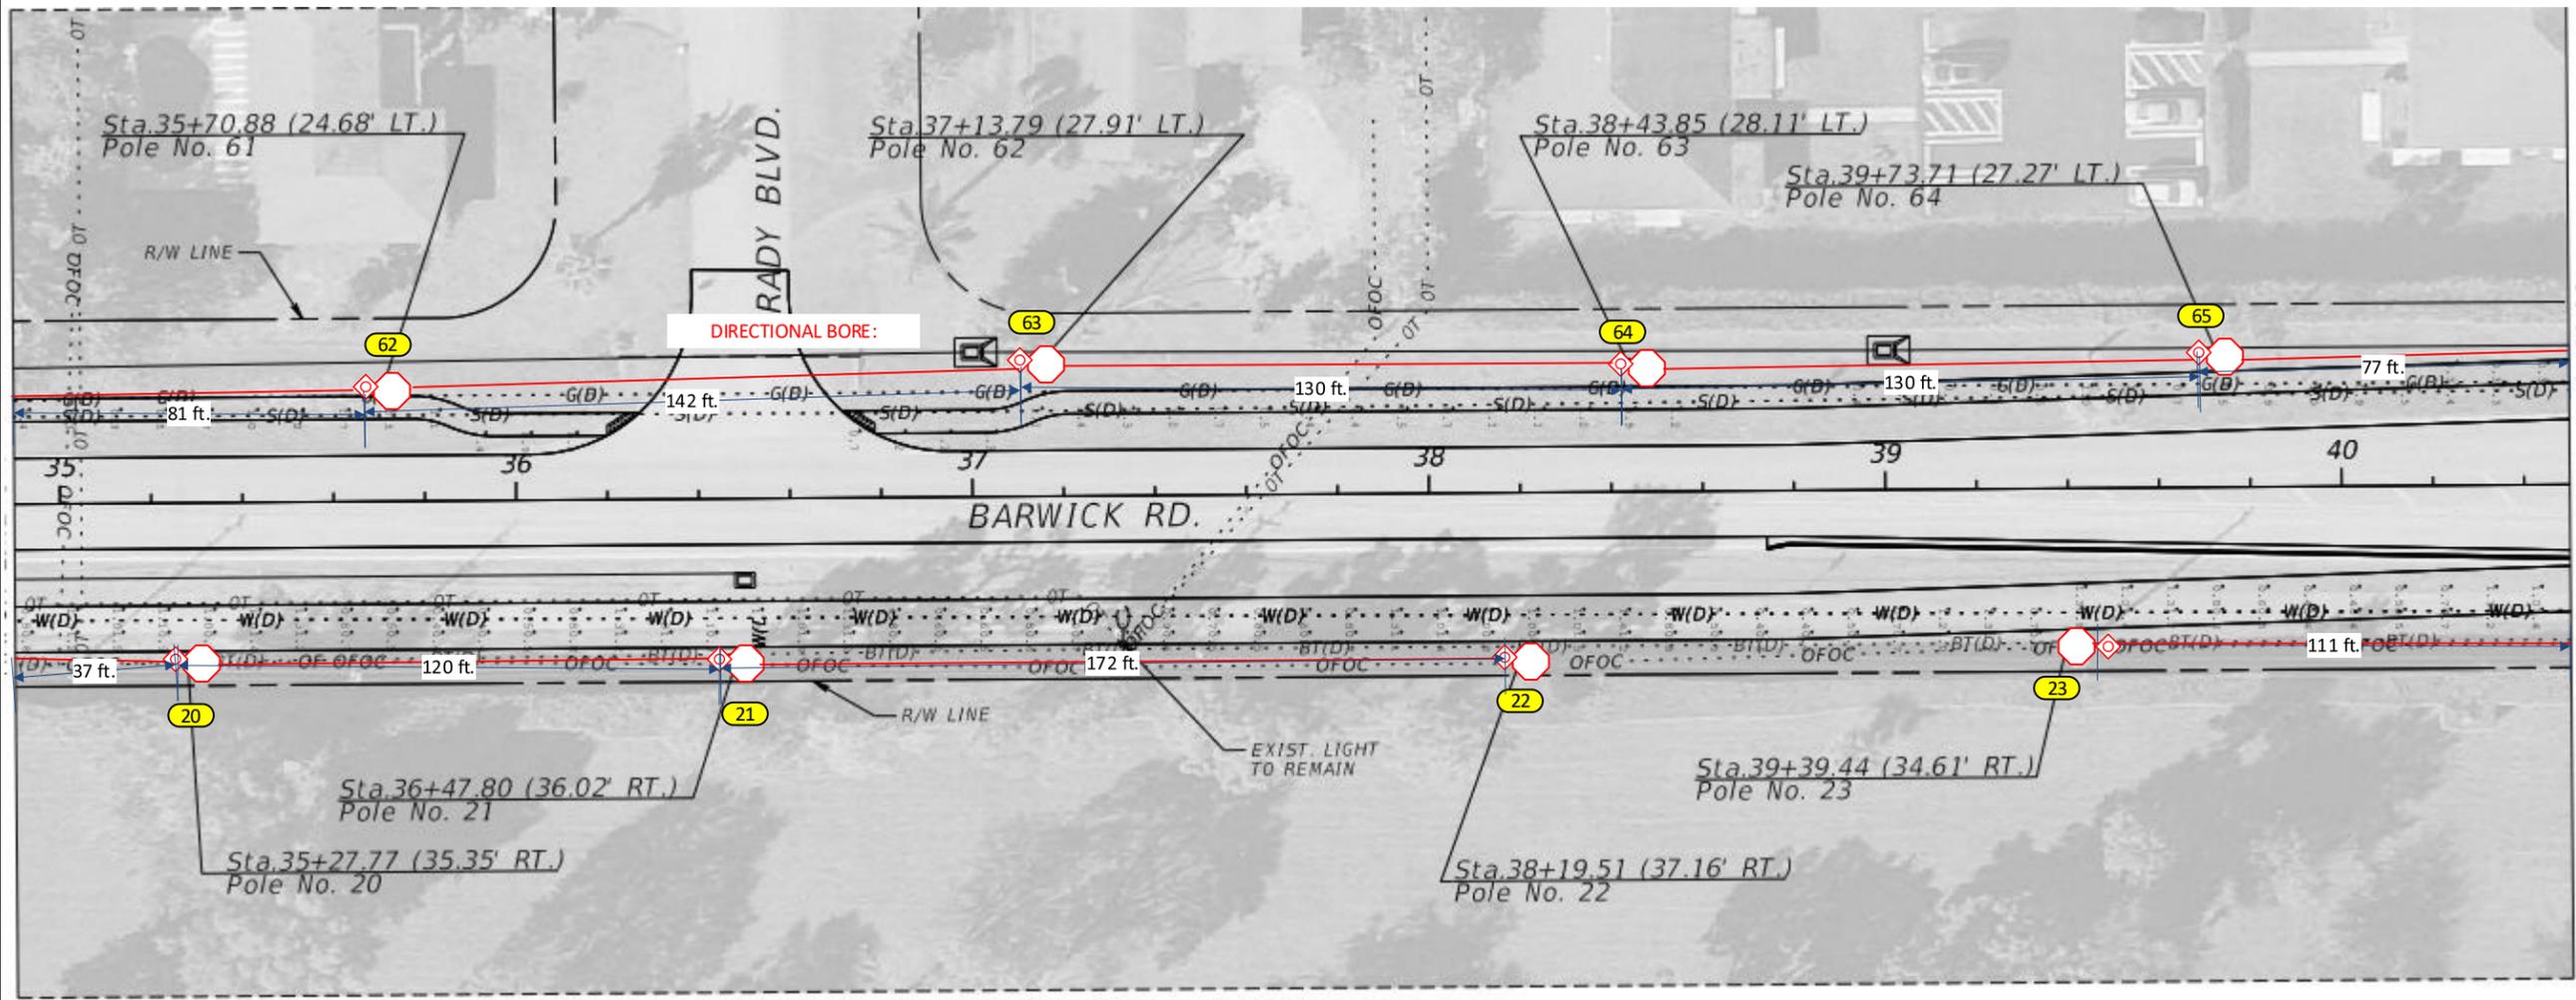

- FPL Construction Symbols**
- = Proposed UG Cable in 2" Conduit
 - ◇ = Proposed 17" Handhole
 - ◇ = Proposed 24" Handhole
 - ◇ = Existing Handhole
 - ▾ = Existing PM Transformer
 - ▾ = Existing OH Transformer
 - = Proposed Streetlight and Pole

PERMIT REQUIRED FOR ALL LOCATIONS


Construction Notes: (Customer installing conduit and handoles)

Customer to install 2" conduit and 17" HH and 24" HH. Call Locates before digging for each location
 Loc. 1-85: FPL contractor to install (85) GREEN WASHINGTON FOR SINGLE POST TOPS 18' 6" (14' 6" MH) POLE and (85)HOLOPHANE GRANVILLE GREEN/GREEN 39W 3000K 5,190L.
 Verify fixture is working correctly after installation.
 Check 120V to terminal blocks.
 'CHECK VOLTAGE – CONVERT 480V to 120V or 240V' On 480V circuits, change the relay prior to installing the lights. Verify the source and amount of lights on that relay. Contact the FPL PL to assist with this process.
 -All locations are 17"HH unless otherwise specified.
 -FPL crew to run #6 DPX UG cable to all locations shown in the drawing.
 -All facilities to be installed within utility easement.
 -Customer to contact FPL PL and coordinate staking of all locations prior LED installations. Customer is responsible for any restoration required.

FPL LED Representative: Gladys Reyes

AS-BUILT CREW PRINT		ALL REQUIRED GROUND RODS HAVE BEEN DRIVEN & VERIFIED TO BE WITHIN FPL STANDARDS. VALUES ARE SHOWN AT ALLOCATIONS.		JOB CERTIFIED COMPLETED AS SHOWN ON THIS AS-BUILT PRINT. MATERIAL CHANGES SHOWN ON ROS.		AS-BUILT COPY	
FOREMAN SIGNATURE _____ DATE _____		FOREMAN SIGNATURE _____ DATE _____		SUPERVISOR SIGNATURE _____ DATE _____		INITIALS _____ CERT. DATE _____	
Easement? Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	Survey/Stake? Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	Work with SMO? Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	FPL				
Tree Work? Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	Designer/Stake? Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	CT/Special Mtr? Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	City of Delray- Along Barwick Rd				
PERMIT REQ'D: City _____ County Rd. _____ County Air _____ State Road _____ FAA _____			Install 85 Green Holophane Post and 85 Poles				
WMD _____ RR Xing _____ DR. Dist. _____ Transm. _____			Designed by: Jesufane Mentor		Date: 12/20/22		
Requested Tel. Co. Set Poles? YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>			Requested Tel. Co. Transfer? YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>		Drawn by: JJM Check by: _____ Dwg No. 6 OF 11		
Request CAVT Transfer? YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>			Tele. Attachment Per _____ Telephone Co. Job No. _____		Rural Location Sec. 09 TWP. 28 S, RGE. 37 E.		
POLE LINE FEET 0'		DUCT BANK FT. 0'		SCALE: N.T.S. St. Lt MAP No. MAP# Pri Map No. CC0709			
POLE LINE FT. ON TRANSM. POLES 0'		TRENCH FT. 0'		WR XXXXXXXX			
TLM/LDS MODEL No. -		Map Posting? YES <input checked="" type="checkbox"/> NO <input type="checkbox"/>		Posted by: _____		M/A BV	

INACCESSIBLE 13 kV FUTURE 23 kV 23 kV SALT SPRAY

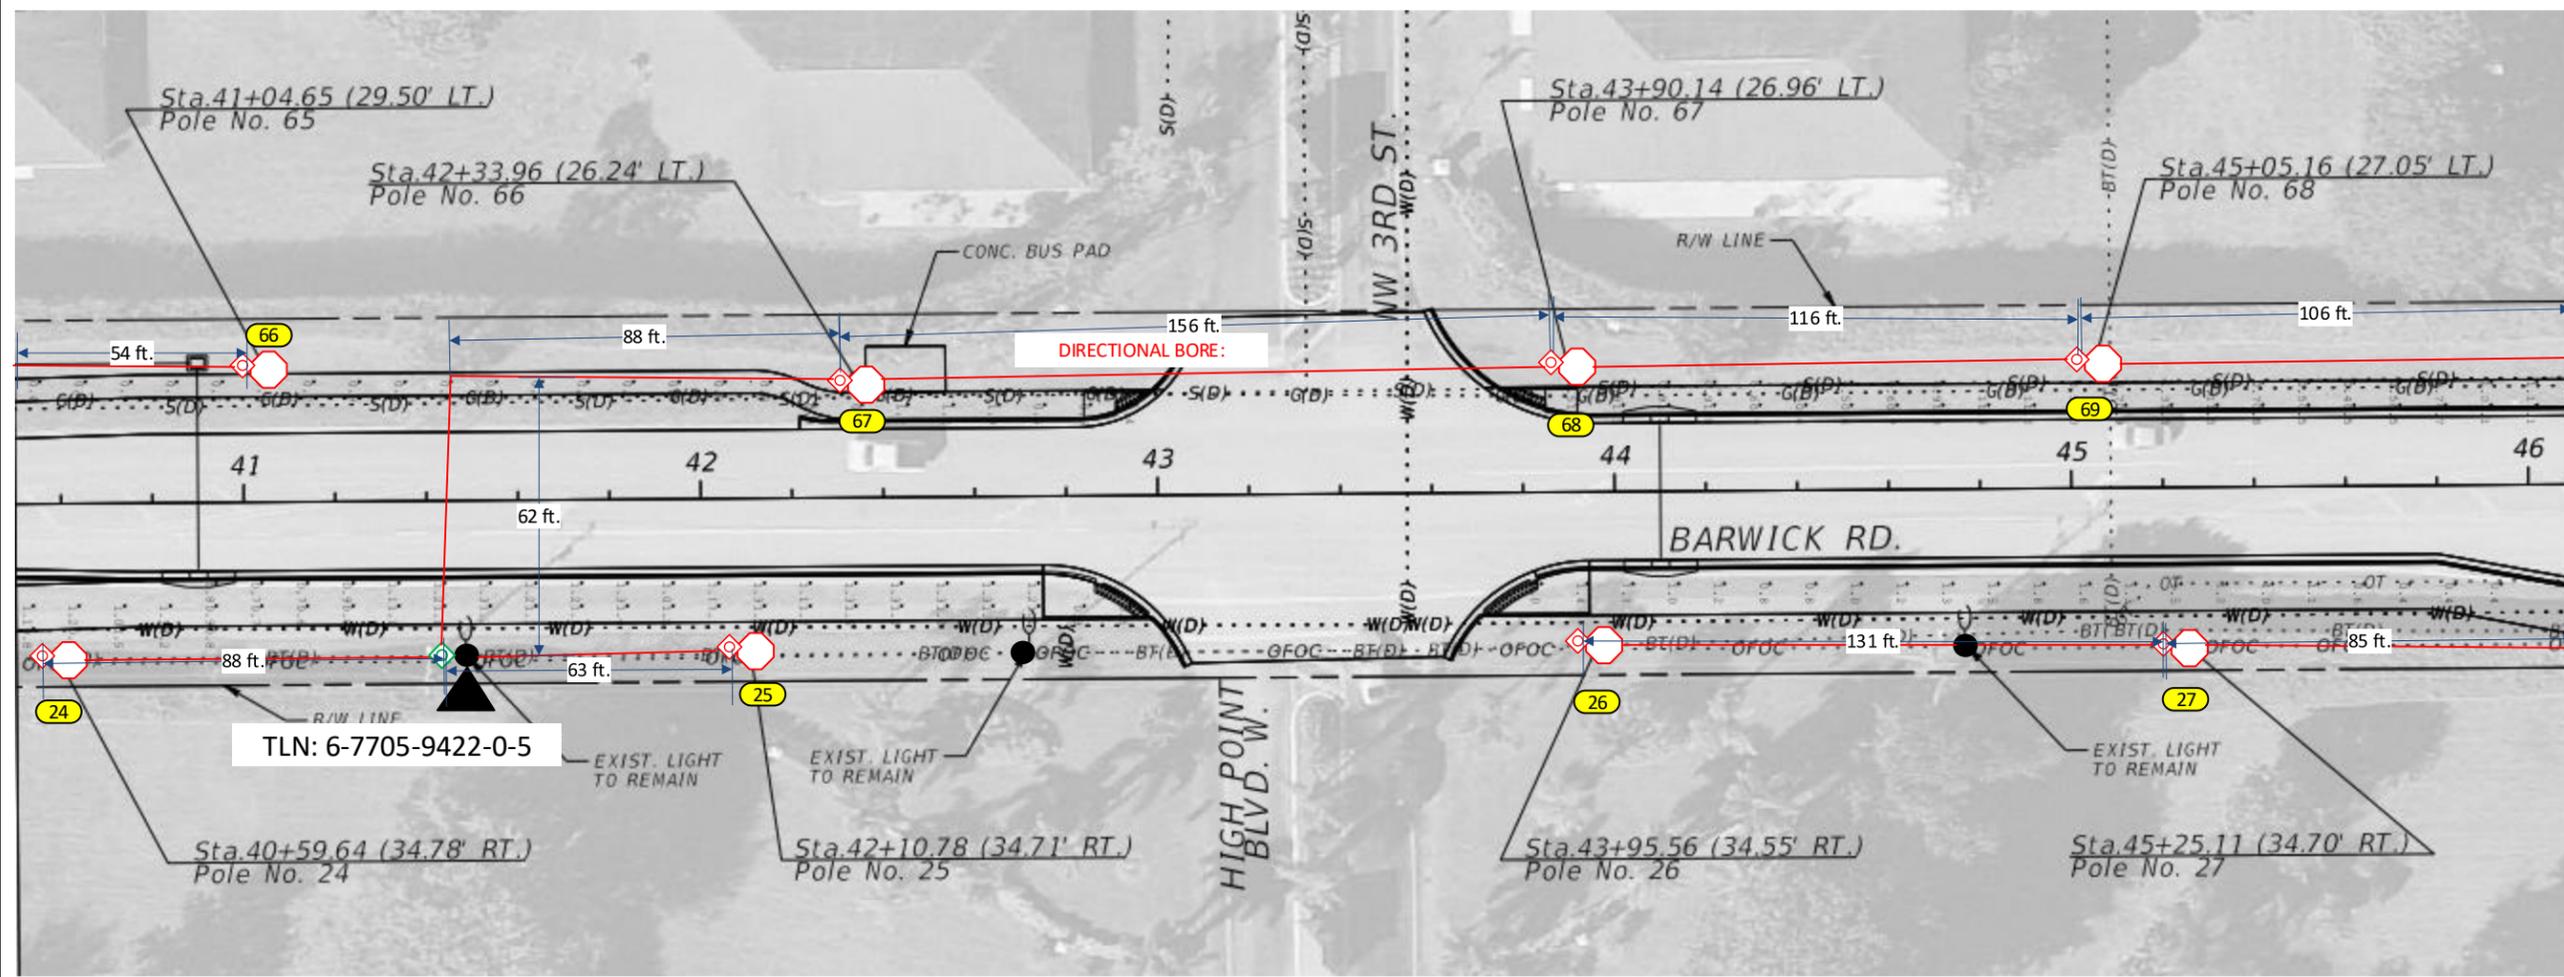

- FPL Construction Symbols
- = Proposed UG Cable in 2" Conduit
 - ◊ = Proposed 17" Handhole
 - ◊ = Proposed 24" Handhole
 - ◊ = Existing Handhole
 - ◻ = Existing PM Transformer
 - ◼ = Existing OH Transformer
 - = Proposed Streetlight and Pole


PERMIT REQUIRED FOR ALL LOCATIONS

Construction Notes: (Customer installing conduit and handoles)

Customer to install 2" conduit and 17" HH and 24" HH. Call Locates before digging for each location
 Loc. 1-85: FPL contractor to install (85) GREEN WASHINGTON FOR SINGLE POST TOPS 18' 6" (14' 6" MH) POLE and (85)HOLOPHANE GRANVILLE GREEN/GREEN 39W 3000K 5,190L.
 Verify fixture is working correctly after installation.
 Check 120V to terminal blocks.
 'CHECK VOLTAGE – CONVERT 480V to 120V or 240V' On 480V circuits, change the relay prior to installing the lights. Verify the source and amount of lights on that relay. Contact the FPL PL to assist with this process.
 -All locations are 17"HH unless otherwise specified.
 -FPL crew to run #6 DPX UG cable to all locations shown in the drawing.
 -All facilities to be installed within utility easement.
 -Customer to contact FPL PL and coordinate staking of all locations prior LED installations. Customer is responsible for any restoration required.
 FPL LED Representative: Gladys Reyes

AS-BUILT CREW PRINT		ALL REQUIRED GROUND RODS HAVE BEEN DRIVEN & VERIFIED TO BE WITH FPL STANDARDS, VALUES ARE SHOWN AT ALLOCATIONS.		JOB CERTIFIED COMPLETED AS SHOWN ON THIS AS-BUILT PRINT. MATERIAL CHANGES SHOWN ON RDS.		AS-BUILT COPY	
FOREMAN SIGNATURE _____ DATE _____		FOREMAN SIGNATURE _____ DATE _____		SUPERVISOR SIGNATURE _____ DATE _____		INITIALS _____ CERT. DATE _____	
Easement? Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>		Survey/Stake? Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>		Work with SMO? Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>		FPL City of Delray- Along Barwick Rd Install 85 Green Holophane Post and 85 Poles	
Tree Work? Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>		Designer/Stake? Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>		CT/Special Mtr? Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>			
PERMIT REQ'D	City	County Rd.	County Air	State Road	FAA	Designed by: Jesufane Mentor Date: 12/20/22	
	WMD	RR Xing	DR. Dist.	Transm.			
Requested Tel. Co. Set Poles? YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>		Requested Tel. Co. Transfer? YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>		Request CAVT Transfer? YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>		Rural Location Sec. 09 TWP. 28 S, RGE. 37 E.	
POLE LINE FEET 0'		DUCT BANK FT. 0'		TRENCH FT. 0'		SCALE: N.T.S. St. Lt MAP No. MAP# Pri Map No. CC0709	
TLM/LDS MODEL No. -		Map Posting? YES <input checked="" type="checkbox"/> NO <input type="checkbox"/>		Posted by: _____		WR XXXXXXXX M/A BV	

INACCESSIBLE
 13 kV
 FUTURE 23 kV
 23 kV
 SALT SPRAY

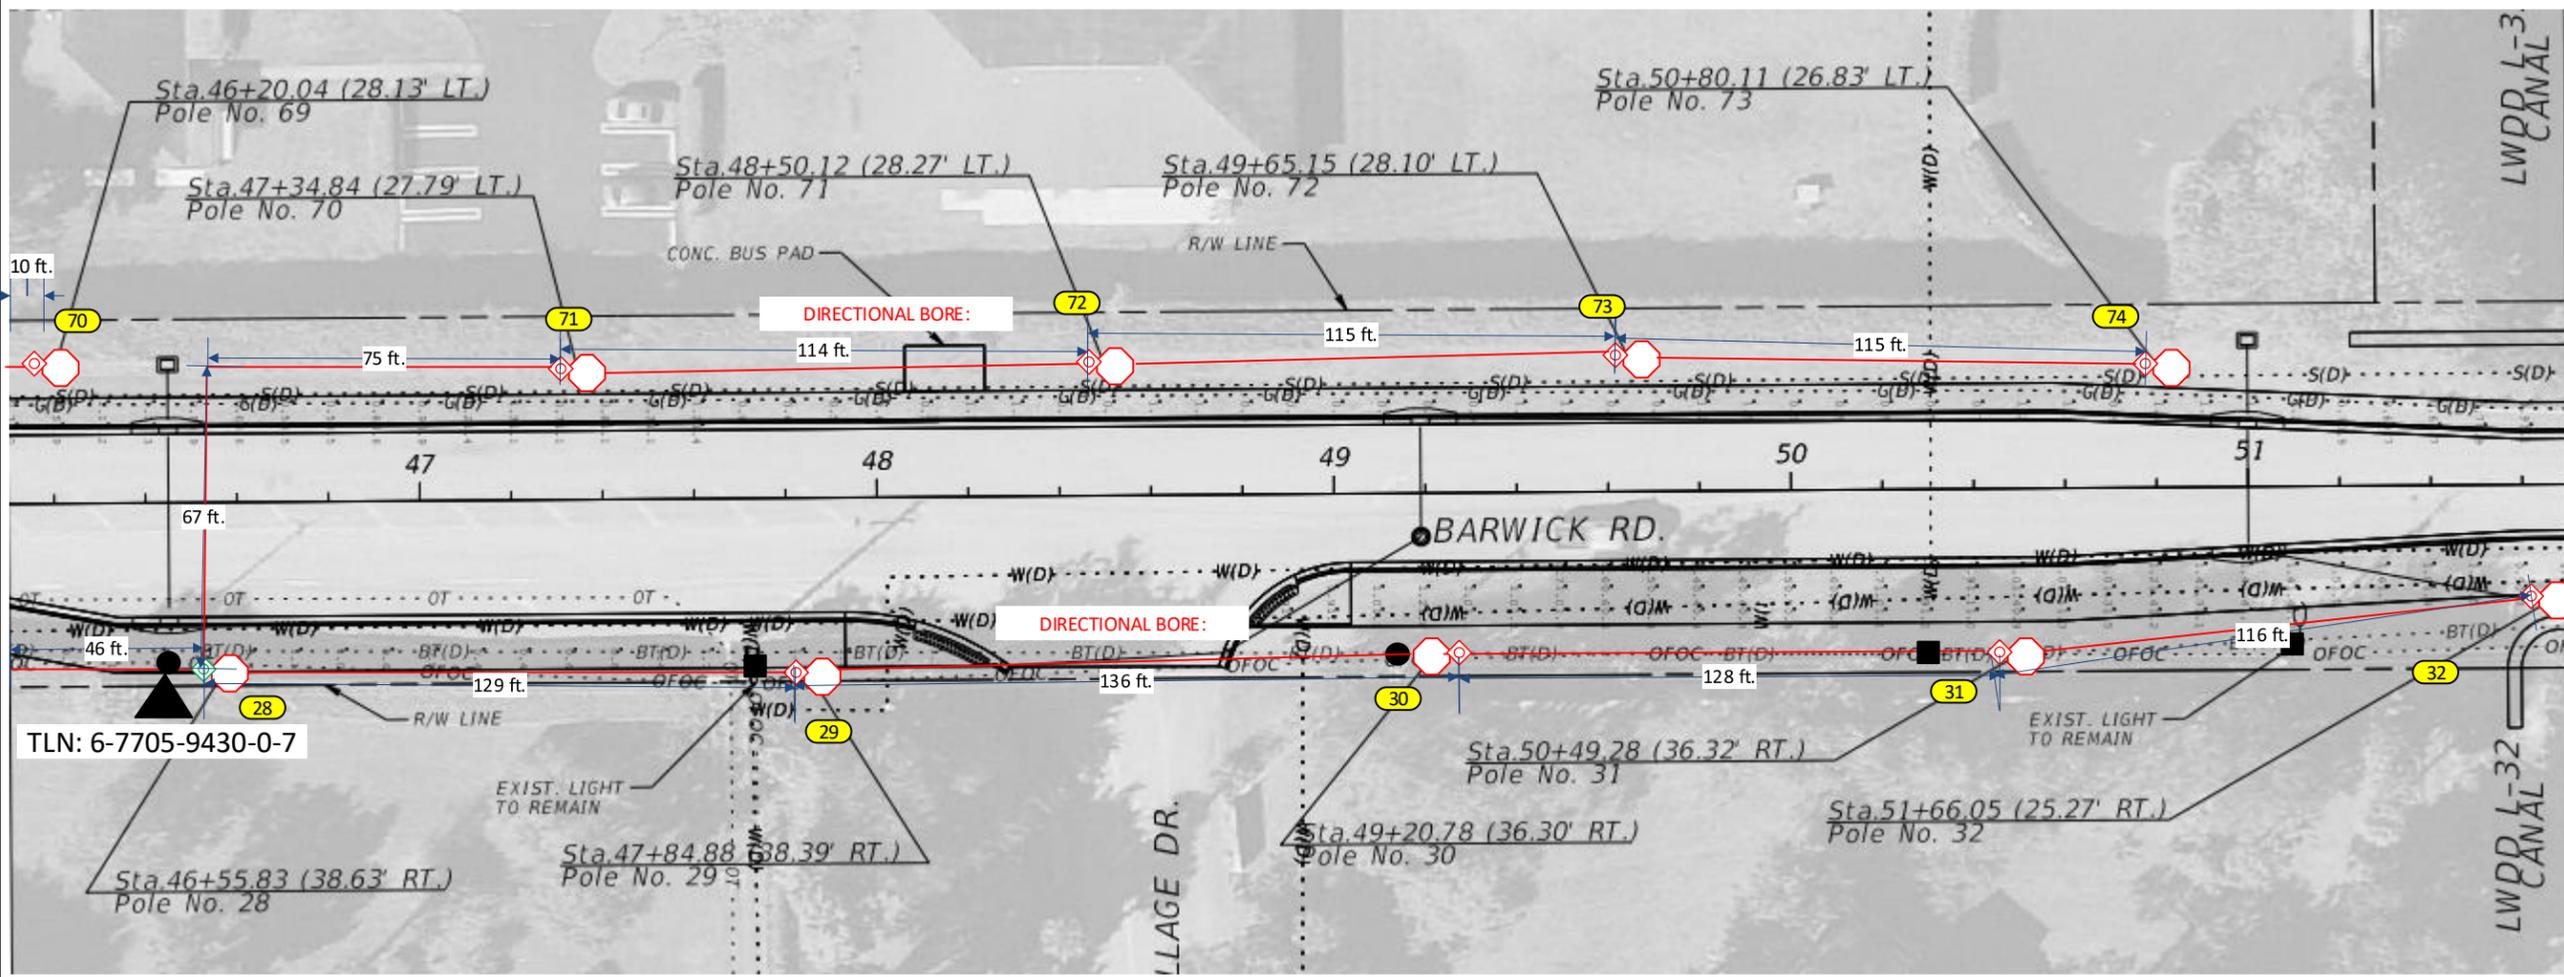

- FPL Construction Symbols**
- = Proposed UG Cable in 2" Conduit
 - ◇ = Proposed 17" Handhole
 - ◇ = Proposed 24" Handhole
 - ◇ = Existing Handhole
 - ▴ = Existing PM Transformer
 - ▾ = Existing OH Transformer
 - ◇ = Proposed Streetlight and Pole

TLN: 6-7705-9430-0-7

PERMIT REQUIRED FOR ALL LOCATIONS


Construction Notes: (Customer installing conduit and handholes)

- Customer to install 2" conduit and 17" HH and 24" HH. Call Locates before digging for each location
- Loc. 1-85: FPL contractor to install (85) GREEN WASHINGTON FOR SINGLE POST TOPS 18' 6" (14' 6" MH) POLE and (85)HOLOPHANE GRANVILLE GREEN/GREEN 39W 3000K 5,190L.
- Verify fixture is working correctly after installation.
- Check 120V to terminal blocks.
- 'CHECK VOLTAGE – CONVERT 480V to 120V or 240V' On 480V circuits, change the relay prior to installing the lights. Verify the source and amount of lights on that relay. Contact the FPL PL to assist with this process.
- All locations are 17"HH unless otherwise specified.
- FPL crew to run #6 DPX UG cable to all locations shown in the drawing.
- All facilities to be installed within utility easement.
- Customer to contact FPL PL and coordinate staking of all locations prior LED installations. Customer is responsible for any restoration required.

FPL LED Representative: Gladys Reyes

AS-BUILT CREW PRINT		<small>ALL REQUIRED GROUND RODS HAVE BEEN DRIVEN & VERIFIED TO BE WITHIN FPL STANDARDS. VALUES ARE SHOWN AT ALLOCATIONS.</small>		<small>JOB CERTIFIED COMPLETED AS SHOWN ON THIS AS-BUILT PRINT. MATERIAL CHANGES SHOWN ON RODS.</small>		AS-BUILT COPY	
FOREMAN SIGNATURE _____ DATE _____		FOREMAN SIGNATURE _____ DATE _____		SUPERVISOR SIGNATURE _____ DATE _____		INITIALS _____ CERT. DATE _____	
Easement?	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	Survey/Stake?	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	Work with SMO?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	FPL City of Delray- Along Barwick Rd Install 85 Green Holophane Post and 85 Poles	
Tree Work?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	Designer/Stake?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	CT/Special Mtr?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>		
PERMIT REQ'D	City _____ County Rd. _____ County Air _____ State Road _____ FAA _____	WMD _____ RR Xing _____ DR. Dist. _____ Transm. _____	Requested Tel. Co. Set Poles? YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>		Requested Tel. Co. Transfer? YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>		Designed by: Jesufane Mentor
Request CAVT Transfer? YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>		Telephone Co. Job No. _____		Request CAVT Transfer? YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>		Date: 12/20/22	
POLE LINE FEET 0'		DUCT BANK FT. 0'		Rural Location Sec. 09 TWP. 28 S, RGE. 37 E.		Drawn by: JJM Check by: _____ Dwg No. 8 OF 11	
POLE LINE FT. ON TRANSM. POLES 0'		TRENCH FT. 0'		SCALE: N.T.S. St. Lt MAP No. MAP# _____ Pri Map No. CC0709		WR XXXXXXXX	
TLM/LDS MODEL No. -		Map Posting? YES <input checked="" type="checkbox"/> NO <input type="checkbox"/> Posted by: _____		M/A _____ BV _____			

INACCESSIBLE 13 kV FUTURE 23 kV 23 kV SALT SPRAY

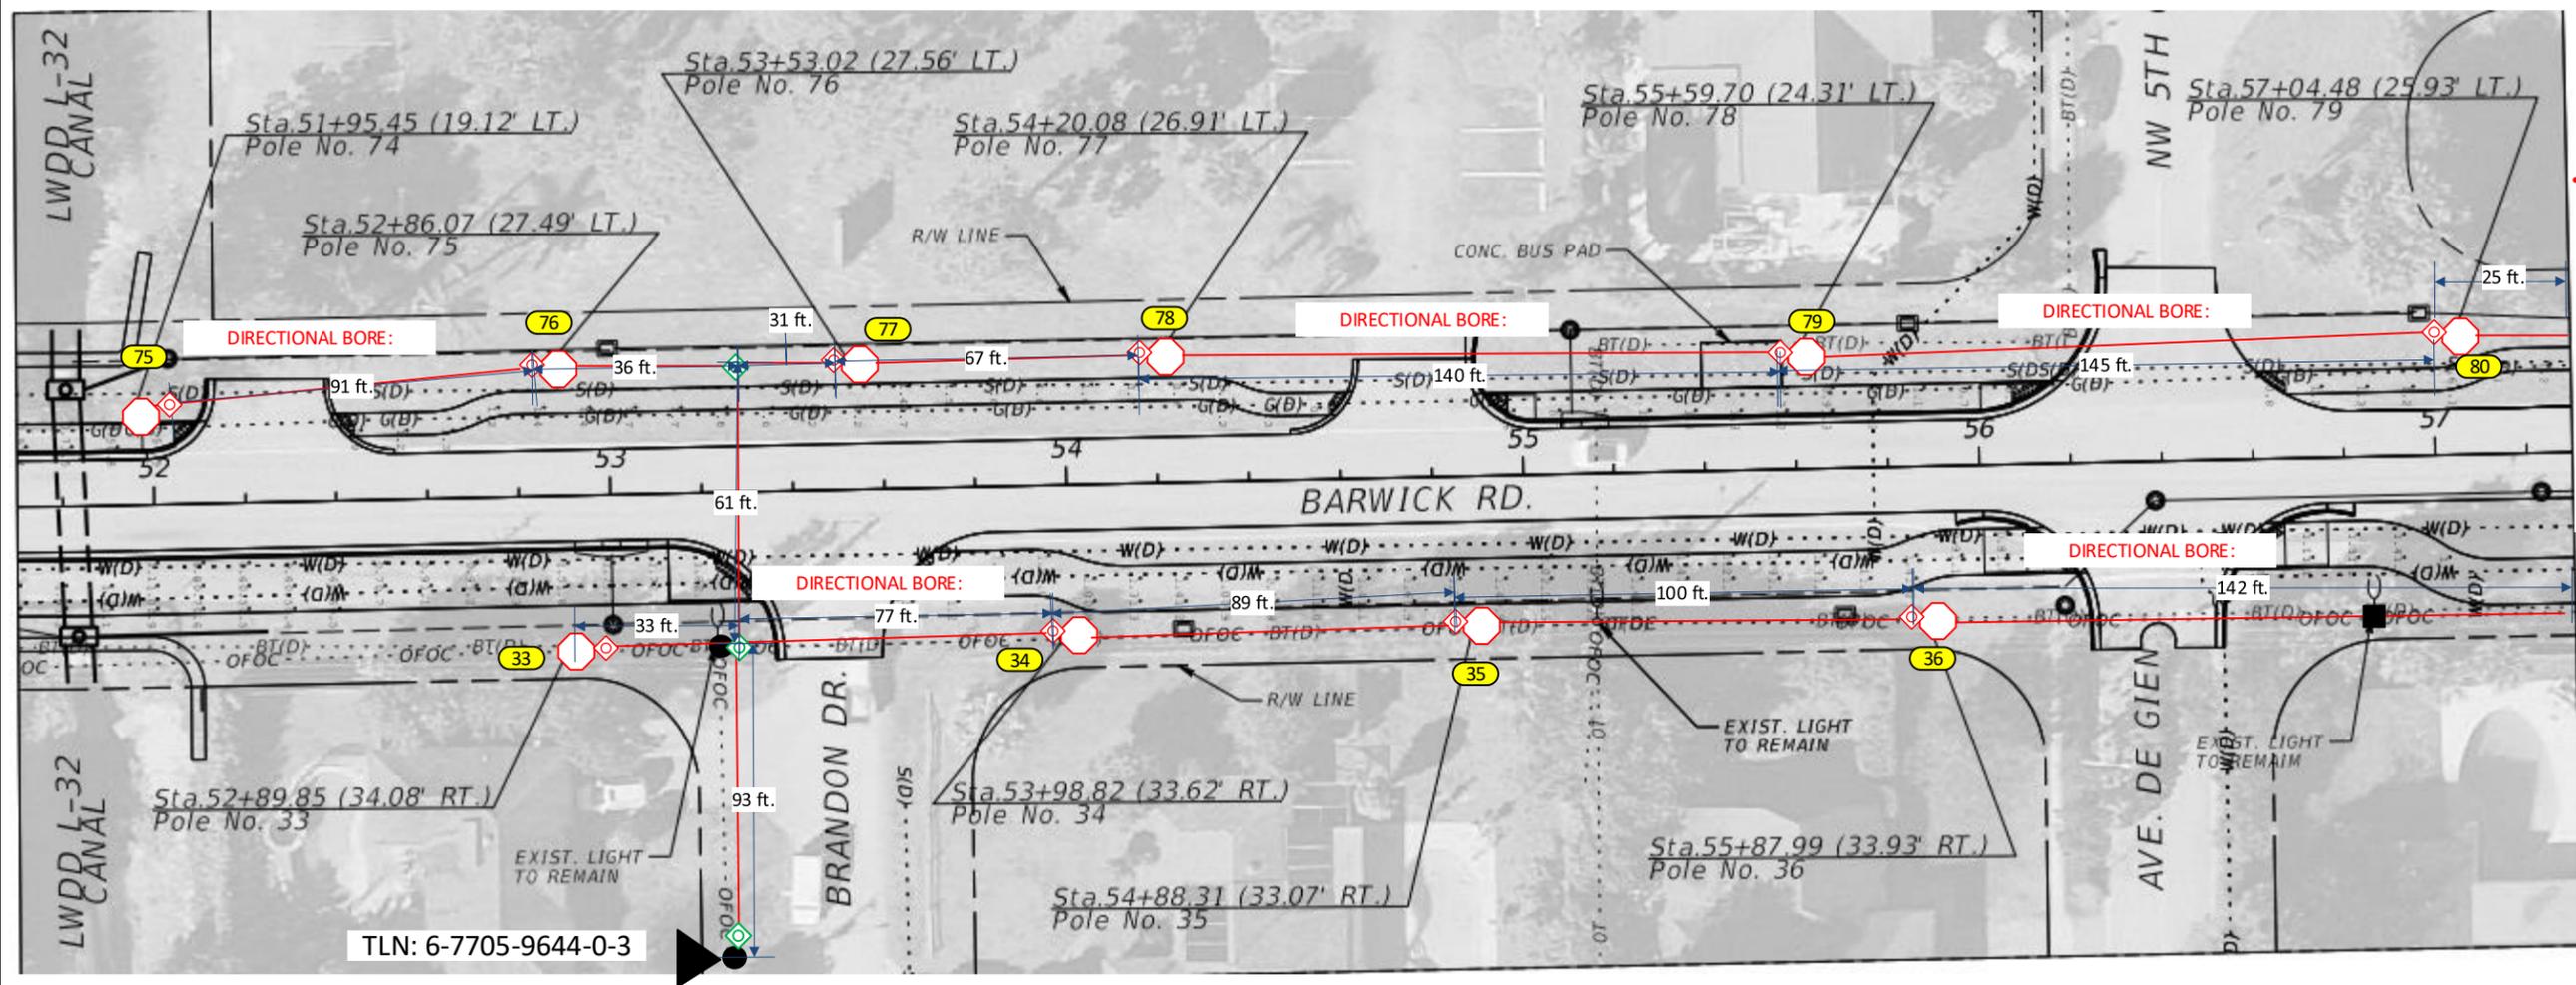

- FPL Construction Symbols**
- = Proposed UG Cable in 2" Conduit
 - ◇ = Proposed 17" Handhole
 - ◇ = Proposed 24" Handhole
 - ◆ = Existing Handhole
 - ▣ = Existing PM Transformer
 - ▾ = Existing OH Transformer
 - = Proposed Streetlight and Pole

TLN: 6-7705-9644-0-3

PERMIT REQUIRED FOR ALL LOCATIONS



Construction Notes: (Customer installing conduit and handoles)

- Customer to install 2" conduit and 17" HH and 24" HH. Call Locates before digging for each location
- Loc. 1-85: FPL contractor to install (85) GREEN WASHINGTON FOR SINGLE POST TOPS 18' 6" (14' 6" MH) POLE and (85)HOLOPHANE GRANVILLE GREEN/GREEN 39W 3000K 5,190L.
- Verify fixture is working correctly after installation.
- Check 120V to terminal blocks.
- 'CHECK VOLTAGE – CONVERT 480V to 120V or 240V' On 480V circuits, change the relay prior to installing the lights. Verify the source and amount of lights on that relay. Contact the FPL PL to assist with this process.
- All locations are 17"HH unless otherwise specified.
- FPL crew to run #6 DPX UG cable to all locations shown in the drawing.
- All facilities to be installed within utility easement.
- Customer to contact FPL PL and coordinate staking of all locations prior LED installations. Customer is responsible for any restoration required.

FPL LED Representative: Gladys Reyes

AS-BUILT CREW PRINT		<small>ALL REQUIRED GROUND RODS HAVE BEEN DRIVEN & VERIFIED TO BE WITHIN FPL STANDARDS. VALUES ARE SHOWN AT LOCATIONS.</small>		<small>JOB CERTIFIED COMPLETED AS SHOWN ON THIS AS-BUILT PRINT. MATERIAL CHANGES SHOWN ON RDS</small>		AS-BUILT COPY	
FOREMAN SIGNATURE _____ DATE _____		FOREMAN SIGNATURE _____ DATE _____		SUPERVISOR SIGNATURE _____ DATE _____		INITIALS _____ CERT. DATE _____	
Easement? Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	Survey/Stake? Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	Work with SMO? Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	FPL				
Tree Work? Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	Designer/Stake? Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	CT/Special Mtr? Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	City of Delray- Along Barwick Rd Install 85 Green Holophane Post and 85 Poles				
PERMIT REQ'D	City	County Rd.	County Air	State Road	FAA	Designed by: Jesufane Mentor Date: 12/20/22	
	WMD	RR Xing	DR. Dist.	Transm.		Drawn by: JJM Check by: Dwg No. 9 OF 11	
Requested Tel. Co. Set Poles? YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	Tele. Attachment Per		Rural Location Sec. 09 TWP. 28 S, RGE. 37 E.				
Requested Tel. Co. Transfer? YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	Telephone Co. Job No.		SCALE: N.T.S. St. Lt MAP No. MAP# Pri Map No. CC0709				
Request CAVT Transfer? YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	POLE LINE FEET 0'	DUCT BANK FT. 0'	WR XXXXXXXX M/A BV				
	POLE LINE FT. ON TRANSM. POLES 0'	TRENCH FT. 0'					
TLM/LDS MODEL No. -	Map Posting? YES <input checked="" type="checkbox"/> NO <input type="checkbox"/>	Posted by:					

INACCESSIBLE 13 kV FUTURE 23 kV 23 kV SALT SPRAY

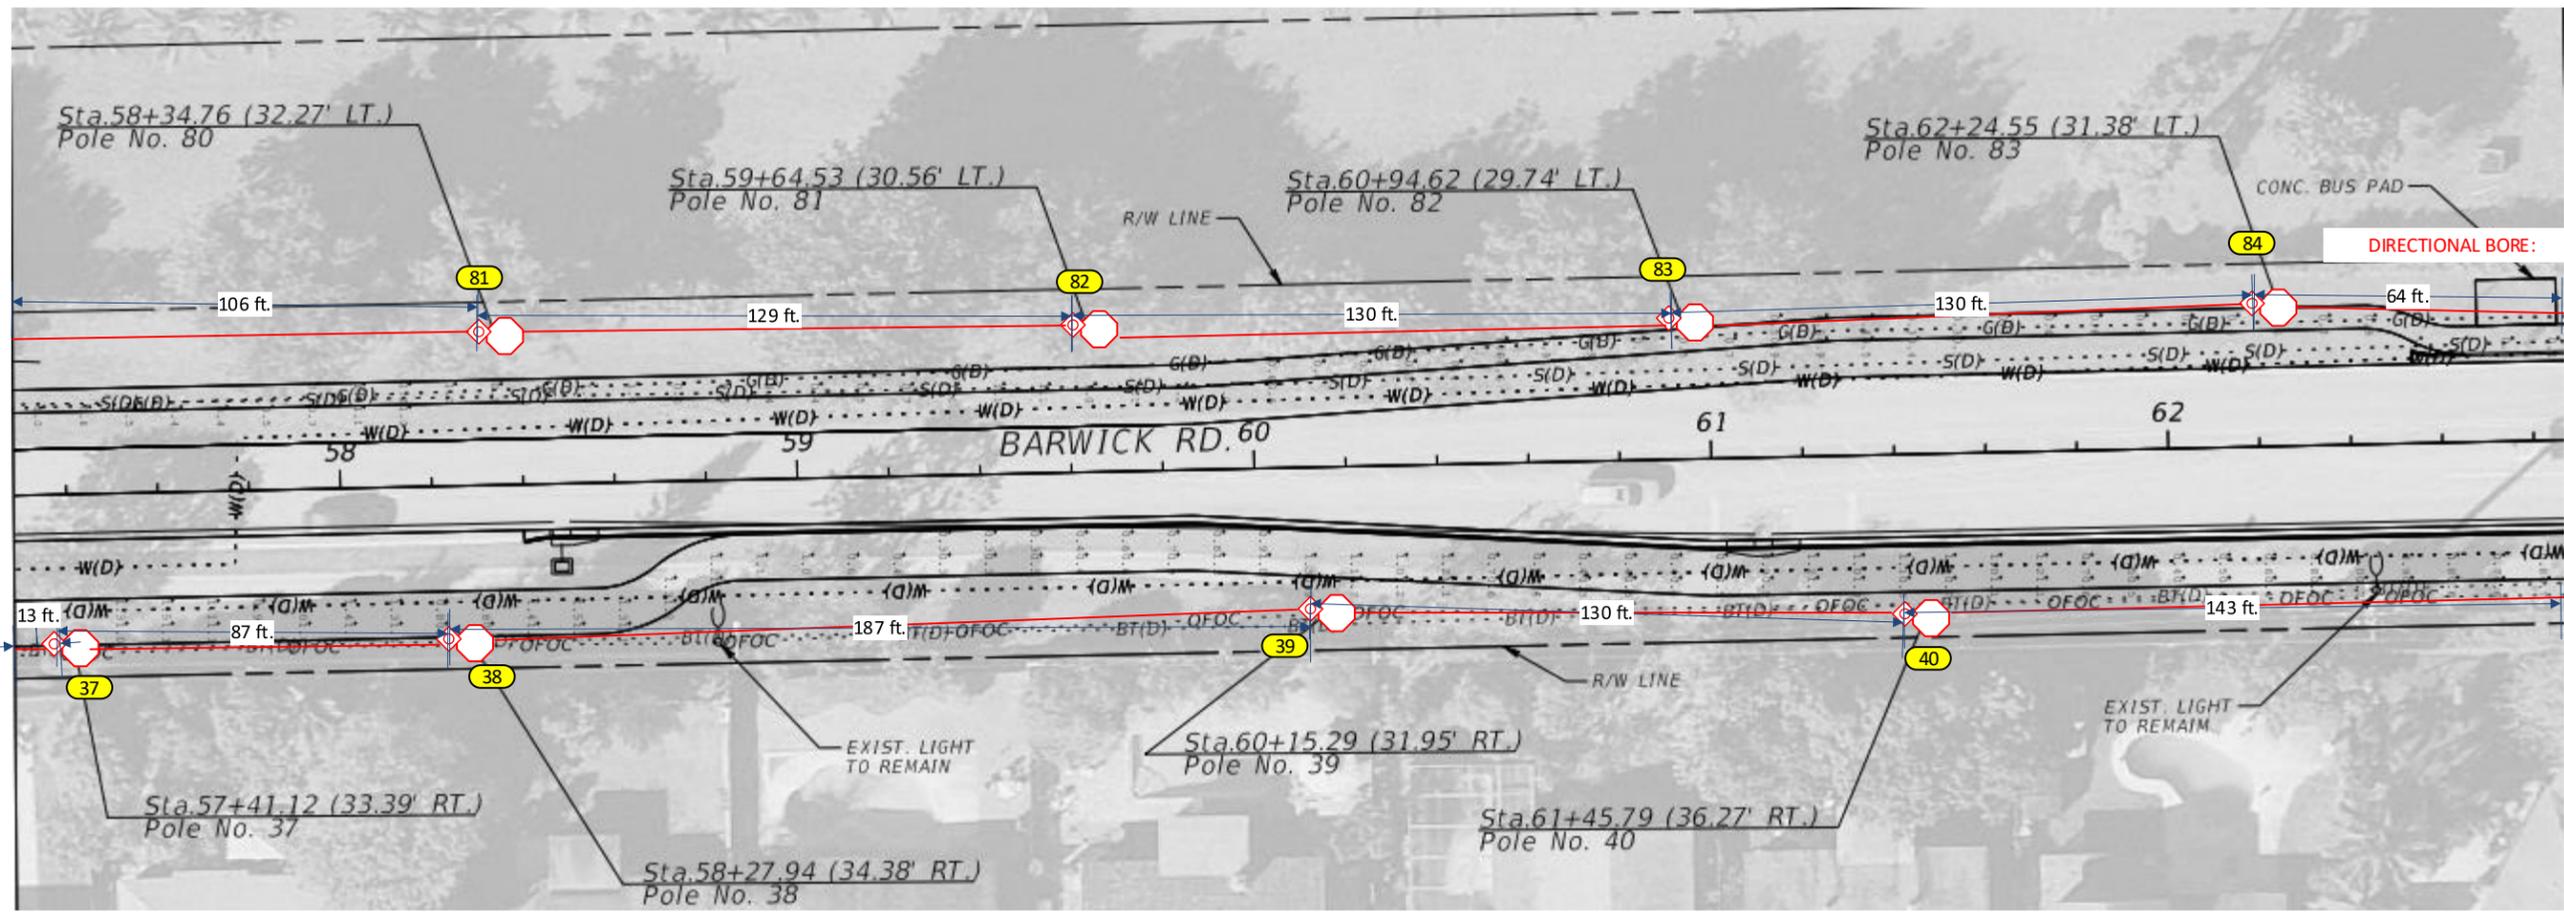

- FPL Construction Symbols
- = Proposed UG Cable in 2" Conduit
 - ◇ = Proposed 17" Handhole
 - ◇ = Proposed 24" Handhole
 - ◇ = Existing Handhole
 - ▾ = Existing PM Transformer
 - ▾ = Existing OH Transformer
 - ◇ = Proposed Streetlight and Pole

PERMIT REQUIRED FOR ALL LOCATIONS

Construction Notes: (Customer installing conduit and handoles)

- Customer to install 2" conduit and 17" HH and 24" HH. Call Locates before digging for each location
- Loc. 1-85: FPL contractor to install (85) GREEN WASHINGTON FOR SINGLE POST TOPS 18' 6" (14' 6" MH) POLE and (85)HOLOPHANE GRANVILLE GREEN/GREEN 39W 3000K 5,190L.
- Verify fixture is working correctly after installation.
- Check 120V to terminal blocks.
- 'CHECK VOLTAGE – CONVERT 480V to 120V or 240V' On 480V circuits, change the relay prior to installing the lights. Verify the source and amount of lights on that relay. Contact the FPL PL to assist with this process.
- All locations are 17"HH unless otherwise specified.
- FPL crew to run #6 DPX UG cable to all locations shown in the drawing.
- All facilities to be installed within utility easement.
- Customer to contact FPL PL and coordinate staking of all locations prior LED installations. Customer is responsible for any restoration required.

FPL LED Representative: Gladys Reyes

AS-BUILT CREW PRINT		ALL REQUIRED GROUND RODS HAVE BEEN DRIVEN & VERIFIED TO BE WITH FPL STANDARDS. VALUES ARE SHOWN AT ALLOCATIONS.		JOB CERTIFIED COMPLETED AS SHOWN ON THIS AS-BUILT PRINT. MATERIAL CHANGES SHOWN ON ROS.		AS-BUILT COPY	
FOREMAN SIGNATURE _____ DATE _____		FOREMAN SIGNATURE _____ DATE _____		SUPERVISOR SIGNATURE _____ DATE _____		INITIALS _____ CERT. DATE _____	
Easement?	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	Survey/Stake?	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	Work with SMO?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	FPL City of Delray- Along Barwick Rd Install 85 Green Holophane Post and 85 Poles	
Tree Work?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	Designer/Stake?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	CT/Special Mtr?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>		
PERMIT REQ'D	City _____ County Rd. _____ County Air _____ State Road _____ FAA _____	WMD _____ RR Xing _____ DR. Dist. _____ Transm. _____	Tele. Attachment Per _____ Telephone Co. Job No. _____		Designed by: Jesufane Mentor Date: 12/20/22		
Requested Tel. Co. Set Poles?	YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	Requested Tel. Co. Transfer?	YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	Request CAVT Transfer?	YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	Drawn by: JJM Check by: _____ Dwg No. 10 OF 11	
POLE LINE FEET	0'	DUCT BANK FT.	0'	Rural Location Sec. 09 TWP. 28 S, RGE. 37 E.			
POLE LINE FT. ON TRANSM. POLES	0'	TRENCH FT.	0'	SCALE: N.T.S.	St. Lt MAP No. MAP#	Pri Map No. CC0709	
TLM/LDS MODEL No.	-	Map Posting?	YES <input checked="" type="checkbox"/> NO <input type="checkbox"/>	Posted by:	WR XXXXXXXX	M/A	BV

INACCESSIBLE
 13 kV
 FUTURE 23 kV
 23 kV
 SALT SPRAY



FPL Construction Symbols

- = Proposed UG Cable in 2" Conduit
- ◊ = Proposed 17" Handhole
- ◊ = Proposed 24" Handhole
- ◊ = Existing Handhole
- ◼ = Existing PM Transformer
- ◼ = Existing OH Transformer
- = Proposed Streetlight and Pole



PERMIT REQUIRED FOR ALL LOCATIONS

Construction Notes: (Customer installing conduit and handholes)

Customer to install 2" conduit and 17" HH and 24" HH. Call Locates before digging for each location
 Loc. 1-85: FPL contractor to install (85) GREEN WASHINGTON FOR SINGLE POST TOPS 18' 6" (14' 6" MH) POLE and (85)HOLOPHANE GRANVILLE GREEN/GREEN 39W 3000K 5,190L.
 Verify fixture is working correctly after installation.
 Check 120V to terminal blocks.
 'CHECK VOLTAGE – CONVERT 480V to 120V or 240V' On 480V circuits, change the relay prior to installing the lights. Verify the source and amount of lights on that relay. Contact the FPL PL to assist with this process.
 -All locations are 17"HH unless otherwise specified.
 -FPL crew to run #6 DPX UG cable to all locations shown in the drawing.
 -All facilities to be installed within utility easement.
 -Customer to contact FPL PL and coordinate staking of all locations prior LED installations. Customer is responsible for any restoration required.

FPL LED Representative: Gladys Reyes

AS-BUILT CREW PRINT		ALL REQUIRED GROUND RODS HAVE BEEN DRIVEN & VERIFIED TO BE WITHIN FPL STANDARDS. VALUES ARE SHOWN AT ALLOCATIONS.		JOB CERTIFIED COMPLETED AS SHOWN ON THIS AS-BUILT PRINT. MATERIAL CHANGES SHOWN ON ROS.		AS-BUILT COPY	
FOREMAN SIGNATURE _____ DATE _____		FOREMAN SIGNATURE _____ DATE _____		SUPERVISOR SIGNATURE _____ DATE _____		INITIALS _____ CERT. DATE _____	
Easement?	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	Survey/Stake?	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	Work with SMO?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	FPL City of Delray- Along Barwick Rd Install 85 Green Holophane Post and 85 Poles	
Tree Work?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	Designer/Stake?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	CT/Special Mtr?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>		
PERMIT REQ'D	City	County Rd.	County Air	State Road	FAA	Designed by: Jesufane Mentor Date: 12/20/22	
	WMD	RR Xing	DR. Dist.	Transm.			
Requested Tel. Co. Set Poles?	YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	Tele. Attachment Per		Rural Location Sec.		09 TWP. 28 S, RGE. 37 E.	
Requested Tel. Co. Transfer?	YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	Telephone Co. Job No.		SCALE: N.T.S.		St. Lt MAP No. MAP# Pri Map No. CC0709	
Request CAVT Transfer?	YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>	POLE LINE FEET	DUCT BANK FT.	TRENCH FT.	WR XXXXXXXX M/A BV		
		0'	0'	0'			
TLM/LDS MODEL No.	-	Map Posting?	YES <input checked="" type="checkbox"/> NO <input type="checkbox"/>	Posted by:			