



Planning, Zoning, and Building Department

BOARD ACTION REPORT – APPEALABLE ITEM

Project Name: Orchard Supply Hardware, New Century Commons
Project Location: 500-510 West Linton Boulevard
Request: Class IV Site Plan Modification
Board: Site Plan Review and Appearance Board
Meeting Date: March 22, 2017

Board Action:

Approve the Class IV Site Plan Modification, Landscape Plan, and Architectural Elevations on a 5 to 0 vote (Shannon Dawson and Linda Purdo-Enochs absent)

Project Description:

The subject property is located on the north side of West Linton Boulevard between SW 4th Avenue and Lavers Circle. The 8.89 acre property consists of Track “A”, Costco Wholesale-Delray Beach and is zoned PC (Planned Commercial).

The request is to approve a 6,636 square foot addition to the west side of the principal building, adjacent to the space formerly occupied by Sports Authority and associated site improvements for landscaping, parking, and lighting. The addition will provide a plant/outdoor nursery area for the new tenant which also requires elevation changes.

Board Comments:

Board comments were relevant to the landscaping and proposed colors.

Public Comments:

No members of the public spoke for or against the project.

Associated Actions:

All required actions were taken.

Next Action:

SPRAB action is final unless appealed by the City Commission.

SITE PLAN REVIEW AND APPEARANCE BOARD

CITY OF DELRAY BEACH

---STAFF REPORT---

MEETING DATE: March 22, 20017

ITEM: **Orchard Supply Hardware (2017-066):** Class IV Site Plan Modification, Landscape Plan and Architectural Elevations for an addition and parking lot and landscaping modifications at 500 West Linton Boulevard.

RECOMMENDATION: Approve subject to conditions

GENERAL DATA:

Owner/Applicant: New Century Linton One LLC

Agent: Weiner & Aronson P.A.

Location: Southwest corner of Linton Boulevard and SW 4th Avenue

Property Size: 8.89 acres

Future Land Use Map: GC (General Commercial)

Current Zoning: PC (Planned Commercial)

Adjacent Zoning:

North:	GC and POD (Professional Office District)
South:	SAD (Special Activities District)
East:	GC and I (Industrial)
West:	PC

Existing Land Use.: Commercial

Proposed Land Use: Commercial

Water Service: Existing on site

Sewer Service: Existing on site



ITEM BEFORE THE BOARD

The item before the Board is the approval of a Class IV Site Plan Modification for **Orchard Supply Hardware** located within **New Century Commons** at **500 - 510 West Linton Boulevard**, pursuant to Land Development Regulations (LDR) Section 2.4.5(G)(1)(c).

BACKGROUND

The subject property is located on the north side of West Linton Boulevard between SW 4th Avenue and Lavers Circle. The 8.89 acre property consists of Track "A", Costco Wholesale-Delray Beach and is zoned PC (Planned Commercial).

The property originally contained a 117,218 square feet building constructed in 1990 for Costco wholesale. In 2007, a Class IV Site Plan Modification was approved by the Board for the partial demolition of the existing building and conversion of the remaining 72,582 square feet building for multiple tenant retail use. Two additional out buildings containing approximately 13,600 sq. ft were also approved on the site, adjacent to West Linton Boulevard; the building at the northwest corner of the site contained approximately 7,400 square feet, while the building at the northeast corner contained approximately 6,200 square feet.

At its meeting of September 18, 2007, the City Commission approved the elevations for the development subsequent to a recommendation of approval by the Board at its September 10, 2007 meeting.

PROJECT DESCRIPTION

The subject request consists of the following site revisions:

- Addition of 6,636 square feet to the west side of the principal building, adjacent to the space formerly occupied by Sports Authority;
- Removal of 34 parking spaces in location of proposed addition;
- Reconfiguration of driveways adjacent to addition;
- Removal of landscaping, lighting, curbing, and other existing improvements in location of proposed addition;
- New landscaping and lighting, as needed within existing area to be improved;
- New concrete pad for deliveries with ramp at the rear of the new addition; and,
- New dumpster and recycling facilities at rear of building within delivery area.

The addition will provide a plant/outdoor nursery area for the new tenant, and will therefore be enclosed by a black, vertical rod fence topped with a green standing seam metal roof. The elevation changes to the existing building consist of the following:

- Shed-style, forest green awnings;
- New vertical corrugated metal panel over the existing metal panel above the main entrance;
- New color scheme combination of "Gingersnaps" (light brown), "Coconut Grove" (Brown), and the existing Light Yellow, Gray/Green, and Dark Gray on the wall planes, with off-white trim to accent.

SITE PLAN ANALYSIS

Pursuant to **LDR Section 2.4.5(F)(5)**, the approving body must make a finding that development of the property pursuant to the site plan will be compatible and harmonious with adjacent and nearby

properties and the City as a whole, so as not to cause substantial depreciation of property values. The following table identifies the zoning designations and uses that are adjacent to the subject property:

	Zoning Designation:	Use:
North:	General Commercial (GC) and POD (Planned Office Development)	Delray Village Shoppes & Women's Cancer Care
South:	SAD (Special Activities District)	Laver's North (Multi-family residential / condominiums)
East:	GC and I (Industrial)	Shell Gas Stations & Delray Industrial Park
West:	PC	Commercial Development (Lavers International Plaza)

Pursuant to **LDR Section 4.4.12(B)(1), Principal Uses and Structures Permitted**, all uses allowed as such within the GC District are permitted within the PC District. The permitted uses within the GC District include general retail uses and/or facilities, such as the existing uses on the site. The proposed use is not new and the applicant has not requested a change of use.

Development Standards

Pursuant to **LDR Section 4.4.12(F)**, the development standards set forth in Section 4.3.4 shall apply. The Development Standards Matrix in **LDR Section 4.3.4(K)** requires the following applicable standards:

	Standard	Provided
Open Space (Minimum)	25%	25.12%
Setbacks:		
Side-Interior (West):	10'	75'
Rear (South):	10'	110'

As illustrated above, the requirements applicable to or impacted by the proposed addition and associated improvements have been met.

Minimum Parking Requirements:

Pursuant to **LDR Section 4.6.9(C)(3)(e), Shopping Centers**, 4 spaces per 1,000 square feet of gross floor area is required for shopping centers containing 25,000 to 400,000 square feet. The parking requirement for the existing 89,159 square foot center is 345 spaces. The proposed addition requires 25.54 spaces (6,636 square feet / 1,000 x 4). Therefore, the required parking for the entire center is 371. The site provides 462 parking spaces; the proposed improvements eliminate 34 spaces, for a remaining total of parking provided at 428.

SECTION 4.6.16, LANDSCAPE REGULATIONS

Pursuant to **LDR Section 4.6.16(D)(3), Applicability**, the provisions of this Section shall apply to any new development, or any modification of existing development. That portion of the site which is being newly developed or modified must comply with the requirements contained herein.

The proposed modifications at the southwest corner of the property have been reviewed for compliance with the applicable Standards and have been found to be in compliance by the City's Senior Landscape Planner. The landscape modifications consist of the removal of two trees of an "unknown" species; relocation of 19 existing trees; and retainment of the other trees within the area to be impacted. The provided Landscape Calculation Form indicates that 18 native trees are

required, while 35 were provided. The groundcovers will consist of Variegated Flax Lily, Green Island Ficus, and Dwarf Firebush, accented by Queen Emma Crinum Lily shrubs.

SECTION 4.6.18, ARCHITECTURAL ELEVATIONS AND AESTHETICS

Pursuant to **LDR Section 4.6.18(B)(1), Building and Structure Requirements**, buildings or structures which are a part of a present or future group or complex shall have a unity of character and design. The relationship of forms and the use, texture, and color of materials shall be such as to create a harmonious whole. When the area involved forms an integral part of, is immediately adjacent to, or otherwise clearly affects the future of any established section of the City, the design, scale and location on the site shall enhance rather than detract from the character, value, and attractiveness of the surroundings.

Pursuant to **LDR Section 4.6.18(B)(4), Building and Structure Requirements**, to be harmonious, it is not to be inferred that buildings must look alike or be of the same style. Harmony can be achieved through the proper consideration of scale, proportion, site planning, landscaping, materials, and color.

Pursuant to **LDR Section 4.6.18(E), Criteria for Board Action**, the following criteria shall be considered, by the Site Plan Review and Appearance Board or Historic Preservation Board, in the review of plans for building permits. If the following criteria are not met, the application shall be disapproved.

- (1)The plan or the proposed structure is in conformity with good taste, good design, and in general, contributes to the image of the City as a place of beauty, spaciousness, harmony, taste, fitness, broad vistas, and high quality.
- (2)The proposed structure, or project, is in its exterior design and appearance of quality such as not to cause the nature of the local environment or evolving environment to materially depreciate in appearance and value.
- (3)The proposed structure, or project, is in harmony with the proposed developments in the general area, with the Comprehensive Plan, and with the supplemental criteria which may be set forth for the Board from time to time.

The proposed alterations to the elevations consist of color changes and the addition of shed-style awnings. The color changes introduce deeper hues than the generally muted and pastel development presently contains, with the exception of the red metal panel previously utilized by Sports Authority above the entrance (to be replaced by a gray metal panel). While the proposed color scheme and overall aesthetic of the addition will not necessarily have a negative impact on the architectural character of the center, the Board may want to consider requesting that the browns be further muted to better blend in with the lighter scheme of the shopping center to better create a "harmonious whole" as specified above in Section 4.6.18(B)(1).

REQUIRED FINDINGS

Pursuant to **LDR Section 3.1.1, Required Findings**, prior to the approval of development applications, certain findings must be made in a form which is a part of the official record. This may be achieved through information on the application, written materials submitted by the applicant, the staff report, or minutes. Findings shall be made by the body which has the authority to approve or deny the development application.

(A) Future Land Use Map: The subject property has a Future Land Use Map (FLUM) designation of GC (General Commercial) and is currently zoned GC (General Commercial); these two designations are consistent with each other.

(B) Concurrency: As indicated below, a positive finding of concurrency can be made as it relates to the applicable items reviewed below:

Water & Sewer: Water and sewer service is currently available to the subject property. The Delray Beach Water Treatment Plant and the South Central County Waste Water Treatment Plant both have adequate capacity to serve the City at build out.

Traffic: The applicant has submitted a site-specific transportation impact evaluation and driveway analysis. The proposed retail addition is “expected to generate a net increase of 724 net new external daily trip, with 3 new external AM peak hour trips and 62 net new external PM peak hour trips. The submitted traffic study does not anticipate any major impacts on the surrounding roadway network as a result of this increase. However, the applicant has not yet received an approval of traffic concurrency from the Palm Beach County Traffic Division, which has been submitted. The applicant is presently addressing comments, and therefore, it is anticipated that an approval will be obtained. This is added as a recommended condition of approval.

Drainage: Existing drainage provided throughout the overall site will be maintained. Within the area to be revised, an existing drainage inlet will remain within the drive aisle.

Solid Waste: The existing development generates approximately 651 tons of solid waste per year. The addition of 6,636 square feet adds 48 tons of solid waste generated by the shopping center each year, which is not a significant increase. The Solid Waste Authority has indicated that its facilities have sufficient capacity to handle all development proposals until the year 2048.

(C) Consistency: As described in Appendix B, a positive finding of consistency can be made as it relates to Development Standards for Site Plan Actions, upon Board approval of the requested conditions of approval.

(D) Compliance With the Land Development Regulations: As described under the Site Plan Analysis of this report, a positive finding of compliance with the LDRs can be made.

A review of the applicable objectives and policies of the adopted **Comprehensive Plan** was conducted and the following are noted:

Future Land Use Element, Objective A-1: Property shall be developed or redeveloped in a manner so that the future use and intensity is appropriate in terms of soil, topographic and other applicable physical considerations; is complimentary to adjacent land uses; and fulfills remaining land use needs.

The proposed addition is complimentary to the existing shopping center, which was previously found to be compatible and complimentary to the surrounding properties and their associated uses. The addition is minor and will not have a huge impact, although the reuse of the space will provide a positive impact to the shopping center.

Based on the above, positive findings with respect to **LDR Section 3.1.1, Required Findings**, can be made.

ALTERNATIVE ACTIONS

- A. Continue with direction.
- B. Approve the Class IV Site Plan Modification, Landscape Plan, and Architectural Elevations for **Orchard Supply Hardware** located within **New Century Commons** at **500 - 510 West Linton Boulevard** by adopting the findings of fact and law contained in the staff report, and finding that the request and approval thereof is consistent with the Comprehensive Plan and meets criteria set forth in Section 2.4.5(F)(5) and Chapter 3 of the Land Development Regulations.
- C. Deny the Class IV Site Plan Modification, Landscape Plan, and Architectural Elevations for **Orchard Supply Hardware** located within **New Century Commons** at **500 - 510 West Linton Boulevard** by adopting the findings of fact and law contained in the staff report, and finding that the request is inconsistent with the Comprehensive Plan and does not meet criteria set forth in Section 2.4.5(F)(5) and Chapter 3 of the Land Development Regulations.

STAFF RECOMMENDATION

By Separate Motions:

Site Plan

Approve the Class IV Site Plan Modification for **Orchard Supply Hardware** located within **New Century Commons** at **500 - 510 West Linton Boulevard** by adopting the findings of fact and law contained in the staff report, and finding that the request and approval thereof is consistent with the Comprehensive Plan and meets criteria set forth in Section 2.4.5(F)(5) and Chapter 3 of the Land Development Regulations, subject to the condition that a letter of approval for traffic concurrency is received by the Palm Beach County Traffic Division prior to site plan certification.

Landscape Plan

Approve the Landscape Plan for **Orchard Supply Hardware** located within **New Century Commons** at **500 -510 West Linton Boulevard** by adopting the findings of fact and law contained in the staff report, and finding that the request and approval thereof is consistent with LDR Section 4.6.18.

Architectural Elevations

Approve the Architectural Elevations for **Orchard Supply Hardware** located within **New Century Commons** at **500 -510 West Linton Boulevard** by adopting the findings of fact and law contained in the staff report, and finding that the request and approval thereof is consistent with LDR Section 4.6.18(E).

<p style="text-align: center;">APPENDIX A STANDARDS FOR SITE PLAN ACTIONS</p>

- A. Building design, landscaping and lighting (glare) shall be such that they do not create unwarranted distractions or blockage of visibility as it pertains to traffic circulation.**
Not applicable _____
Meets intent _____ X
Does not meet intent _____
- B. Separation of different forms of transportation shall be encouraged. This includes pedestrians, bicyclists and vehicles in a manner consistent with policies found under Objectives D-1 and D-2 of the Transportation Element.**
Not applicable _____ X
Meets intent _____
Does not meet intent _____
- C. Open space enhancements as described in Policies found under Objective B-1 of the Open Space and Recreation Element are appropriately addressed.**
Not applicable _____ X
Meets intent _____
Does not meet intent _____
- D. The City shall evaluate the effect that any street widening or traffic circulation modification may have upon an existing neighborhood. If it is determined that the widening or modification will be detrimental and result in a degradation of the neighborhood, the project shall not be permitted.**
Not applicable _____ X
Meets intent _____
Does not meet intent _____
- E. Development of vacant land which is zoned for residential purposes shall be planned in a manner which is consistent with adjacent development regardless of zoning designations.**
Not applicable _____ X
Meets intent _____
Does not meet intent _____
- F. Property shall be developed or redeveloped in a manner so that the future use and intensity are appropriate in terms of soil, topographic, and other applicable physical considerations; complementary to adjacent land uses; and fulfills remaining land use needs.**
Not applicable _____
Meets intent _____ X
Does not meet intent _____

- G. Redevelopment and the development of new land shall result in the provision of a variety of housing types which shall continue to accommodate the diverse makeup of the City's demographic profile, and meet the housing needs identified in the Housing Element. This shall be accomplished through the implementation of policies under Objective B-2 of the Housing Element.**

Not applicable X

Meets intent

Does not meet intent

- H. The City shall consider the effect that the proposal will have on the stability of nearby neighborhoods. Factors such as noise, odors, dust, traffic volumes and circulation patterns shall be reviewed in terms of their potential to negatively impact the safety, habitability and stability of residential areas. If it is determined that a proposed development will result in a degradation of any neighborhood, the project shall be modified accordingly or denied.

Not applicable

Meets intent	<u> </u>	X
--------------	-----------------------------	----------

Does not meet intent

- I. Development shall not be approved if traffic associated with such development would create a new high accident location, or exacerbate an existing situation causing it to become a high accident location, without such development taking actions to remedy the accident situation.

Not applicable _____

Meets intent	<u> </u>	X
--------------	-----------------------------	----------


Does not meet intent

- J. Tot lots and recreational areas, serving children from toddler to teens, shall be a feature of all new housing developments as part of the design to accommodate households having a range of ages. This requirement may be waived or modified for residential developments located in the downtown area, and for infill projects having fewer than 25 units.**

Not applicable **X**

Meets intent

Does not meet intent

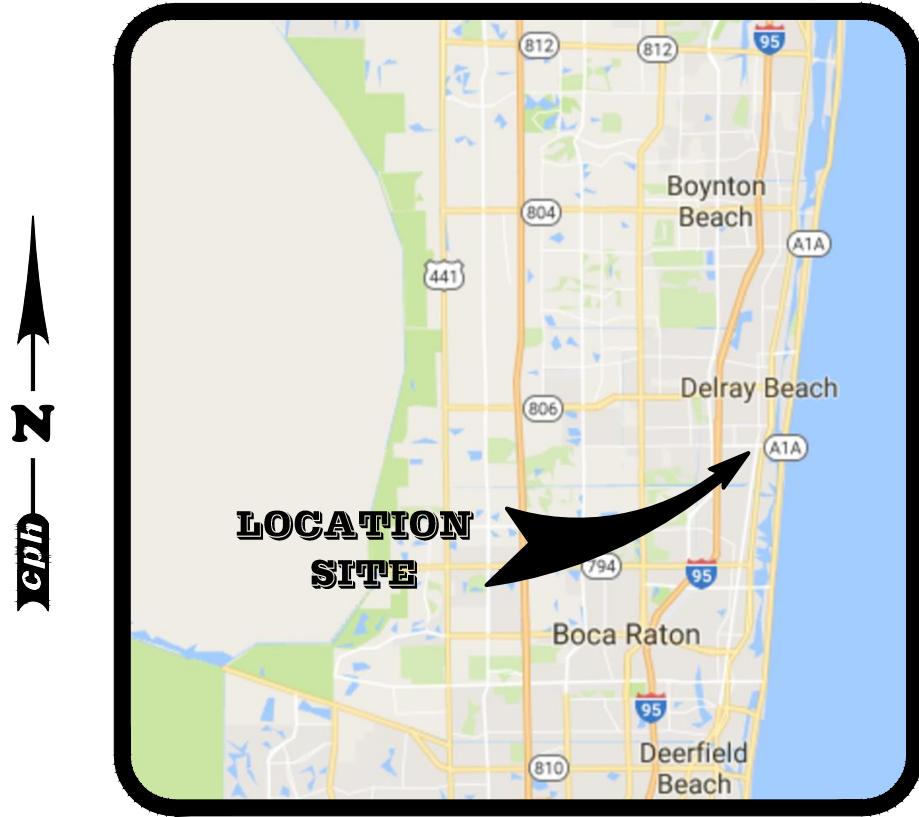

DELRAY BEACH, FLORIDA
PALM BEACH COUNTY
SECTION 12, TOWNSHIP 43 SOUTH, RANGE 46 EAST
LOCATION MAP
SCALE: NTS

CONSTRUCTION PLANS FOR



ORCHARD SUPPLY HARDWARE 510 W LINTON BLVD DELRAY BEACH, FLORIDA PARCEL ID: 12-43-46-29-32-001-0000



DELRAY BEACH, FLORIDA
PALM BEACH COUNTY
SECTION 12, TOWNSHIP 43 SOUTH, RANGE 46 EAST
LOCATION MAP
SCALE: 1" = 1,500'

CONSULTANTS	UTILITY PROVIDERS	APPROVAL AGENCIES	INDEX OF SHEETS
<p>DEVELOPER OPPIDAN INVESTMENT COMPANY 400 WATER STREET, SUITE 200 EXCELSIOR, MN. 55331 (952) 294-1247 ATTN: BILL PEW</p> <p>ARCHITECT DLR GROUP 421 SW 6th AVENUE, SUITE 1212 PORTLAND, OR. 97204 (503) 200-3967 ATTN: AMY VOHS</p> <p>OWNER LINTON 510 LLC 660 LINCOLN RD MIAMI, FLORIDA 33139-2916 ATTN: YANIV SANANES</p> <p>ENGINEER CPH, INC. 1992 SW 1ST STREET MIAMI, FL 33135 (305) 274-4805 ATTN.: TODD HENDRIX, P.E.</p> <p>SURVEYOR CAULFIELD & WHEELER, INC. 7900 GLADES RD., SUITE 100 BOCA RATON, FLORIDA 33434 (561) 392-1991 ATTN: JEFFREY WAGNER</p> <p>LANDSCAPE ARCHITECT CPH, INC. 500 WEST FULTON STREET SANFORD, FLORIDA 32771 (407) 322-6841 ATTN: MAXWELL SPANN, R.L.A.</p>	<p>UTILITIES SEWER & WATER: CITY OF DELRAY BEACH 100 NW 1st AVENUE DELRAY BEACH, FLORIDA 33444 (561) 243-7040</p> <p>ELECTRIC: FLORIDA POWER & LIGHT BOCA RATON OPERATIONS (561) 479-4544 ATTN: SETH DAGEN</p> <p>COMMUNICATION: AT & T DISTRIBUTION 321 S.E. 2nd STREET DELRAY BEACH, FL. 33483 (561) 988-6516 ATTN:</p>	<p>FLORIDA DEPARTMENT OF ENVIRONMENTAL PROTECTION DOMESTIC WASTEWATER COLLECTION DIVISION SOUTHEAST DISTRICT 400 NORTH CONGRESS AVENUE, SUITE 200 WEST PALM BEACH, FL 33401-2913 (561) 681-6600</p> <p>FLORIDA DEPARTMENT OF ENVIRONMENTAL PROTECTION DRINKING WATER DIVISION CENTRAL DISTRICT SOUTHEAST DISTRICT 400 NORTH CONGRESS AVENUE, SUITE 200 WEST PALM BEACH, FL 33401-2913 (561) 681-6600</p> <p>CITY OF DELRAY BEACH PLANNING AND ZONING 100 NW 1st AVENUE DELRAY BEACH, FLORIDA 33444 (561) 243-7040 ATTN.:</p> <p>SOUTH FLORIDA RIVER WATER MANAGEMENT DISTRICT 3301 GUN CLUB ROAD WEST PALM BEACH, FLORIDA 33416 (516) 682-6012 ATTN.:</p>	<p>C-1 COVER SHEET C-2 GENERAL NOTES 1 OF 2 SURVEY COVER 2 OF 2 SURVEY C-3 EROSION CONTROL PLAN C-3A EROSION CONTROL NOTES C-4 EROSION CONTROL DETAILS C-5 SITE DEMOLITION PLAN C-6 OVERALL SITE PLAN C-7 SITE DIMENSION PLAN C-8 GRADING & DRAINAGE PLAN C-9 COMPOSITE UTILITY PLAN C-10 SITE DETAILS & CROSS SECTIONS C-10A SITE DETAILS C-11 OVERALL SITE TRUCK ROUTE PLAN C-12 CITY OF DELRAY BEACH UTILITY DETAILS E1.1 EXISTING SITE LIGHTING PHOTOMETRICS L-1 PRELIMINARY LANDSCAPE PLAN L-2 LANDSCAPE NOTES AND DETAILS TR-1 TREE RETENTION PLAN 0.4 EGRESS, OCCUPANCY, AND SCHEDULE A-1 OVERALL FLOOR PLAN A-2 FLOOR PLAN A-3 EXTERIOR ELEVATIONS A4.1 ROOF PLAN</p>
NOTES			
<p>1. ALL CONSTRUCTION COVERED BY THESE PLANS SHALL COMPLY WITH THE MATERIAL REQUIREMENTS AND QUALITY CONTROL STANDARDS CONTAINED BY FDOT AND MIAMI-DADE COUNTY.</p> <p>2. A PERMIT MUST BE OBTAINED FROM FDOT PERMITTING DIVISION PRIOR TO COMMENCEMENT OF ANY WORK IN THE STATES RIGHT-OF-WAY.</p>			



DELRAY BEACH


COVER SHEET
ORCHARD SUPPLY HARDWARE - DELRAY BEACH
CITY SITE PLAN REVIEW

COVER SHEET

C-1
36-16121-00
Issue Date
REVISIONS

DLR Group
Architecture Engineering Planning Interiors
© 2016, DLR Group Inc., a Florida corporation. ALL RIGHTS RESERVED

510 LINTON BLVD
DELRAY BEACH, FL 33483

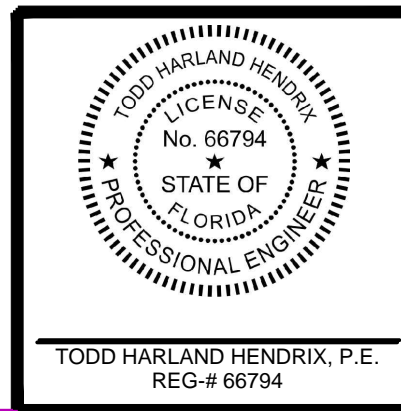


JOB No.: D11914

cph
www.cphcorp.com
A Full Service A & E Firm


Architects
Engineers
Environmental
Landscape Architects
M / E / P
Planners
Structural
Surveyors
Traffic / Transportation

Offices in:
• Florida
• Puerto Rico
• Connecticut
• Maryland
• Texas


C:\Revit\36-16121-00-OSH-AR-CENTRAL_11ferret.nvt
2/2/2017 3:54:04 PM

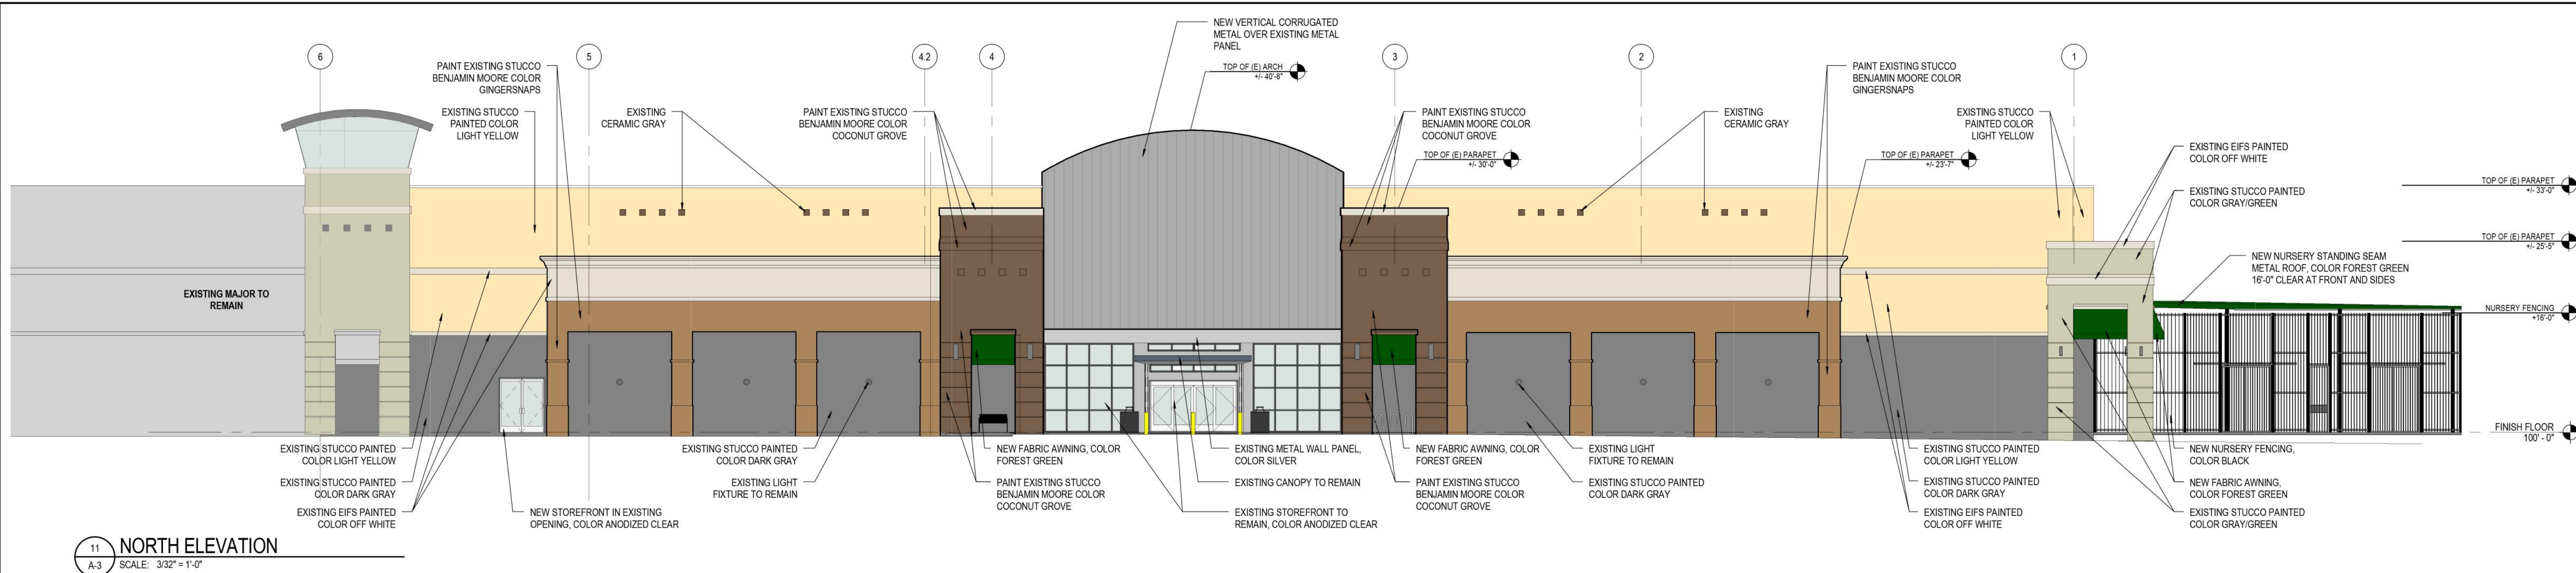


11 NORTH ELEVATION
SCALE: 3/32" = 1'-0"

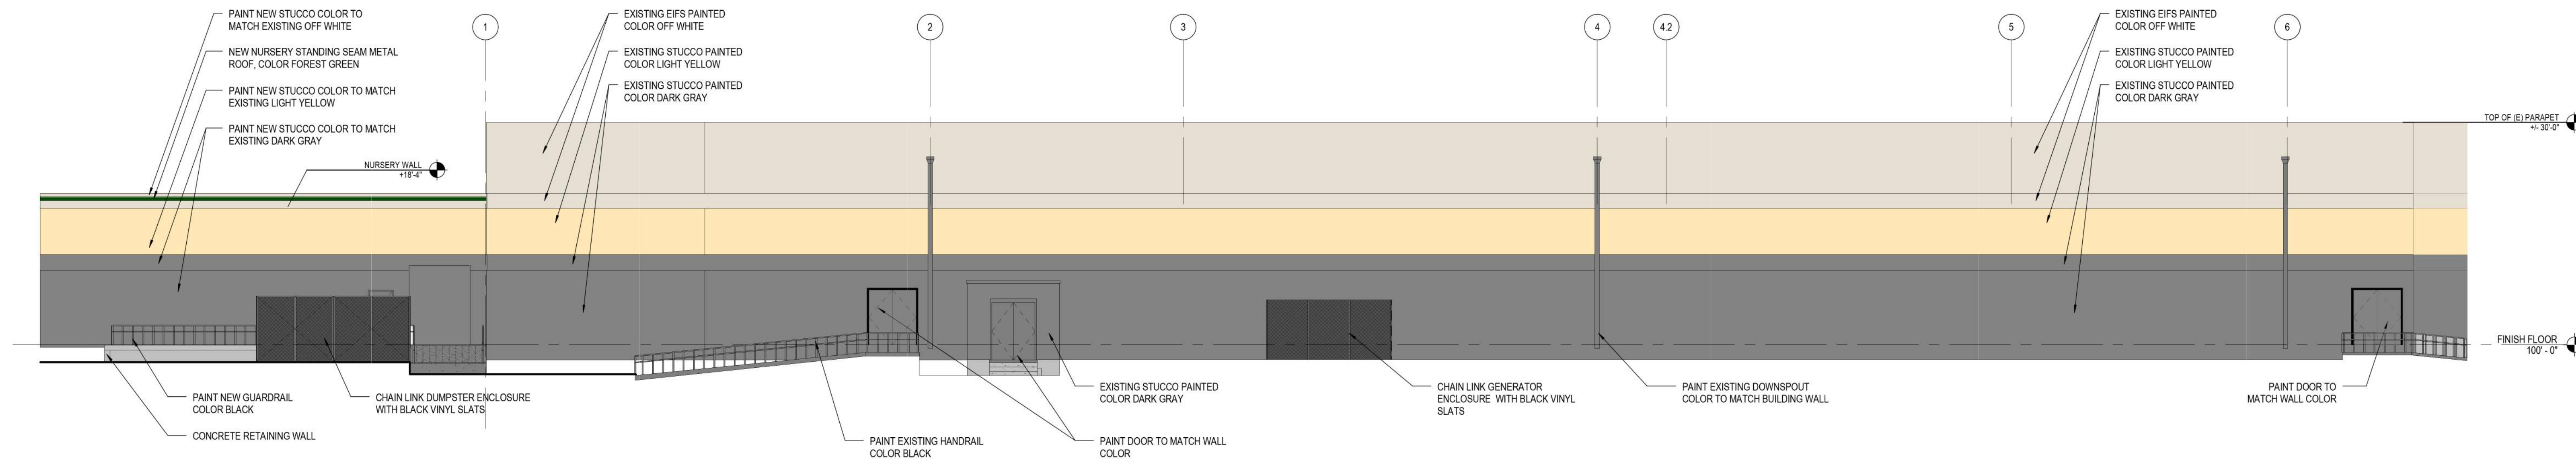


21 SOUTH ELEVATION
SCALE: 3/32" = 1'-0"

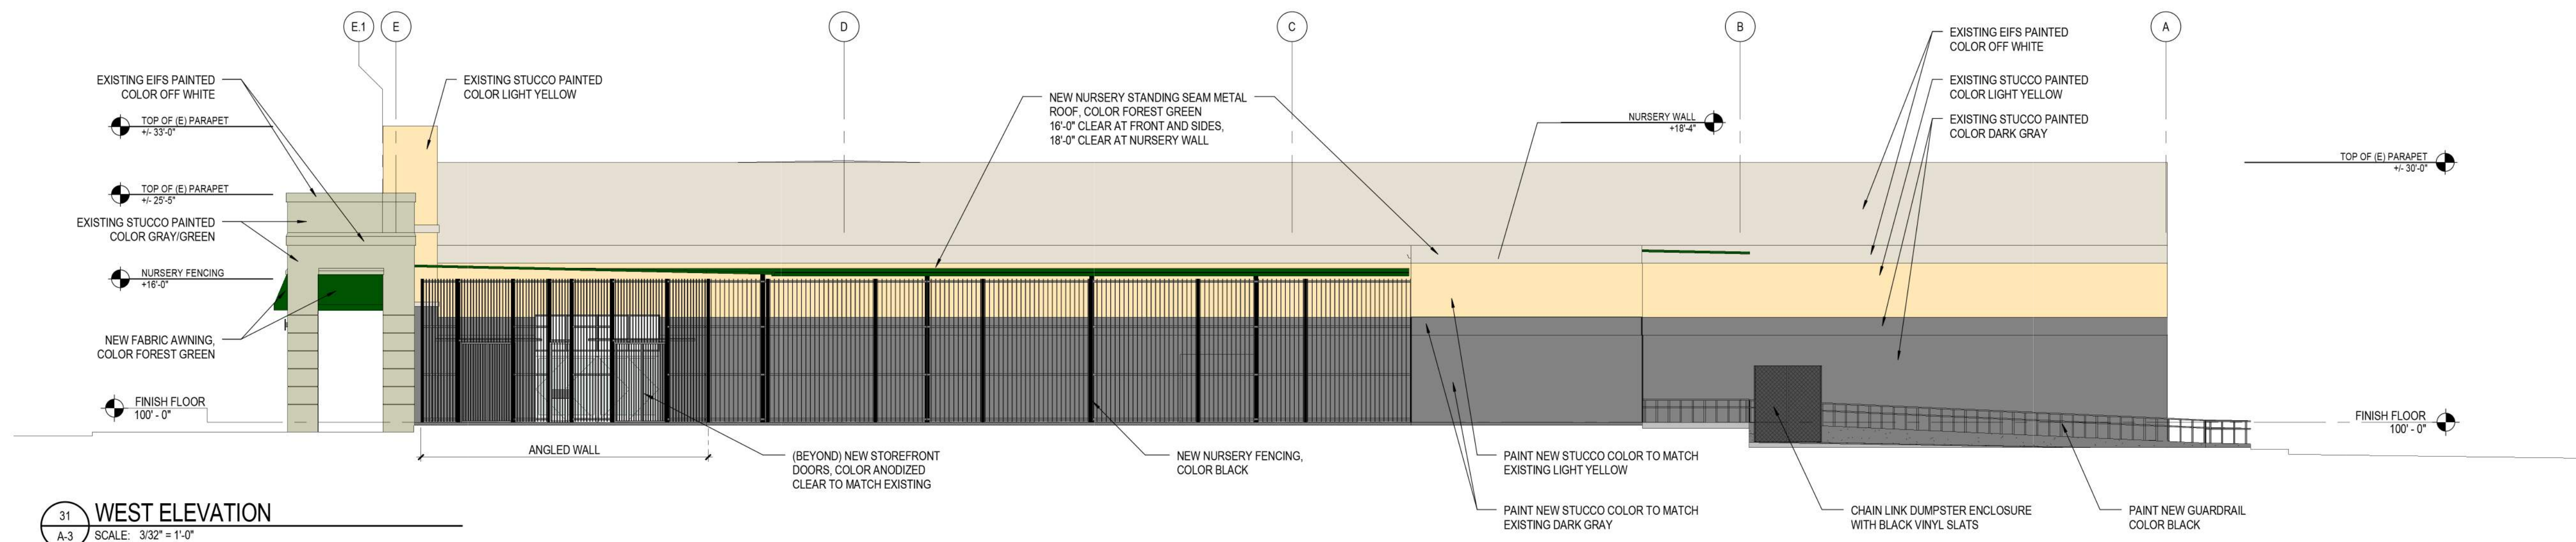

31 WEST ELEVATION
SCALE: 3/32" = 1'-0"

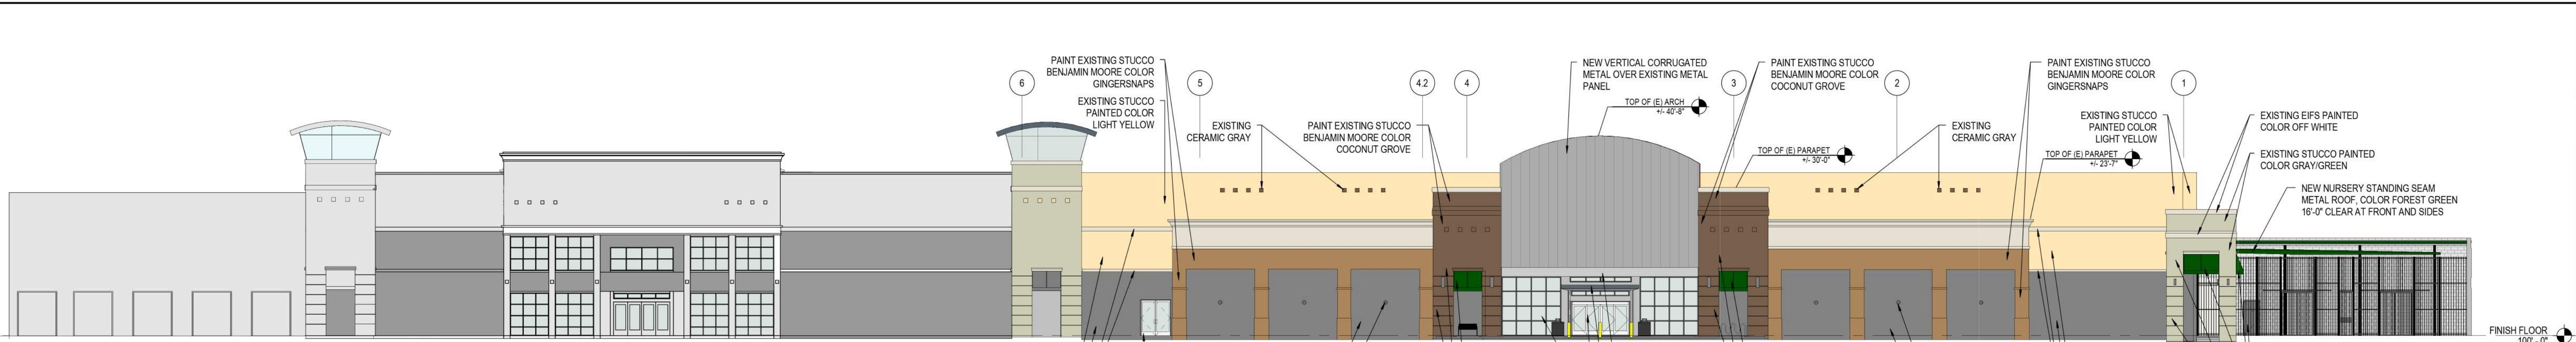

11 NORTH ELEVATION
A-4 SCALE: 1/16" = 1'-0"

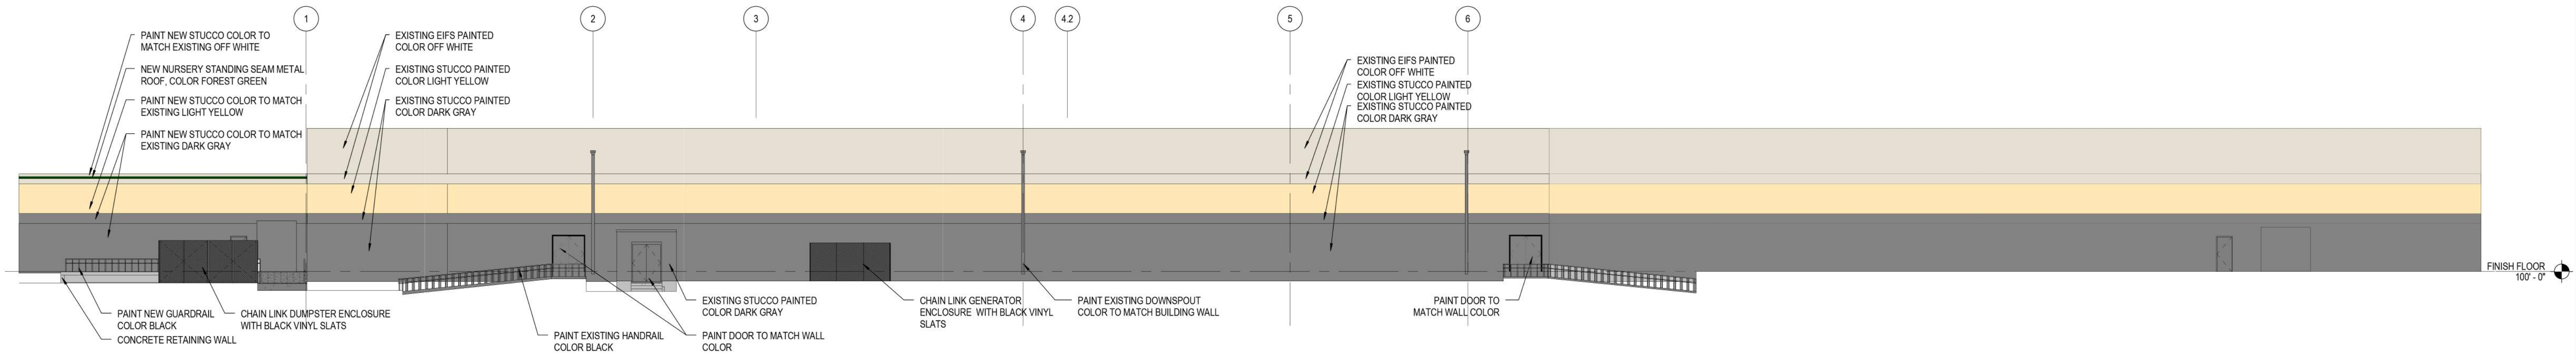

21 SOUTH ELEVATION
A-4 SCALE: 1/16" = 1'-0"



Black
Wrought Iron
Fencing




Galvanized
Corrugated Metal



Coconut Grove
#1029
Benjamin Moore



Light Yellow
DCR014 -
Lowcountry
Spoonbread

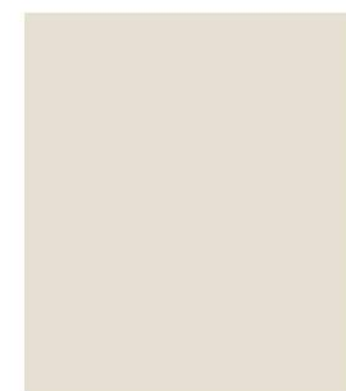

Off White
MAB 041-150



Galvanized
Pipe Railing



Standing Seam
Metal Roof



Gingersnaps
#1063
Benjamin Moore



Gray/Green
Duron DCR084 -
Acanthus




Dark Gray
Benjamin Moore
2112-40 Stone

Always call 811 two full business days before you dig

Sunshine811.com

www.sunshine811.com

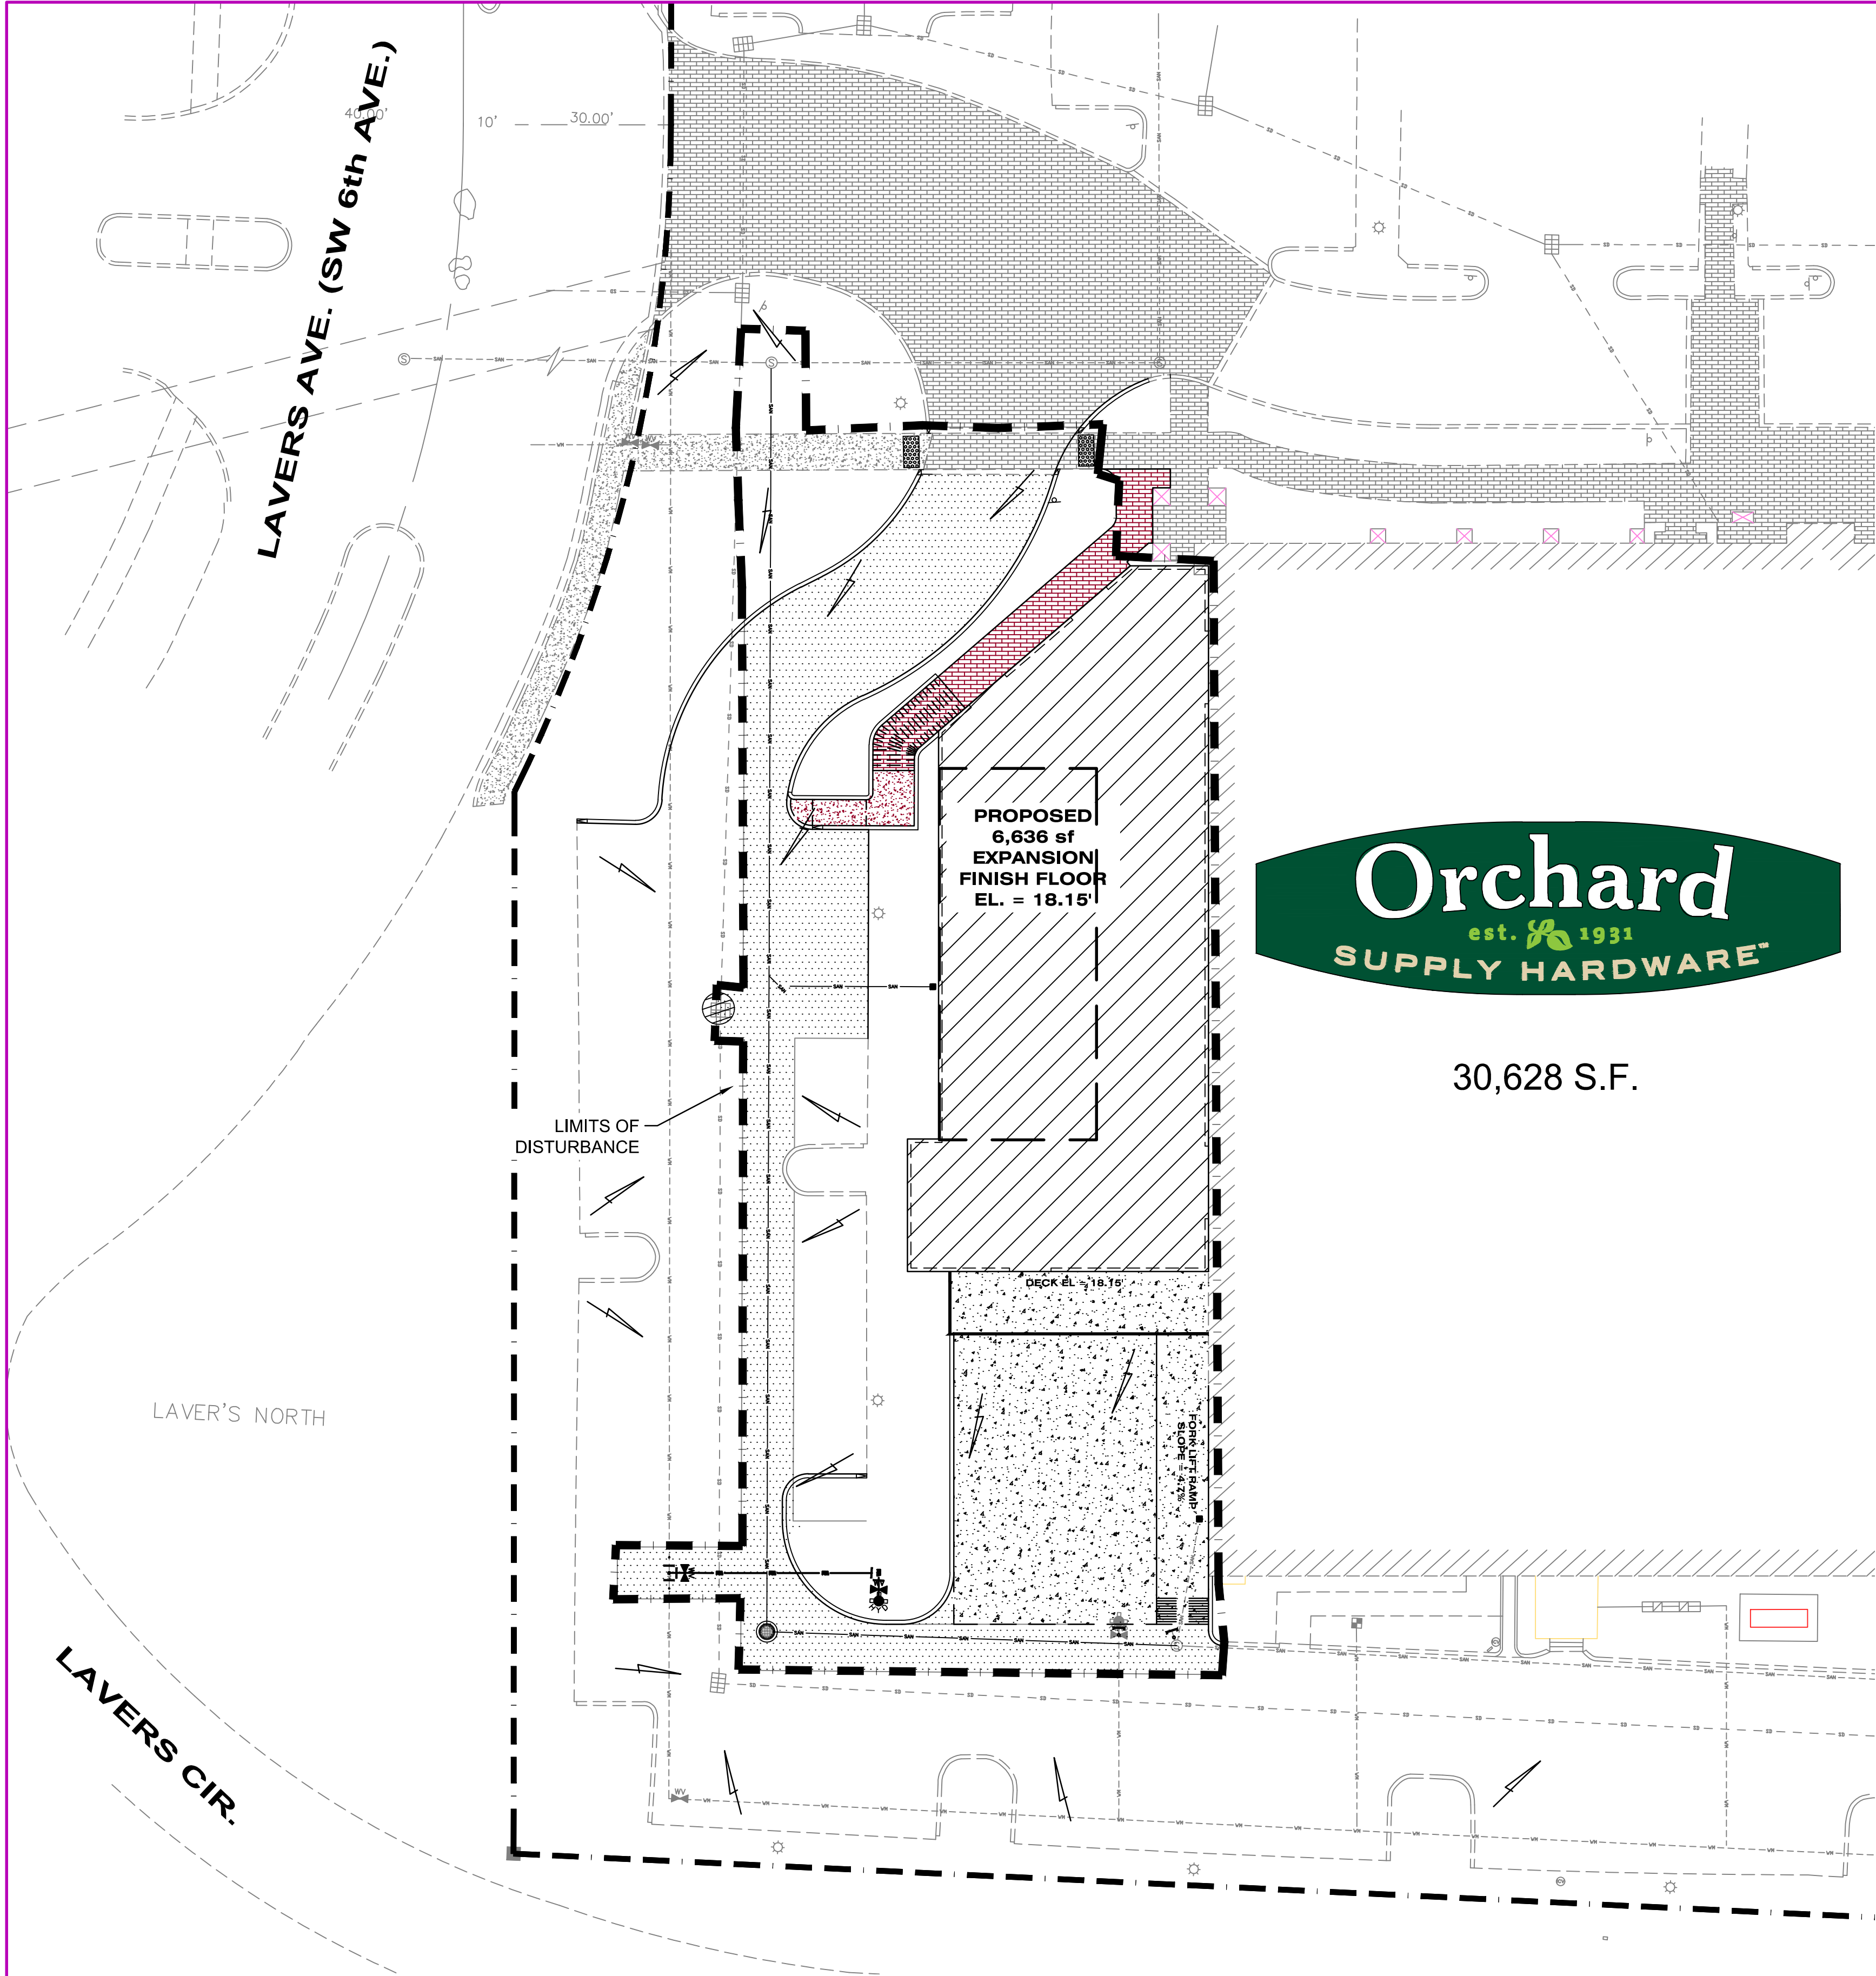

30,628 S.F.

CONTRACTOR / SUBCONTRACTOR CERTIFICATION TABLE

THIS SWPPP MUST CLEARLY IDENTIFY, FOR EACH MEASURE IDENTIFIED WITHIN THE SWPPP, THE CONTRACTOR(S) OR SUBCONTRACTOR(S) WHO WILL IMPLEMENT EACH MEASURE. ALL CONTRACTOR(S) AND SUBCONTRACTOR(S) IDENTIFIED IN THE SWPPP MUST SIGN THE FOLLOWING CERTIFICATION:

I CERTIFY UNDER PENALTY OF LAW THAT I UNDERSTAND, AND SHALL COMPLY WITH, THE TERMS AND CONDITIONS OF THE STATE OF FLORIDA GENERIC PERMIT FOR STORMWATER DISCHARGE FROM LARGE AND SMALL CONSTRUCTION ACTIVITIES AND THIS STORMWATER POLLUTION PREVENTION PLAN."

Name / Signature	Title	Company Name, Address and Phone Number	Date

NOTE: CONTRACTOR TO ADD SHEETS TO CERTIFICATION TABLE AS NECESSARY.

SWPPP IMPLEMENTATION LOG

A RECORD OF DATES WHEN BMPs ARE INSTALLED OR REMOVED, STABILIZATION MEASURES ARE INITIATED, MAJOR GRADING ACTIVITIES OCCUR, AND CONSTRUCTION ACTIVITIES TEMPORARILY OR PERMANENTLY CEASE ON PORTIONS OF THE SITE. THIS FORM MUST BE UPDATED CONTINUOUSLY THROUGHOUT THE PROJECT UNTIL THE NOTICE OF TERMINATION (NOT) IS FILED.

DESCRIPTION OF ACTIVITY	LOCATION	CONTRACTOR	BEGIN DATE	END DATE

NOTE: CONTRACTOR TO ADD SHEETS TO THE SWPPP IMPLEMENTATION LOG AS NECESSARY.


"I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations."

Name (Operator and/or Responsible Authority) _____ Date _____

Project Name and location information:

CONSTRUCTION SEQUENCING TABLE												
ANTICIPATED CONSTRUCTION SEQUENCE*	SEP	OCT	NOV	DEC	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG
CONSTRUCTION ENTRANCE												
TEMPORARY CONTROL MEASURES												
STORM FACILITIES												
ROUGH GRADE / SEDIMENT CONTROL												
FOUNDATION / BUILDING CONSTRUCTION												
SITE CONSTRUCTION												
FINISH GRADING												
PERMANENT CONTROL MEASURES												
* THIS IS ONLY A GUIDE. CONTRACTOR IS TO USE HIS JUDGMENT TO MODIFY AS NEEDED.												

Stormwater Team		
Description	Name	Company
Contractor:		
Contractor's Responsible Authority:		
Qualified Inspector(s):		
Maintenance Personnel:		
The contractor shall complete this table identifying the individuals of the stormwater team and their responsibilities.		

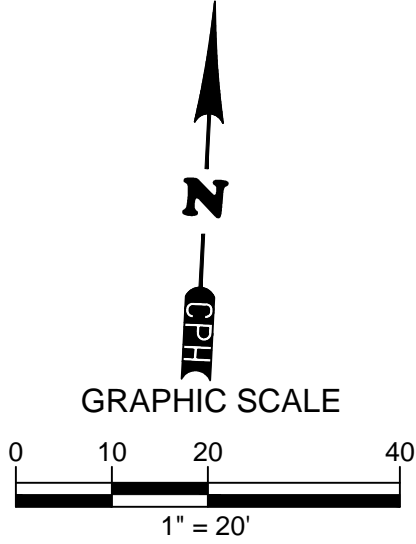

LEGEND

- DIRECTION OF FLOW
- LIMITS OF DISTURBANCE
- PROPOSED INLET PROTECTION

SEQUENCE OF CONSTRUCTION

THE CONTRACTOR SHALL FOLLOW THE SEQUENCE OF CONSTRUCTION AS DESCRIBED BELOW. IF THE CONTRACTOR FINDS THAT THE SEQUENCE NEEDS TO BE MODIFIED, THE CONTRACTOR SHALL CONTACT THE CEC FOR FURTHER DIRECTION. THE INSTALLATION OR REMOVAL OF BMPs, EARTH DISTURBANCE, GRADING, TEMPORARY STABILIZATION AND PERMANENT STABILIZATION SHALL BE IMMEDIATELY NOTED IN THE SWPPP IMPLEMENTATION LOG AND ON THE SITE MAP. THE CONTRACTOR SHALL DISTURB ONLY THOSE AREAS NECESSARY TO INSTALL THE BMPs UNTIL DIRECTED IN THE SEQUENCE TO BEGIN CLEARING AND GRUBBING OPERATIONS. ALL TEMPORARY BMPs SHALL BE REPAIRED AND MAINTAINED UNTIL STABILIZATION HAS OCCURRED AND THERE IS NO RISK OF DISCHARGE, THEN THEY SHALL BE REMOVED.

- POST A COPY OF THE NOI OR LETTER FROM FDEP CONFIRMING COVERAGE UNDER THE GENERIC PERMIT, AND THE NAME AND PHONE NUMBER OF THE CONTRACTOR'S REPRESENTATIVE RESPONSIBLE FOR EROSION AND SEDIMENTATION CONTROL INSTALLATION AND MAINTENANCE ON A 24 HOUR BASIS.
- INSTALL PERIMETER CONTROLS IMMEDIATELY DOWNSTREAM OF THE PLANNED LOCATION OF THE CONSTRUCTION EXIT.
- INSTALL STABILIZED CONSTRUCTION EXIT.
- INSTALL REMAINING PERIMETER CONTROLS.
- INSTALL TEMPORARY PARKING AND STORAGE AREAS (TRAILER, PARKING, LAY DOWN, SANITARY FACILITIES, WHEEL WASH, CONCRETE WASHOUT, MASONS AREA, FUEL AND MATERIAL STORAGE CONTAINERS, SOLID WASTE CONTAINERS, ETC).
- CONSTRUCT AND STABILIZE THE SEDIMENT BASINS AND SEDIMENT TRAPS WITH APPROPRIATE OUTFALL STRUCTURES
- CONSTRUCT AND STABILIZE HYDRAULIC CONTROLS (DITCHES, SWALES, DIKES, CHECK DAMS, ETC.).
- BEGIN DEMOLITION, CLEARING AND GRUBBING OPERATIONS AS APPLICABLE.
- BEGIN CONSTRUCTION OF BUILDING PAD AND STRUCTURES.
- TEMPORARILY SEED, IMMEDIATELY AND THROUGHOUT CONSTRUCTION, DENUDED AREAS THAT WILL BE INACTIVE FOR 7 DAYS OR MORE.
- INSTALL UTILITIES, UNDERDRAINS, STORM SEWERS, CURBS AND GUTTERS.
- INSTALL RIP RAP AROUND OUTLET STRUCTURES AS EACH OUTLET STRUCTURE IS INSTALLED.
- INSTALL INLET PROTECTION AROUND ALL STORM SEWER STRUCTURES AS EACH INLET STRUCTURE IS INSTALLED.
- PERMANENTLY STABILIZE AREAS TO BE VEGETATED AS THEY ARE BROUGHT TO FINAL GRADE.
- PREPARE SITE FOR PAVING.
- PAVE SITE.
- INSTALL APPROPRIATE INLET PROTECTION DEVICES FOR PAVED AREAS AS WORK PROGRESSES.
- COMPLETE GRADING AND INSTALL PERMANENT STABILIZATION OVER ALL AREAS.
- REMOVE ALL TEMPORARY EROSION AND SEDIMENT CONTROL DEVICES (ONLY IF SITE IS STABILIZED).
- SUBMIT NOTICE OF TERMINATION (NOT) ONCE ALL CONSTRUCTION IS COMPLETE AND ALL AREAS ARE STABILIZED PER PLAN.

ACREAGE SUMMARY

TOTAL SITE AREA	8.89 AC.
ON-SITE DISTURBED AREA	0.50 AC.
OFF-SITE DISTURBED AREA	0.00 AC.
TOTAL DISTURBED AREA	0.50 AC.


JOB No.: D11914



www.cphcorp.com
**A Full Service
A & E Firm**

Architects
Engineers
Environmental
Landscape Architects
M / E / P
Planners
Structural
Surveyors
Traffic / Transportation

- Offices in:
- Florida
 - Puerto Rico
 - Connecticut
 - Maryland
 - Texas

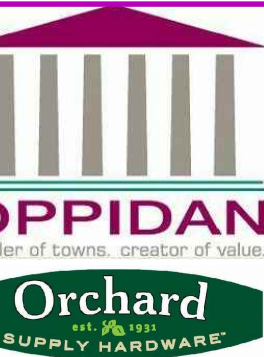

DELRAY BEACH

EROSION CONTROL PLAN
ORCHARD SUPPLY HARDWARE - DELRAY BEACH
CITY SITE PLAN REVIEW

C-3
36-16121-00
Issue Date
REVISIONS

DLR Group
Architecture Engineering Planning Interiors



510 LINTON BLVD
DELRAY BEACH FL 33483

36-16121-00
Issue Date
REVISIONS

Architecture Engineering Planning Interiors

©2016, DLR Group inc., a Florida corporation, ALL RIGHTS RESERVED


SEE LANDSCAPE PLAN FOR PROTECTION AND REMOVAL OF EXISTING VEGETATION



 CONTRACTOR TO PROTECT AND SAVE

Offices in:

- Florida
- Puerto Rico
- Connecticut
- Maryland
- Texas

1/18/2016 6:50:07 AM

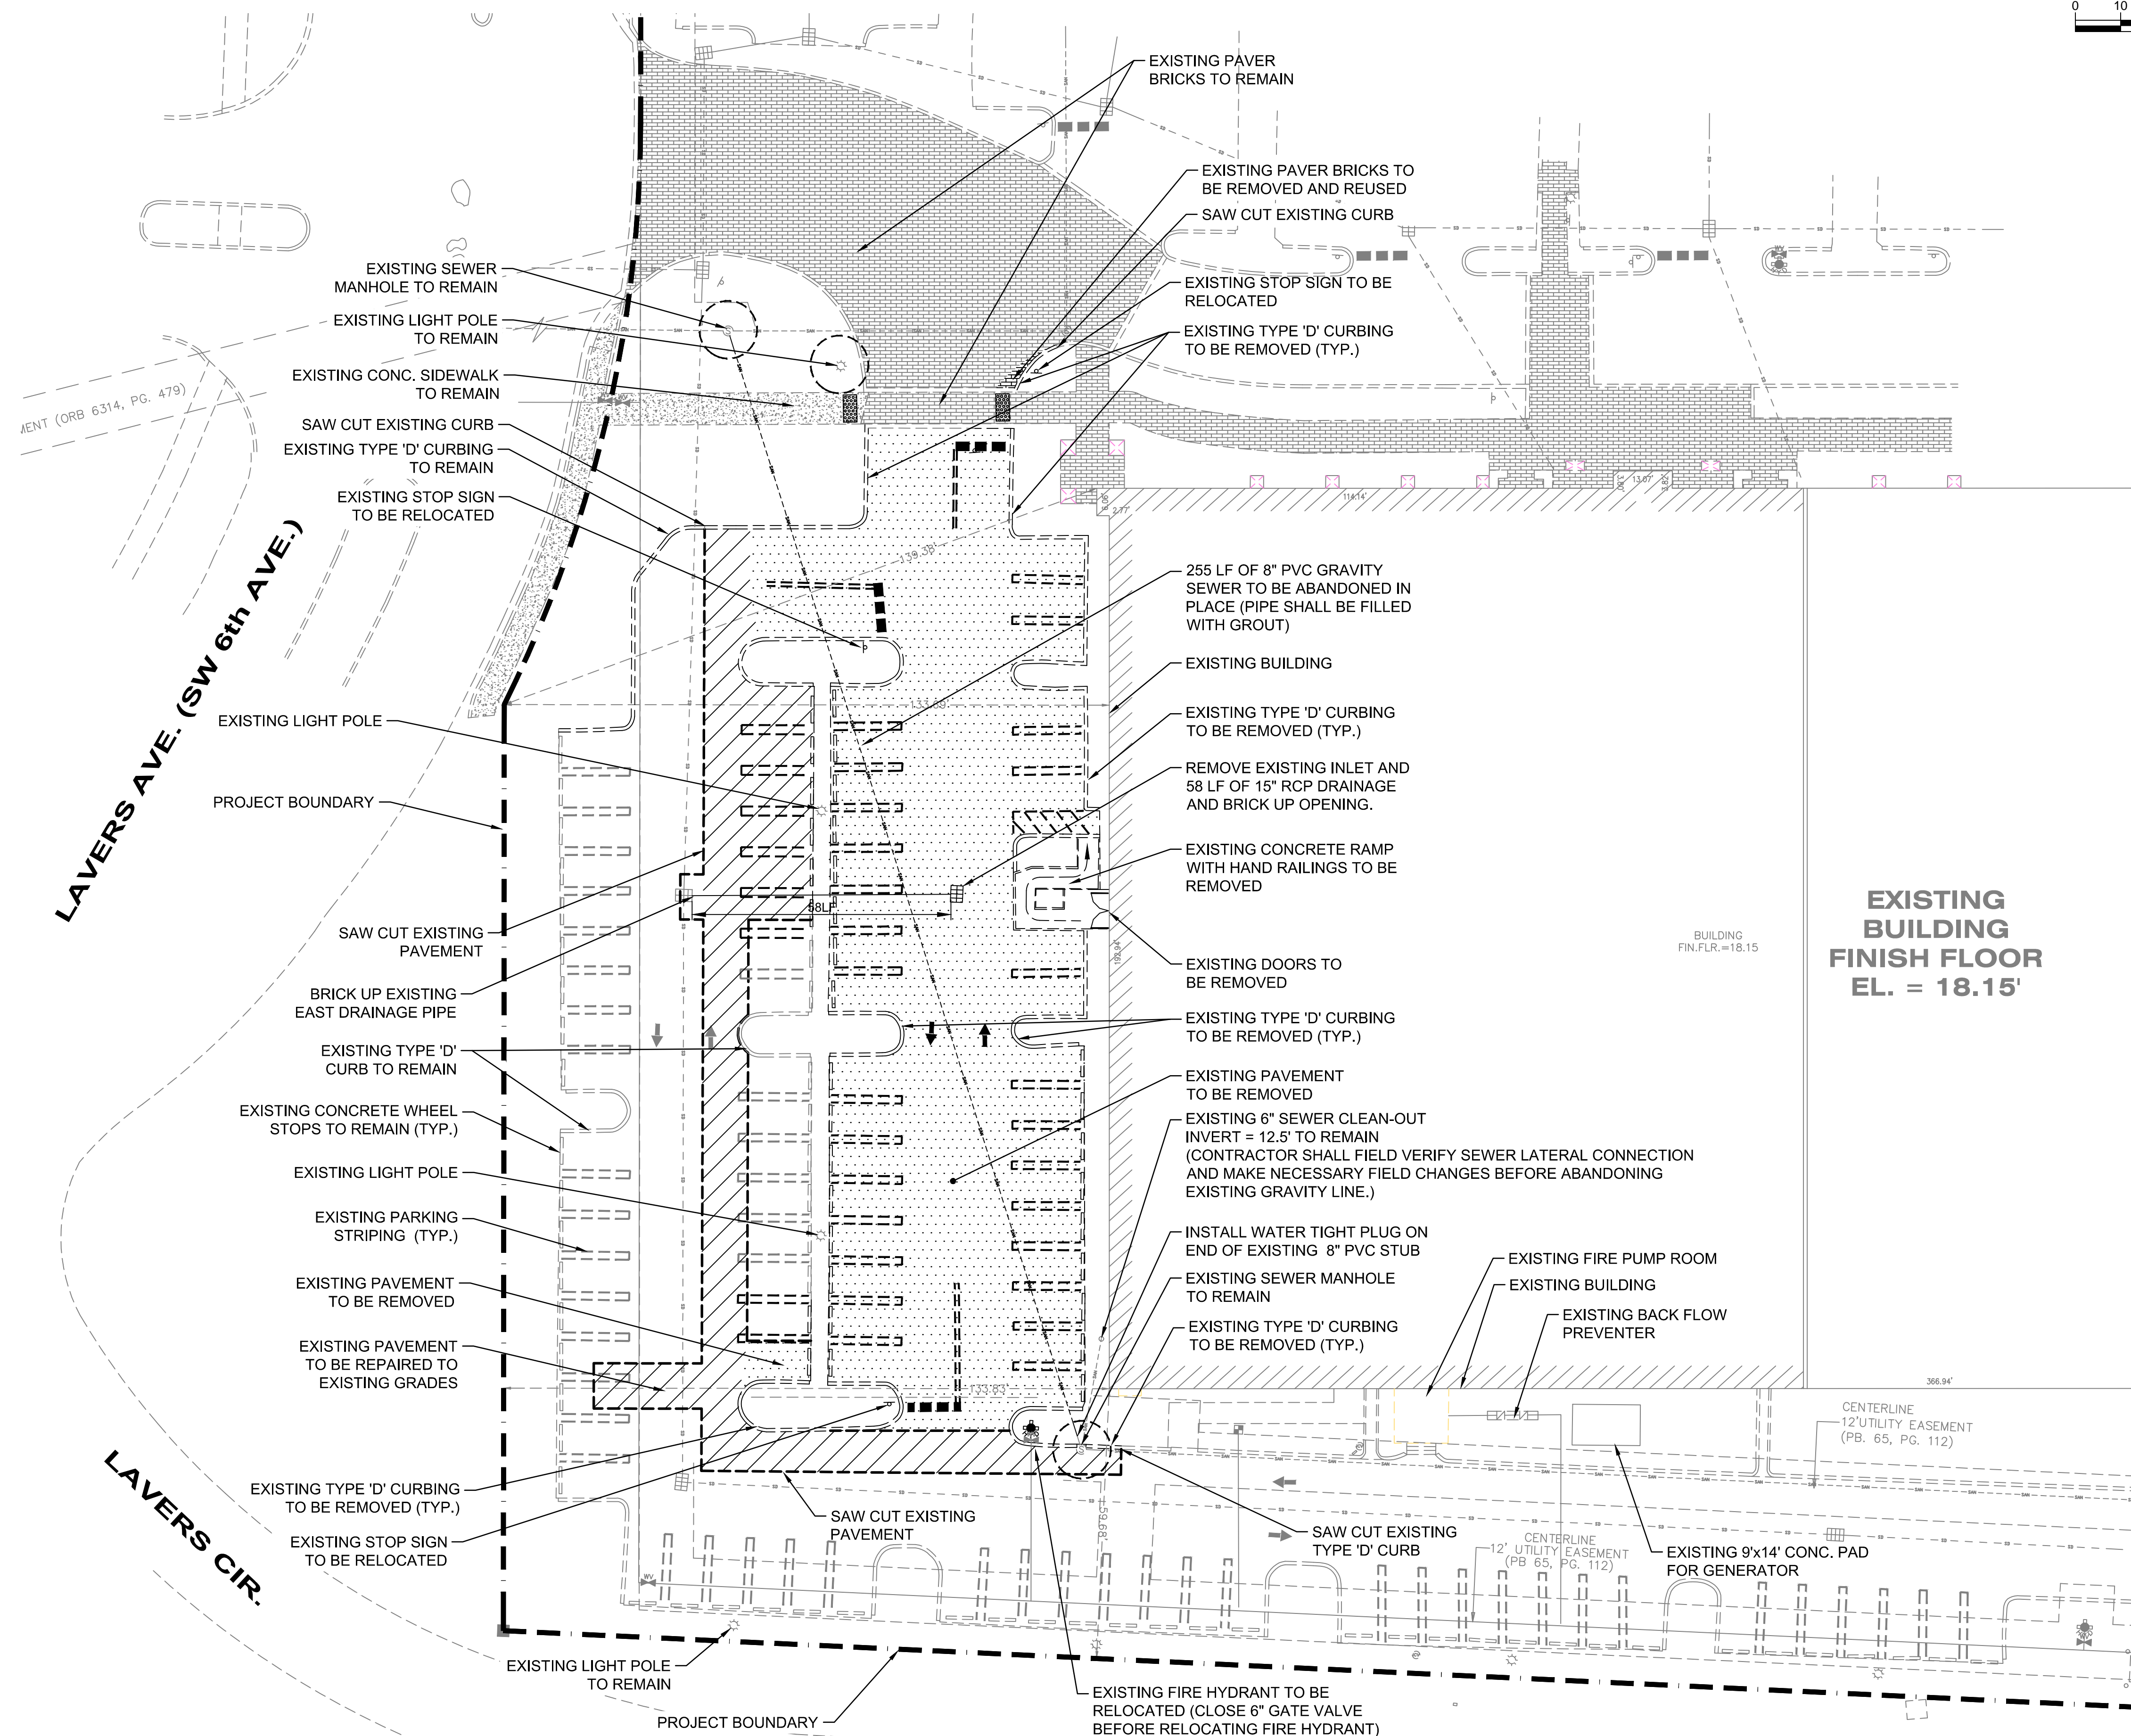

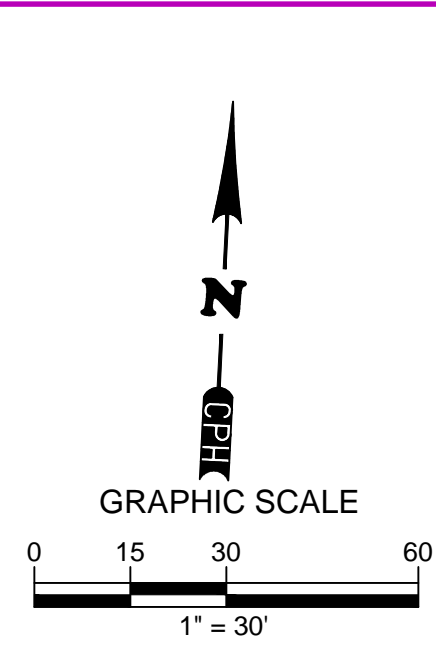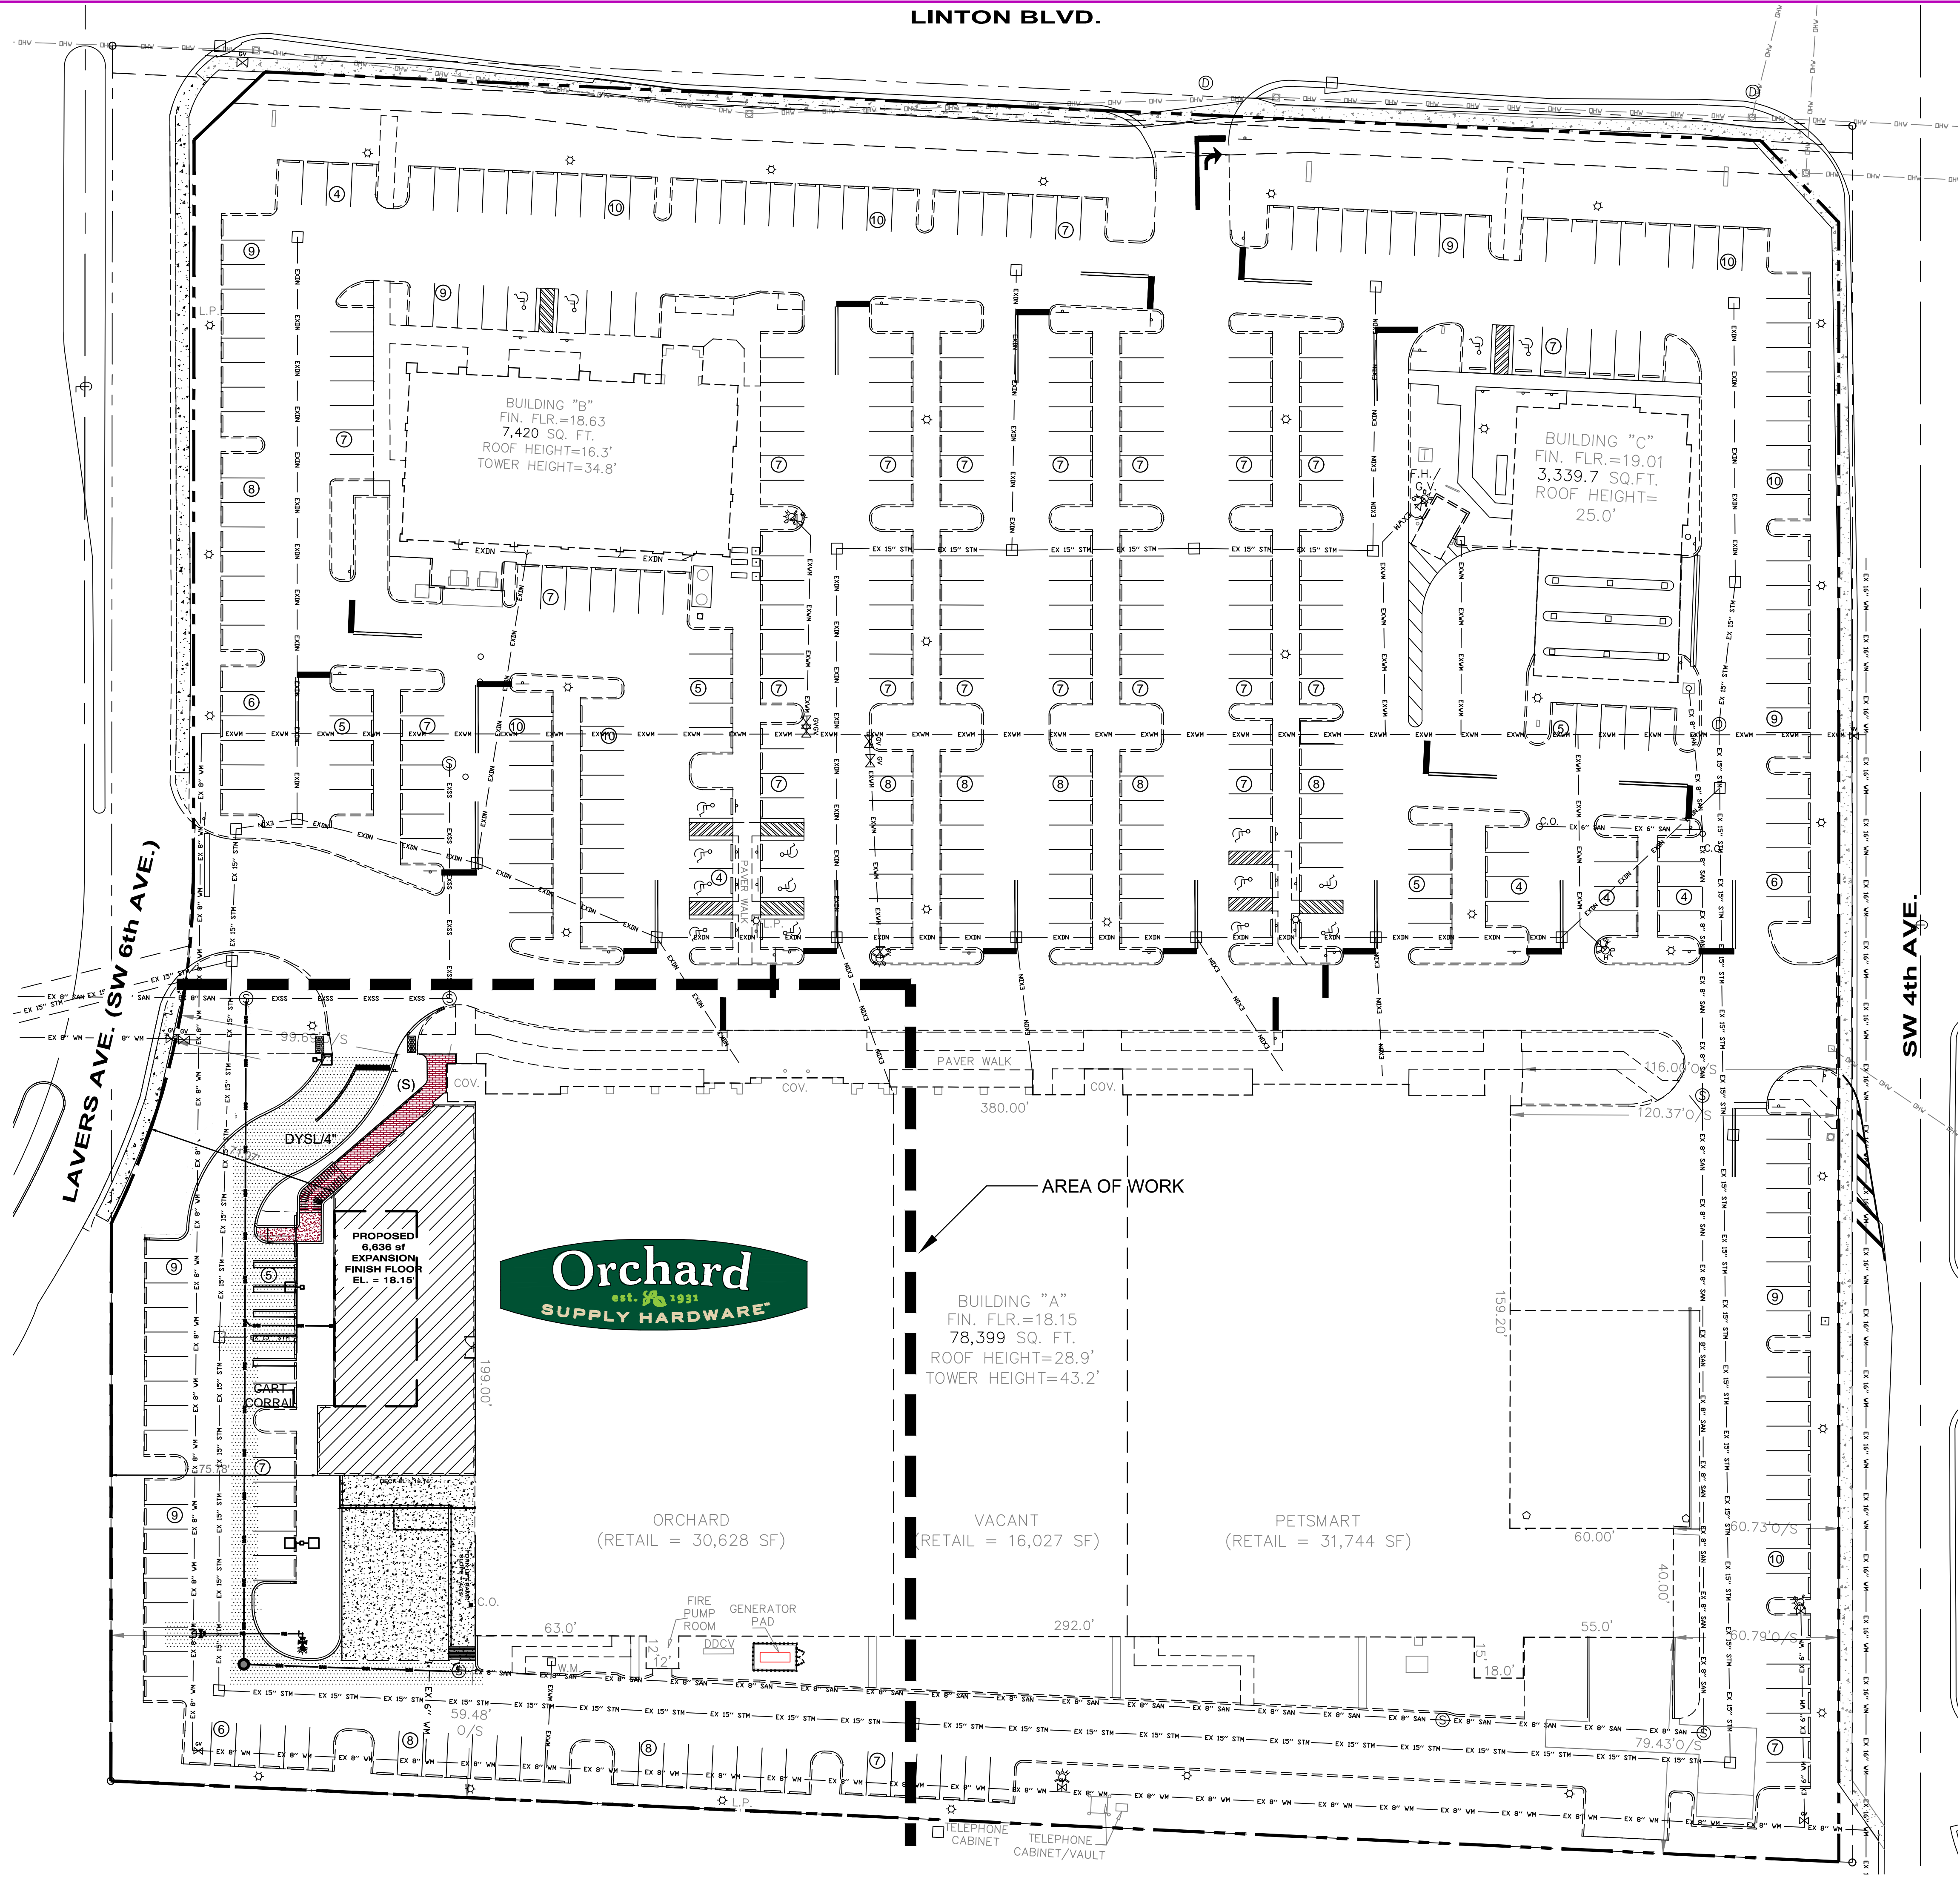

SITE DATA

STATEMENT OF INTENT:
THE OWNER PROPOSES TO CONSTRUCT A NEW 6,636 S.F.
NURSERY AND THE REQUIRED SITE SUPPORT ELEMENTS
TO SERVE IT.

SITE ADDRESS:
510 W. LINTON BLVD. DELRAY BEACH, FL.

PARCEL I.D. NUMBER: 12-43-46-29-32-001-0000

SITE TOTAL AREA: 387,341 S.F. (8.89 AC. ±)

EXISTING AREA CALCULATIONS:

PLATTED BOUNDARY AREA: 387,341 SF / 8.89 AC - 100%

BUILDING AREA: 89,159 SF / 2.05 AC - 23.02%
IMPERVIOUS AREA: 104,253 SF / 4.62 AC - 51.97%
PERVIOUS AREA: 96,869 SF / 2.23 AC - 25.01%

PROPOSED AREA CALCULATIONS:

PLATTED BOUNDARY AREA: 387,341 SF / 8.89 AC - 100%

BUILDING AREA: 95,795 SF / 2.20 AC - 24.73%
IMPERVIOUS AREA: 104,253 SF / 4.62 AC - 51.97%
PERVIOUS AREA: 97,293 SF / 2.23 AC - 25.12%

EXISTING USE: RETAIL

PROPOSED USE: RETAIL

MAX. BUILDING HEIGHT: 48' MAX.

BUILDING AREA CALCULATIONS:

EXISTING (ENTIRE CENTER): 89,159 SF
PROPOSED NURSERY: 6,636 SF
PROPOSED (ENTIRE CENTER): 95,795 SF

BUILDING SETBACKS

	REQUIRED	PROVIDED
FRONT:	10'	74.14'
SIDE (WEST):	10'	78.78'
SIDE (EAST):	10'	120.7'
REAR:	10'	89.5'

LANDSCAPE SETBACKS

	REQUIRED	PROVIDED
NORTH:	30'	32'
EAST:	5'	8.5'
SOUTH:	5'	5.2'
WEST:	5'	VARIES (8'-10.2')

ZONING:

SUBJECT SITE: PC - PLANNED COMMERCIAL
NORTH: GC - GENERAL COMMERCIAL
EAST: SAD - SPECIAL ACTIVITIES DISTRICT
SOUTH: I - INDUSTRIAL / GC - GENERAL COMMERCIAL
WEST: PC - PLANNED COMMERCIAL

PARKING INFORMATION

TOTAL SPACES REQUIRED	384
TOTAL SPACES PROVIDED	427

PARKING REQUIRED	4.0 SPACE / 1,000 S.F.
95,795 S.F. / 1,000 S.F. = 384 SPACES	

412 EXISTING SPACES: 9' X 18' STANDARD @ 90°	
16 EXISTING SPACES: 12' X 18' ACCESSIBLE @ 90°	

SURVEY INFORMATION

PREPARED BY: CAULFIELD & WHEELER, INC.
7900 GLADES RD., SUITE 100
BOCA RATON, FLORIDA 33434
(561) 392-1991
ATTN: JEFFREY WAGNER, PLS
11/16/2016

DATE:

SITE LEGEND

- PROPOSED CONCRETE
- PROPOSED ASPHALT PAVEMENT
- PROPOSED PAVER BRICKS
- PROPOSED BUILDING
- DYSL4" = DOUBLE YELLOW SOLID LINE / 4" WIDE
- EXISTING PARKING COUNT
- STOP SIGN (R1-1)
- PROPERTY LINE

OPPIDAN
builder of towns, creator of value.
Orchard
SUPPLY HARDWARE

DELRAY BEACH

OVERALL SITE PLAN
ORCHARD SUPPLY HARDWARE - DELRAY BEACH
CITY SITE PLAN REVIEW

C-6
36-16121-00
Issue Date
REVISIONS

JOB No.: D11914

www.cphcorp.com
A Full Service
A & E Firm

Architects
Engineers
Environmental
Landscape Architects
M / E / P
Planners
Structural
Surveyors
Traffic / Transportation



Offices in:
• Florida
• Puerto Rico
• Connecticut
• Maryland
• Texas

DLR Group
Architecture Engineering Planning Interiors

© 2016, DLR Group Inc., a Florida corporation. ALL RIGHTS RESERVED

11/18/2016 6:50:07 AM

A:\0113\AC\DWG\DWG\011314-C7-SITE PLAN.dwg, 2/20/2017 11:37:56 AM, 13

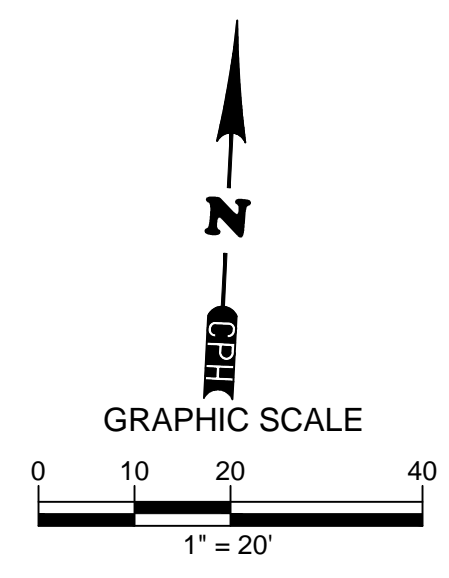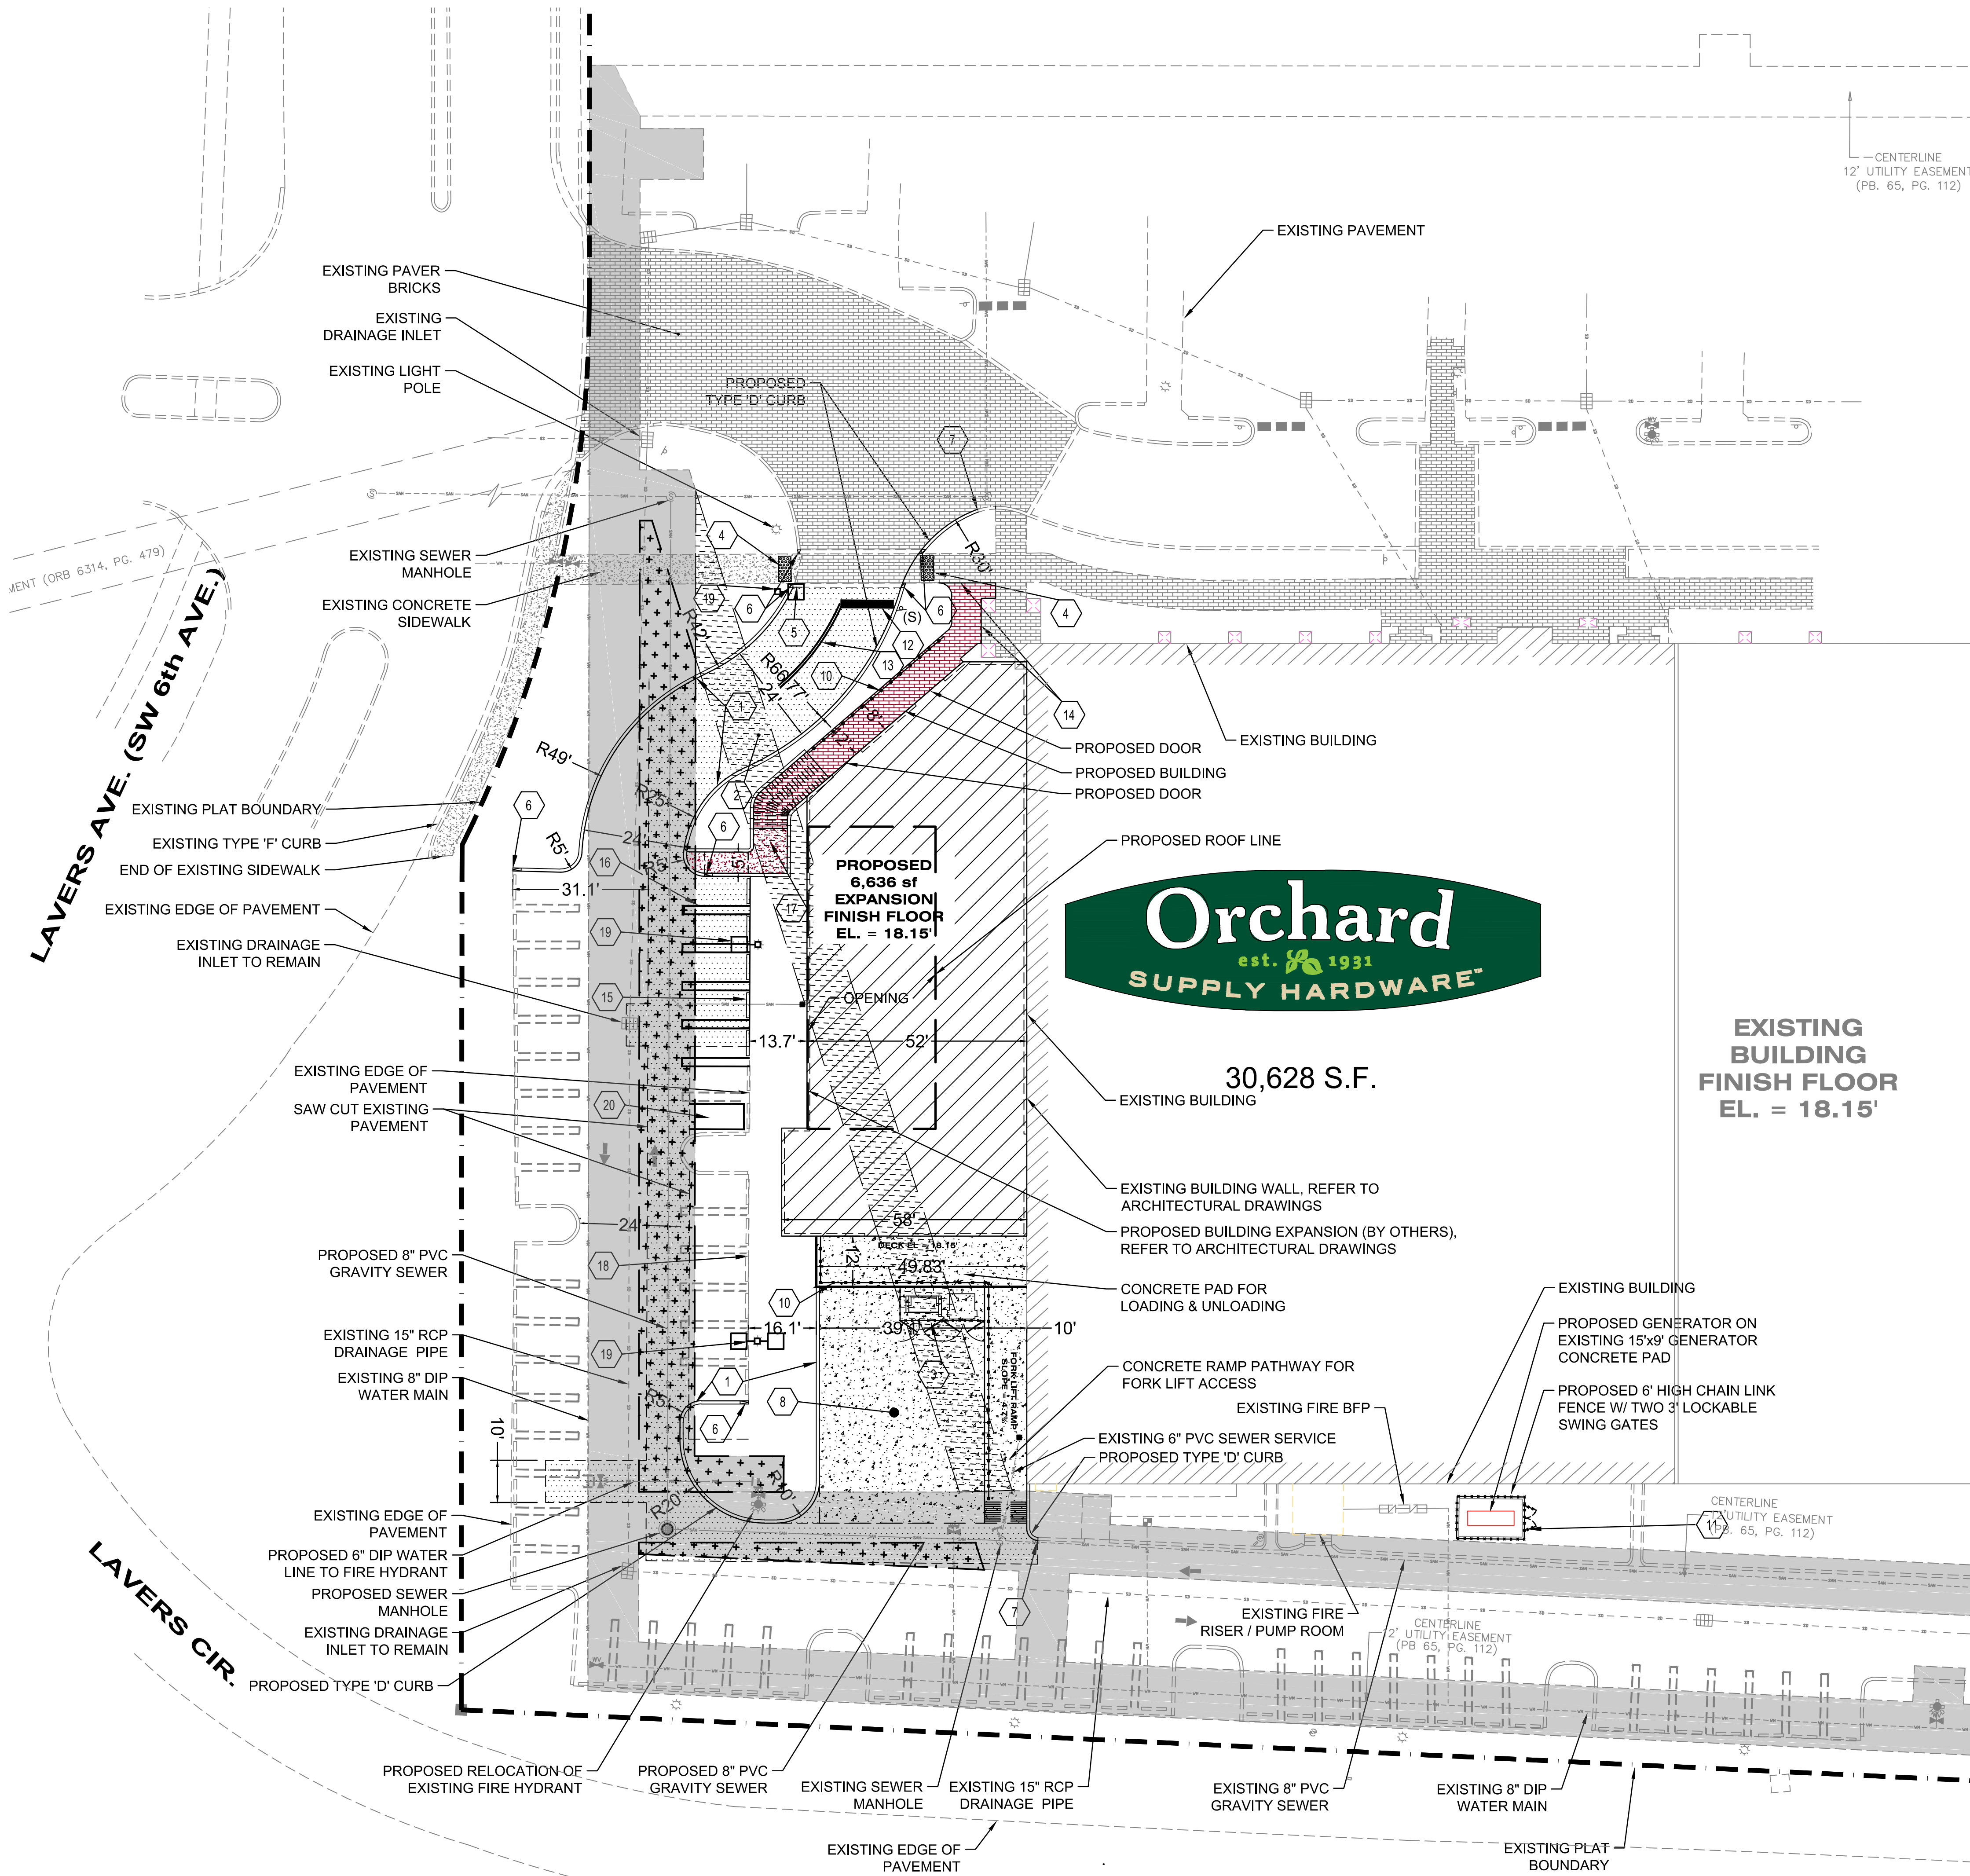

- ### GENERAL NOTES
- 3/4" EMPTY CONDUIT TO LOCATIONS SHOWN AT THE LOT PERIMETER FOR LOT LIGHTING IS BY THE GENERAL CONTRACTOR. LIGHTING FIXTURES, BASES, POLES, CONDUIT, AND WIRING ARE BY THE OWNER/OPERATOR.
 - PROPOSED UTILITIES ARE SHOWN IN SCHEMATIC ONLY. EXACT LOCATIONS SHALL BE DETERMINED TO ALLOW FOR THE MOST ECONOMICAL INSTALLATION.
 - THE CONTRACTOR SHALL COORDINATE WITH ALL UTILITY COMPANIES TO DETERMINE EXACT POINT OF SERVICE CONNECTION AT EXISTING UTILITY. REFER TO THE BUILDING ELECTRICAL AND PLUMBING DRAWINGS FOR UTILITY SERVICE ENTRANCE LOCATIONS, SIZES, AND CIRCUITING.
 - ALL ELEVATIONS SHOWN ARE IN REFERENCE TO THE BENCHMARK AND MUST BE VERIFIED BY THE GENERAL CONTRACTOR AT GROUNDBREAK.
 - FINISH WALK AND CURB ELEVATIONS SHALL BE 6" ABOVE FINISH PAVEMENT.
 - ALL LANDSCAPE AREAS SHALL BE ROUGH GRADED TO 6" BELOW TOP OF ALL WALKS AND CURBS. FINISH GRADING, LANDSCAPING, AND SPRINKLER SYSTEMS ARE BY THE OWNER/OPERATOR.
 - LOT LIGHTING CONCRETE FOOTINGS TO CONFORM WITH THE SOILS REPORT RECOMMENDATIONS FOR THIS PARTICULAR SITE.
 - DIMENSIONS SHOWN ARE TO THE FACE OF CURB UNLESS SHOWN (BOC) WHICH INDICATES BACK OF CURB.
 - ALL STRIPING SHALL BE IN CONFORMANCE WITH LOCAL AGENCY REQUIREMENTS.
 - ADJUST ALL MANHOLE RINGS AND CLEAN OUT COVERS TO BE FLUSH WITH FINISHED GRADE. ALL PARTS TO BE TRAFFIC BEARING (AASHTO H-20 LOADING).
 - ENSURE ACCESSIBILITY STICKERS ARE PLACED ON ALL APPLICABLE DOORS.
 - TRANSITIONS TO BE FLUSH ALL ALONG THE ACCESSIBLE ROUTE. CONTRACTOR SHALL ENSURE THE MAXIMUM CONSTRUCTED LEVEL TRANSITION AT EVERY JOINT DOES NOT EXCEED THE MAXIMUM ALLOWABLE UNDER THE ADA AFTER SETTLEMENT. EXPANSION, CONTRACTION, ETC. CHANGES IN LEVEL OF 1/4" HIGH MAXIMUM SHALL BE PERMITTED TO BE VERTICAL. CHANGES IN LEVEL BETWEEN 1/4" HIGH MINIMUM AND 1/2" HIGH MAXIMUM SHALL BE BEVELED WITH A SLOPE NOT STEEPER THAN 1:2.
 - FILL EXPANSION / CONTROL JOINT WITH EXTERIOR GRADE CONCRETE EXPANSION JOINT CAULKING. FILL ENTIRE LENGTH OF JOINT SUCH THAT ANY CHANGE IN ELEVATION DOES NOT EXCEED 1/4" IN ELEVATION FROM THE ADJACENT CONCRETE SURFACES WHEN CAULKING HAS CURED. FOR JOINTS WITH VOIDS DEEPER THAN 1/2", INSTALL CONTINUOUS FIBERBOARD EXPANSION JOINT FILLER BELOW CAULKING TO SUPPORT CAULKING ABOVE.
 - ALL ON SITE PAVEMENT TO BE DOUBLE STRIPED.

- ### KEYNOTES LEGEND
- 1 CONCRETE CURB - SEE DETAIL RT 6.1 ON C-10
 - 2 ASPHALT PAVING - SEE DETAIL #5 ON C-10A
 - 3 DUMPSTER LAYOUT - SEE DETAIL #7 ON C-10A
 - 4 PROPOSED DETECTABLE WARNING, 3" DEEP TRUNCATED DOMES TO BE OVERLAY PAD. - SEE DETAIL RT 10.3 ON C-10
 - 5 MATCH EXISTING SIDEWALK.
 - 6 PROPOSED FLARED END CURB - SEE DETAIL RT 6.2 ON C-10
 - 7 SAW CUT EXISTING CURB AND MATCH PROPOSED CURB INTO EXISTING CURB.
 - 8 PROPOSED HEAVY DUTY CONCRETE PAVEMENT, SEE DETAIL #4 ON C-10A
 - 9 PROPOSED PARKING STRIPING - SEE DETAIL #11 ON C-10
 - 10 PROPOSED HAND RAIL, (REFER TO ARCHITECTURAL PLANS FOR DETAILS)
 - 11 PROPOSED GENERATOR FENCE - SEE DETAIL #7 ON C-10A
 - 12 24" WIDE THERMOPLASTIC SOLID WHITE PAINTED STOP BAR, FDOT 17346 (TYP.)
 - 13 6" WIDE DOUBLE YELLOW LINE (TYP.)
 - 14 PROPOSED PAVEMENT SIDEWALK TO MATCH EXISTING.
 - 15 EXISTING WHEEL STOP TO BE REUSED.
 - 16 PROPOSED PARKING STRIPE, SEE DETAIL RT 4.2a ON C-10
 - 17 PROPOSED 8" WIDE CONC. SIDEWALK/RAMP.
 - 18 PROPOSED CONC. SIDEWALK TO BE FLUSH WITH PROPOSED AND EXISTING PAVEMENT.
 - 19 PROPOSED LIGHT POLE OR MODIFICATION TO EXISTING
 - 20 PROPOSED CART CORRAL

- ### SITE LEGEND
- EXISTING PAVER BRICKS
 - PROPOSED PAVER BRICKS
 - EXISTING CONCRETE
 - PROPOSED CONCRETE
 - PROPOSED ASPHALT PAVEMENT
 - PROPOSED BUILDING
 - PROPOSED & EXISTING EASEMENT TO REMAIN
 - EXISTING EASEMENT TO BE VACATED
 - (S) = STOP SIGN (R1-1)

Always call 811 two full business days before you dig

Sunshine811.com

www.sunshine811.com

TODD HARLAND HENDRIX, P.E.
REG.# 66794

JOB No.: D11914

cph

www.cphcorp.com

A Full Service A & E Firm

Architects
Engineers
Environmental
Landscape Architects
M / E / P
Planners
Structural
Surveyors
Traffic / Transportation

Offices in:
• Florida
• Puerto Rico
• Connecticut
• Maryland
• Texas

OPPIDAN
Builder of towns, creator of value.

Orchard
IN ALA
SUPPLY HARDWARE

DELAY BEACH

SITE DIMENSION PLAN

ORCHARD SUPPLY HARDWARE - DELRAY BEACH

CITY SITE PLAN REVIEW

510 LINTON BLVD
DELRAY BEACH, FL 33483


C-7

36-16121-00
Issue Date
REVISIONS

DLR Group

Architecture Engineering Planning Interiors

© 2016, DLR Group Inc., a Florida corporation. ALL RIGHTS RESERVED

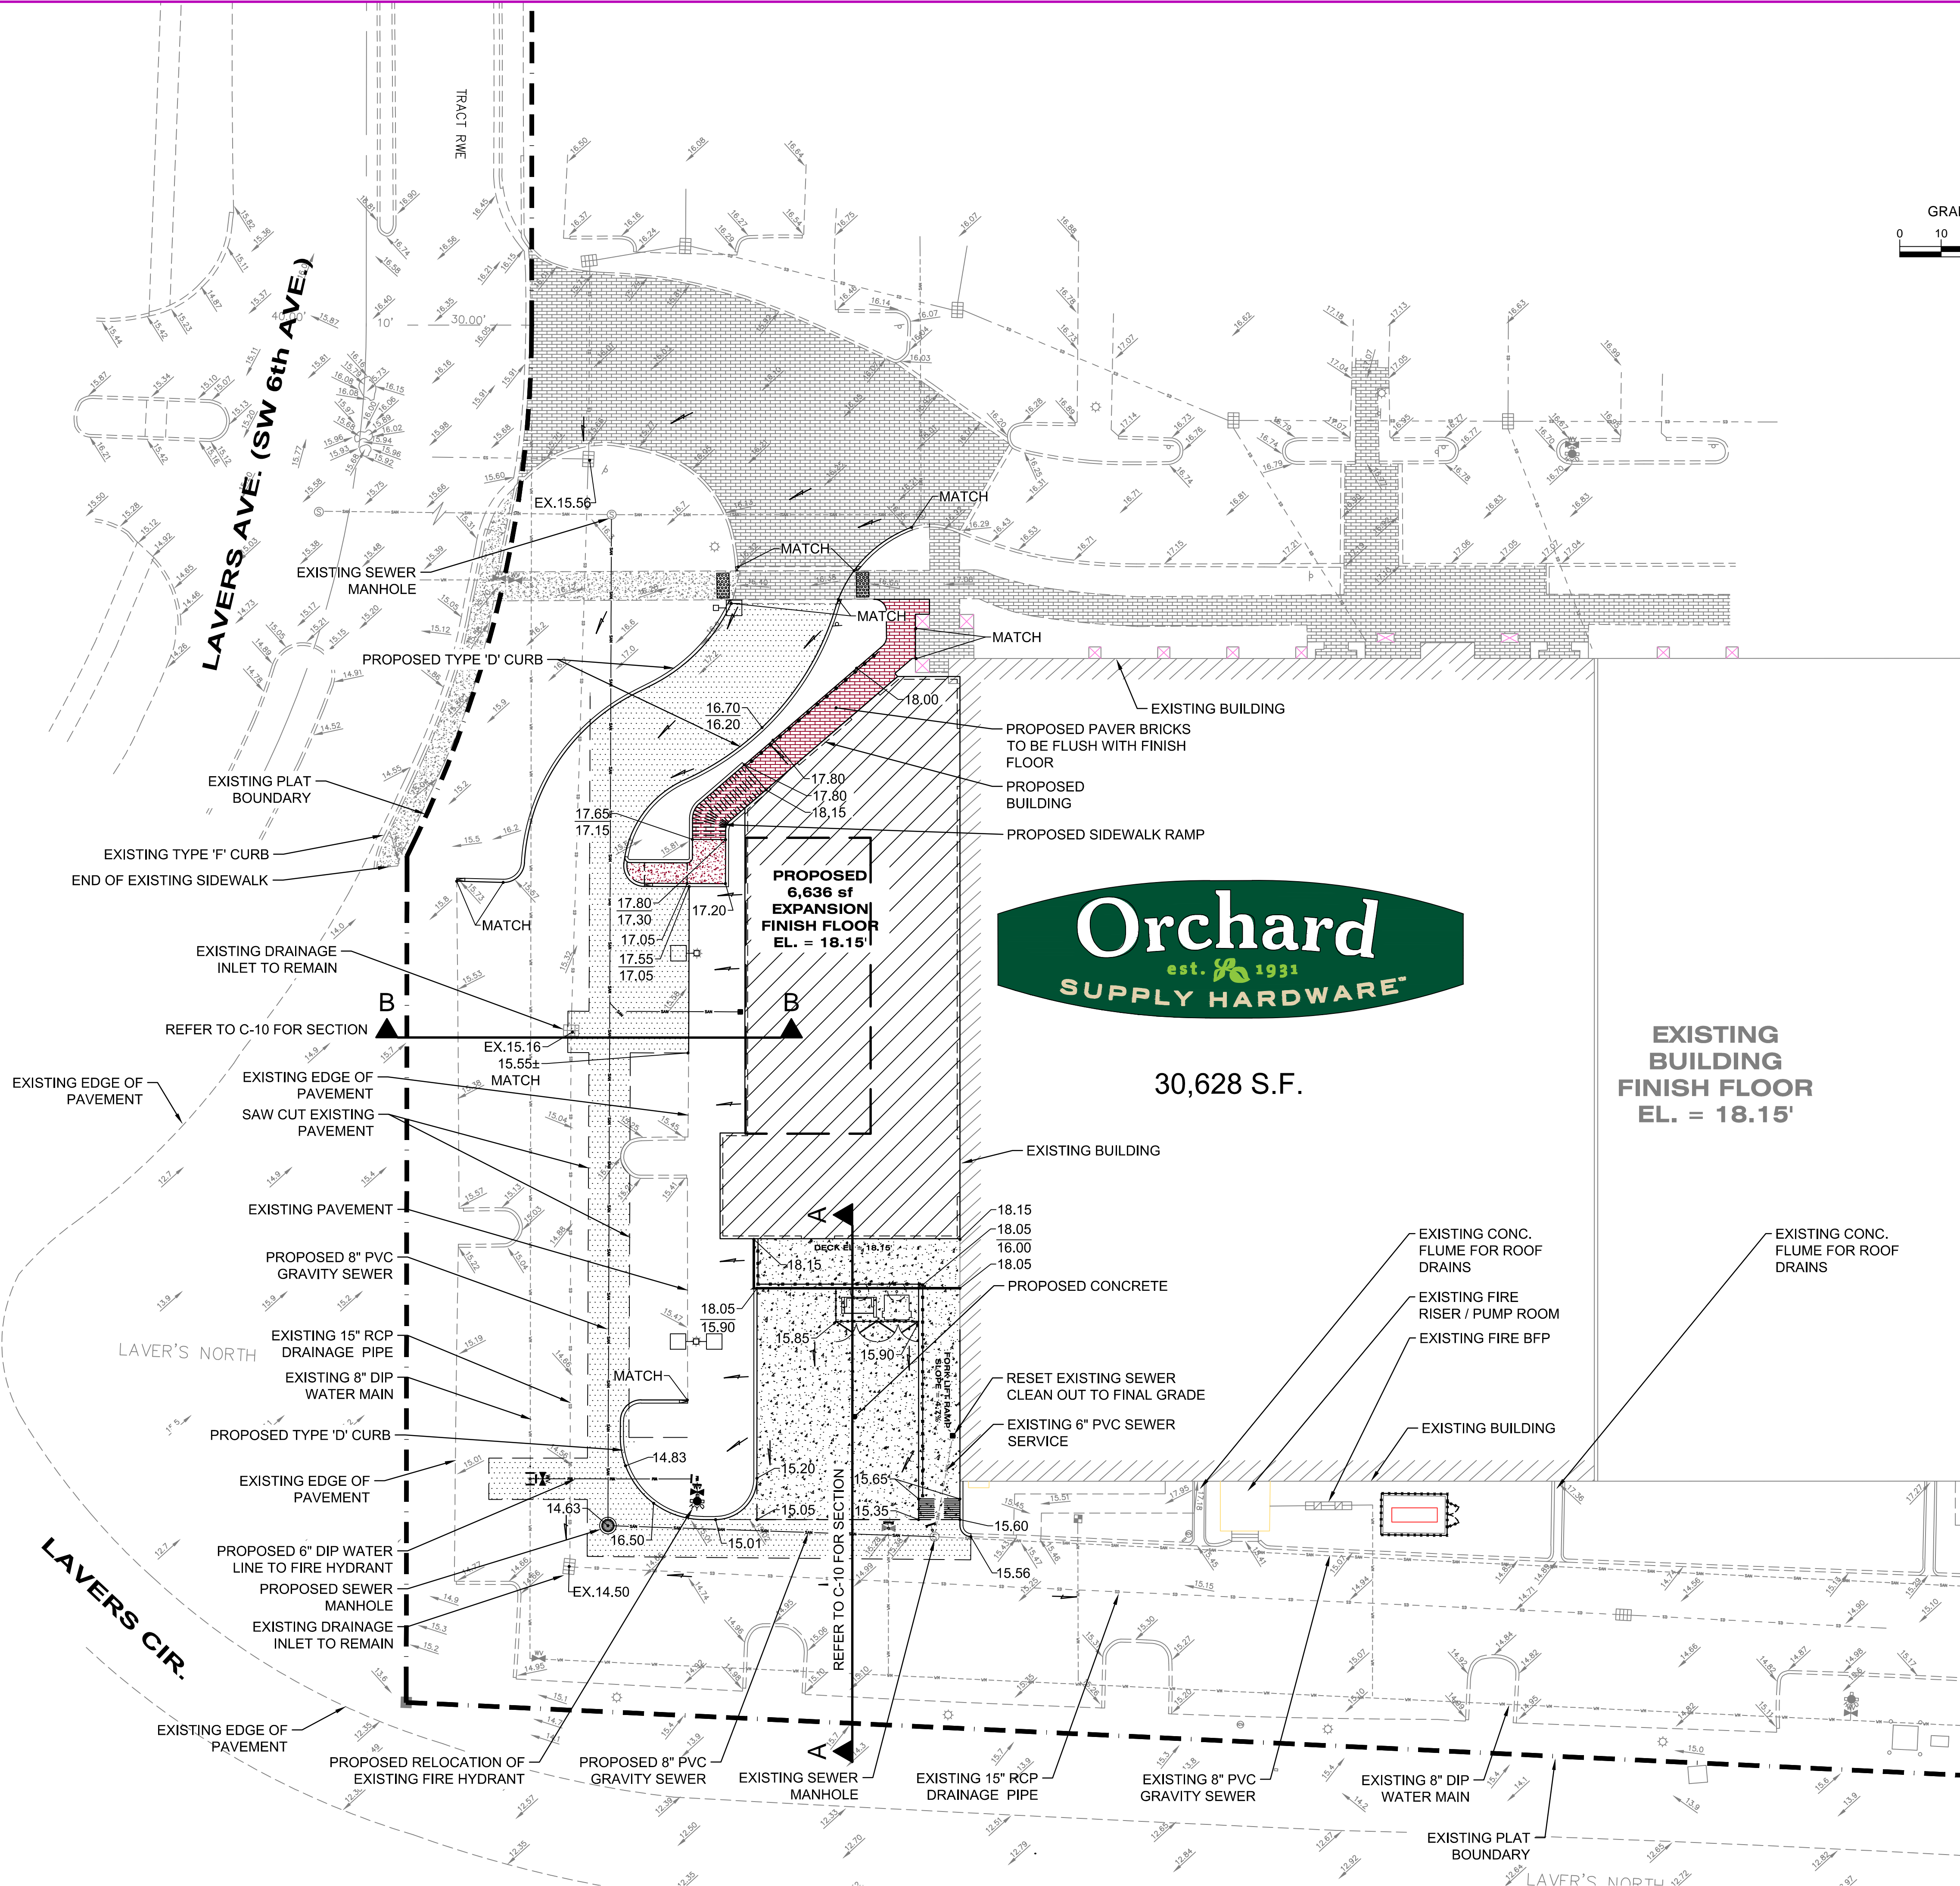

GENERAL GRADING NOTES

1. PRIOR TO ANY DEMOLITION OR CONSTRUCTION ACTIVITY THE CONTRACTOR SHALL INSTALL EROSION AND SEDIMENTATION CONTROL MEASURES SHOWN ON PLANS AND PROVIDED FOR IN FOOT INDEX NO. 102. AS CONSTRUCTION PROGRESSES, THE CONTRACTOR SHALL PERIODICALLY CHECK THE SEDIMENTATION CONTROLS AND REPAIR THEM AS NECESSARY TO KEEP THEM IN GOOD FUNCTIONING ORDER. THE CONTRACTOR SHALL ALSO PROTECT INLETS AND OTHER SITE APPURTENANCES FROM SEDIMENTATION USING PROTECTION AS DETAILED IN FDOT INDEX NO. 102.
2. THE CONTRACTOR SHALL CONDUCT GROUND STABILIZING MEASURES (PAVING, GRASSING, MULCHING AND SODDING) AS SOON AS PRACTICABLE FOLLOWING FINAL GRADING OF THE SITE.
3. FOLLOWING COMPLETION OF CONSTRUCTION AND COMPLETED STABILIZATION OF POTENTIAL EROSION AREAS, THE CONTRACTOR SHALL REMOVE SEDIMENTATION CONTROL MEASURES AND CLEAN AND REPAIR ANY AREAS AFFECTED BY THE CONSTRUCTION ACTIVITIES. ANY SILTATION IN THE STORMWATER SYSTEM SHALL BE COMPLETELY FLUSHED PRIOR TO CERTIFICATION OF COMPLETION.
4. ACCORDING TO THE NATIONAL FLOOD INSURANCE PROGRAM, FLOOD INSURANCE RATE MAP (FIRM) COMMUNITY PANEL NO. 120635-0279, EFFECTIVE DATE SEPT./11/2009 THIS PROPERTY LIES IN ZONE 'X'.
5. THIS PROJECT IS PENDING APPROVAL BY SOUTHWEST FLORIDA WATER MANAGEMENT DISTRICT
6. CONTRACTOR SHALL FIELD VERIFY EXISTING AND SURROUNDING DEVELOPMENT GRADES AND CONTACT ENGINEER IF ANY DISCREPANCIES EXIST PRIOR TO CONSTRUCTION.
7. CONTRACTOR SHALL VERIFY POSITIVE DRAINAGE FLOW AWAY FROM BLDG. AND THAT A MINIMUM SLOPE OF AT LEAST 1% IN THE DIRECTION OF DRAINAGE FLOW INDICATED CAN BE ACHIEVED.
8. ANY TREES AND / OR SHRUBS PLACED WITHIN WATER, SEWER, OR DRAINAGE EASEMENTS SHALL CONFORM TO THE CITY OF DELRAY BEACH STANDARD DETAILS: LDI.1 & LDI.2

PROPOSED STORM SYSTEM NOTES

1. ALL PIPES IN LEGEND SPECIFIED AS "STORM PIPE" SHALL BE SELECTED FROM THOSE LISTED IN GENERAL NOTES, STORM SEWER SYSTEMS, SHEET C-2.
2. FOR INLET BOTTOMS SEE FOOT INDEX NO. 200.
3. FOR SUPPLEMENTAL DETAILS SEE FDOT INDEX NO. 201.
4. ALL DRAINAGE STRUCTURES, INCLUDING CLEAN-OUTS, SHALL BE INSTALLED WITH TRAFFIC BEARING GRATES, TOPS, RINGS AND COVERS, ETC. AS APPLICABLE.
5. ALL PROPOSED INLET GRATES SHALL BE H20 TRAFFIC BEARING RETICULINE STEEL.
6. PIPE CROSSING AT THIS LOCATION HAS BEEN CALCULATED TO BE LESS THAN 18" CLEARANCE. CONTRACTOR SHALL TAKE THE NECESSARY PRECAUTIONS TO ENSURE JOINTS/BELLS DO NOT ALIGN VERTICALLY AT CROSSING POINT AND SAID JOINTS HAVE AT LEAST 2 FEET HORIZONTAL CLEARANCE FROM CROSSING POINT. (SEE PIPE CROSSING DETAIL SHEET C-9).

LEGEND

PROP. SPOT ELEV. = (T.C.) (E.O.P.)	TOP OF CURB EDGE OF PAVEMENT
PROP. SPOT ELEV. = (E.O.P.)	EDGE OF PAVEMENT OR PAVEMENT GRADE
EXIST. SPOT ELEV. =	
EXISTING DRAINAGE FLOW =	
EXISTING STORM PIPE =	
CLEAN OUT =	
	PROPOSED CONCRETE
	EXISTING PAVERS
	PROPOSED PAVERS
	PROPOSED PAVEMENT

DELRAY BEACH

GRADING & DRAINAGE PLAN

ORCHARD SUPPLY HARDWARE - DELRAY BEACH

CITY SITE PLAN REVIEW

C-8

36-16121-00

Issue Date

REVISIONS

JOB No.: D11914

www.cphcorp.com

A Full Service A & E Firm

Architects
Engineers
Environmental
Landscape Architects
M / E / P
Planners
Structural
Surveyors
Traffic / Transportation

Offices in:



- Florida
- Puerto Rico
- Connecticut
- Maryland
- Texas

TODD HARLAND HENDRIX, P.E.
REG.# 66794

DLR Group

Architecture Engineering Planning Interiors

© 2016, DLR Group Inc., a Florida corporation. ALL RIGHTS RESERVED

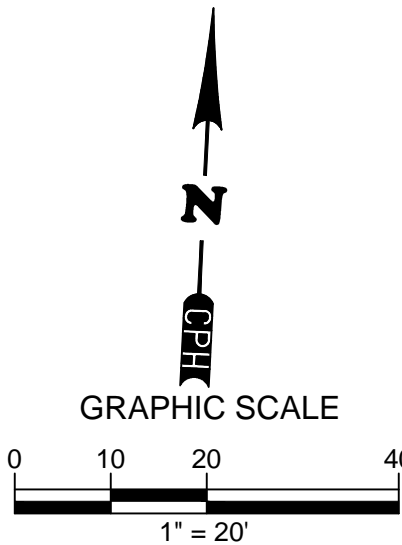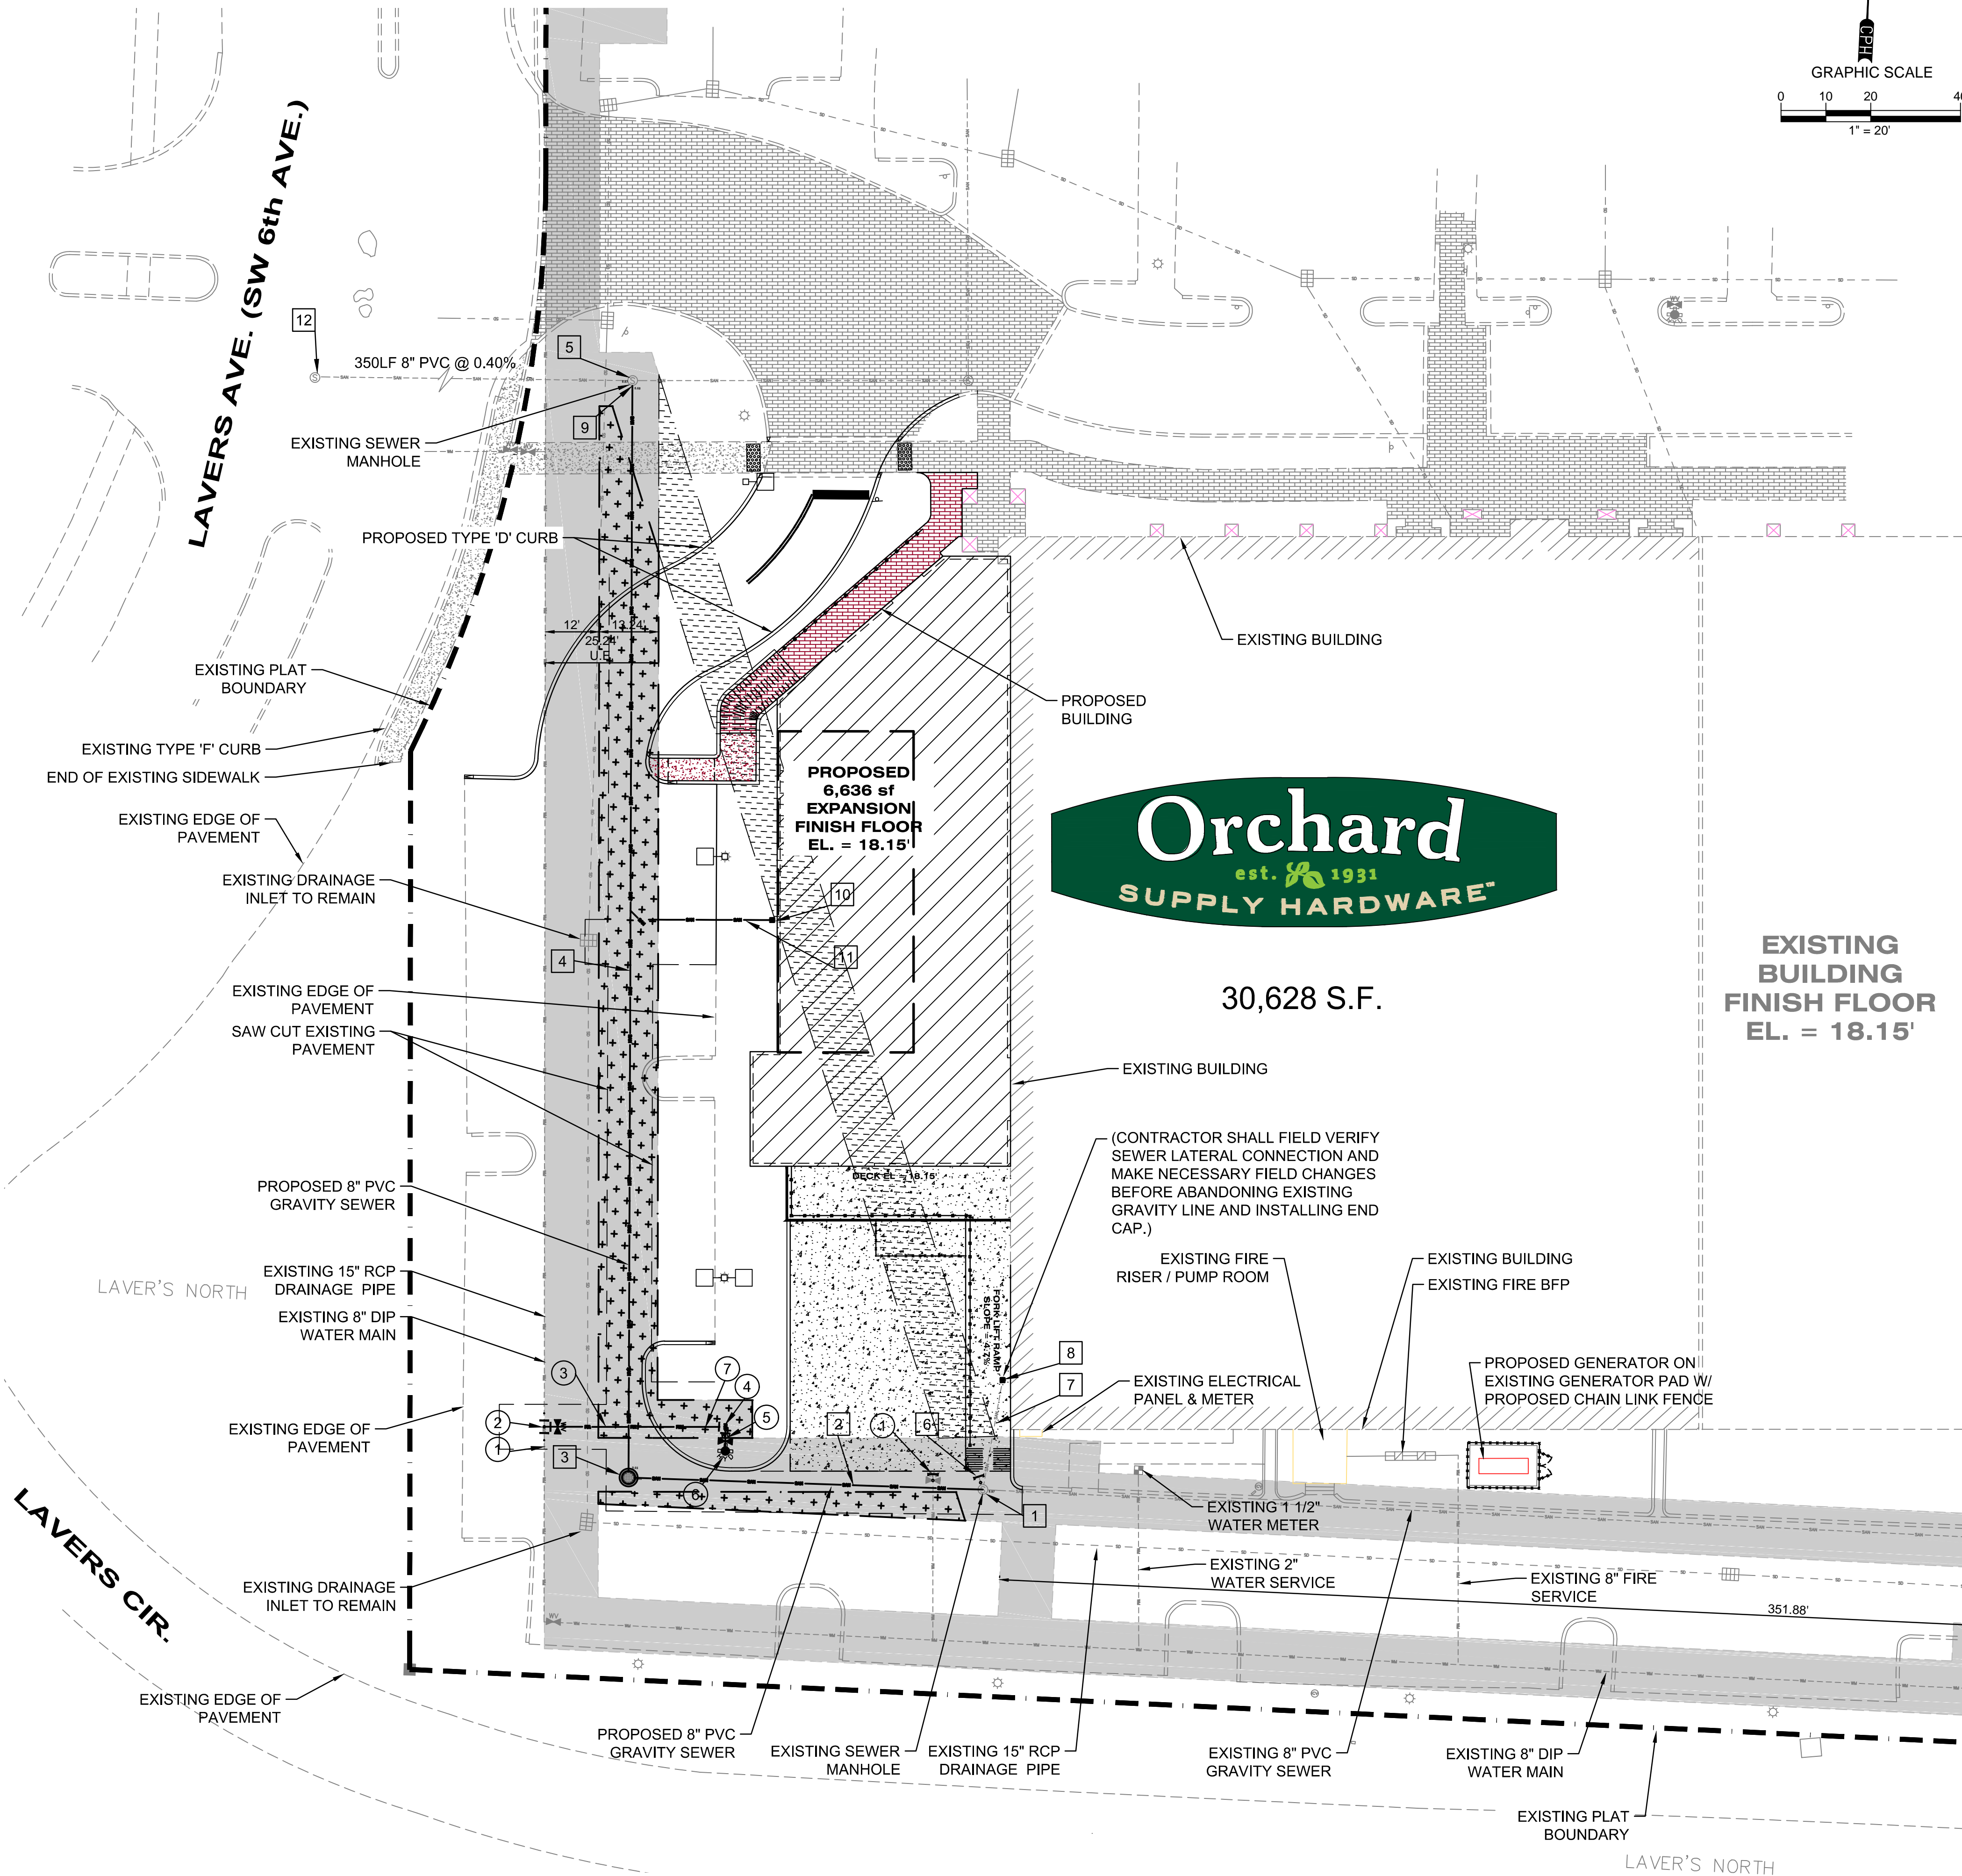

SANITARY SEWER SCHEDULE	GENERAL UTILITY NOTES
<div>1 EXISTING SEWER MANHOLE RIM EL. = 15.67' N. INV. EL. = 11.60' (EXISTING 6" PVC) NW. INV. EL. = 10.01' (EXISTING 8" PVC) E. INV. EL. = 9.97' (EXISTING 8" PVC) W. INV. EL. = 9.96' (PROPOSED 8" PVC)</div> <div>2 77 L.F. - 8" P.V.C. @ 0.40%</div> <div>3 PROPOSED SEWER MANHOLE RIM EL. = 14.63' (MATCH EXISTING PAVEMENT) N. INV. EL. = 9.65' (PROPOSED 8" PVC) E. INV. EL. = 9.66' (PROPOSED 8" PVC) (REFER TO MANHOLE DETAILS ON C-XX)</div> <div>4 243 L.F. - 8" P.V.C. @ 0.04%</div> <div>5 EXISTING SEWER MANHOLE RIM EL. = 15.63' W. INV. EL. = 8.67' (EXISTING 8" PVC) E. INV. EL. = 9.23' (EXISTING 8" PVC) S. INV. EL. = 8.68' (PROPOSED 8" PVC)</div> <div>6 INSTALL WATER TIGHT END CAP ON REMAINING EXISTING 5L/4 OF 8" PVC</div> <div>7 EXISTING 6" PVC SEWER LATERAL TO BUILDING.</div> <div>8 REPLACE EXISTING SEWER CLEAN-OUT/SERVICE WITH TRAFFIC RATED SEWER SERVICE/CLEANOUT AND ADJUST TOP TO PROPOSED GRADE.</div> <div>9 CORE DRILL OPENING ON SOUTH SIDE OF EXISTING MANHOLE FOR PROPOSED 8" PVC SEWER INVERT = 8.68'. EXISTING OPENING SHALL BE PLUGGED AND SEALED TO PREVENT WATER INFILTRATION.</div> <div>10 PROPOSED SEWER CLEAN-OUT/SERVICE FOR NURSERY. SET TOP AT FINAL GRADE AND SET INV. 48" BELOW F.F.E.</div> <div>11 PROPOSED 32L/F OF 6" PVC SEWER LATERAL @ 1% MIN.</div> <div>12 EXISTING SEWER MANHOLE RIM EL. = 14.55' E. INV. EL. = 8.2' (EXISTING 8" PVC)</div> <div>13 EXISTING SEWER MANHOLE RIM EL. = 15.36' E. INV. EL. = 11.45' (EXISTING 8" PVC) W. INV. EL. = 11.41' (EXISTING 8" PVC)</div>	<div>1. SEE COVER SHEET FOR A LIST OF UTILITY COMPANIES.</div> <div>2. GENERAL CONTRACTOR IS TO COORDINATE WITH APPROPRIATE UTILITY COMPANIES PRIOR TO CONSTRUCTION, ADJUSTMENT OR RELOCATION OF EXISTING UTILITIES AS DESIGNATED ON PLANS.</div> <div>3. THE CONTRACTOR SHALL NOTIFY THE UTILITY AUTHORITY INSPECTORS 72 HOURS BEFORE CONNECTING TO ANY EXISTING LINE.</div> <div>4. DRAWINGS DO NOT PURPORT TO SHOW ALL EXISTING UTILITIES. EXISTING UTILITIES SHALL BE VERIFIED BY THE CONTRACTOR PRIOR TO NEW UTILITY LINES BEING INSTALLED.</div> <div>5. THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE LOCATION AND/OR ELEVATION OF EXISTING UTILITIES AS SHOWN ON THESE PLANS IS BASED ON RECORDS OF THE VARIOUS UTILITY COMPANIES AND, WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD. THE INFORMATION IS NOT TO BE RELIED ON AS BEING EXACT OR COMPLETE. THE CONTRACTOR MUST CALL THE APPROPRIATE UTILITY COMPANY AT LEAST 72 HOURS BEFORE ANY EXCAVATION TO REQUEST EXACT FIELD LOCATION OF UTILITIES. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE ALL EXISTING UTILITIES WHICH CONFLICT WITH THE PROPOSED IMPROVEMENTS SHOWN ON THE PLANS.</div> <div>6. CONTRACTOR IS RESPONSIBLE FOR REPAIRS OF DAMAGE TO ANY EXISTING UTILITY DURING CONSTRUCTION AT NO COST TO THE OWNER.</div> <div>7. CONTRACTOR SHALL REFER TO ARCHITECTURAL PLANS AND SPECIFICATIONS FOR ACTUAL LOCATION OF ALL UTILITY ENTRANCES TO INCLUDE SANITARY SEWER LATERALS, DOMESTIC AND FIRE PROTECTION WATER SERVICE, ELECTRICAL, TELEPHONE AND GAS SERVICE. CONTRACTOR SHALL COORDINATE INSTALLATION OF UTILITIES, IN SUCH A MANNER AS TO AVOID CONFLICT AND ASSURE PROPER DEPTHS ARE ACHIEVED AS WELL AS COORDINATING WITH UTILITY REQUIREMENTS AS TO LOCATION AND SCHEDULING FOR TIE-INS/ CONNECTIONS PRIOR TO CONNECTING TO EXISTING UTILITIES.</div> <div>8. THE TOP ELEVATION OF MANHOLES CONSTRUCTED IN PAVED AREAS SHALL MATCH FINISHED GRADE. THE TOP ELEVATION OF MANHOLES CONSTRUCTED IN GRASSED AREAS SHALL BE 4" ABOVE FINISHED GRADE (UNLESS NOTED OTHERWISE).</div> <div>9. ALL MANHOLES CONSTRUCTED WITHIN PAVED AREAS SHALL BE INSTALLED WITH TRAFFIC BEARING RINGS AND COVERS.</div> <div>10. ALL CLEAN-OUTS WITHIN THE PAVEMENT AREA SHALL BE INSTALLED WITH TRAFFIC BEARING PARTS AS APPLICABLE.</div> <div>11. CONTRACTOR SHALL GROUT AROUND ALL PIPE ENTRANCES TO SANITARY SEWER MANHOLES WITH NON-SHRINKING GROUT TO ASSURE CONNECTION IS WATER TIGHT.</div> <div>12. CONTRACTOR SHALL PROVIDE ALL APPURTENANCES SUCH AS CHECK VALVES, BACKFLOW PREVENTERS, ETC., AS REQUIRED BY GOVERNING AUTHORITIES.</div> <div>13. ALL WATER, FORCE MAIN AND SANITARY SEWER LINES SHALL HAVE A MINIMUM OF 3' OF COVER. POLY ETHYLENE WATER SERVICE MAY BE REDUCED TO 2' WHEN NECESSARY.</div> <div>14. CONTRACTOR SHALL COORDINATE INSPECTION ON ALL UTILITIES, WITH APPROPRIATE AUTHORITIES PRIOR TO COVERING TRENCHES DURING INSTALLATION.</div> <div>15. CONSTRUCTION SHALL COMPLY WITH ALL GOVERNING CODES AND REQUIREMENTS.</div> <div>16. THE CONTRACTOR SHALL CONDUCT ALL REQUIRED TESTS TO THE SATISFACTION OF THE RESPECTIVE UTILITY COMPANIES AND THE OWNER'S INSPECTING AUTHORITIES.</div> <div>17. ALL NECESSARY INSPECTIONS AND/OR CERTIFICATIONS REQUIRED BY CODES AND/OR UTILITY SERVICE COMPANIES SHALL BE PERFORMED PRIOR TO ANNOUNCED BUILDING POSSESSION AND THE FINAL CONNECTION OF SERVICES.</div> <div>18. CONTRACTOR SHALL COMPLY TO THE FULLEST EXTENT WITH THE LATEST STANDARDS OF OSHA DIRECTIVES OR ANY OTHER AGENCY HAVING JURISDICTION FOR EXCAVATION AND TRENCHING PROCEDURES. THE CONTRACTOR SHALL USE SUPPORT SYSTEMS, SLOPING, BENCHING AND OTHER MEANS OF PROTECTION. THIS TO INCLUDE BUT NOT BE LIMITED, FOR ACCESS AND EGRESS FROM ALL EXCAVATION AND TRENCHING. CONTRACTOR IS RESPONSIBLE TO COMPLY WITH PERFORMANCE CRITERIA FOR OSHA.</div> <div>19. THE CONTRACTOR SHALL RECOGNIZE AND ABIDE BY ALL OSHA EXCAVATION SAFETY STANDARDS, INCLUDING THE FLORIDA TRENCH SAFETY ACT (90-96, LAWS OF FLORIDA). ANY MATERIAL, CONSTRUCTION METHODS, OR MATERIAL COST TO COMPLY WITH THESE LAWS SHALL BE INCIDENTAL TO THE CONTRACT.</div> <div>20. ALL FILL MATERIAL IS TO BE IN PLACE AND COMPACTED BEFORE INSTALLATION OF PROPOSED UTILITIES.</div> <div>21. CONTRACTOR MUST STOP OPERATION AND NOTIFY THE OWNER FOR PROPER DIRECTION IF ANY ENVIRONMENTAL OR HEALTH RELATED CONTAMINATE IS ENCOUNTERED DURING EXCAVATION.</div> <div>22. ALL WATER MAINS, FIRE WATER MAINS AND SERVICES SHALL BE TESTED, APPROVED AND DISINFECTED IN ACCORDANCE WITH UTILITY COMPANY REQUIREMENTS PRIOR TO CONNECTION TO MUNICIPAL SYSTEM.</div> <div>23. THE MINIMUM HORIZONTAL SEPARATION BETWEEN THE CLOSEST TWO POINTS OF THE WATER AND SEWER LINE IS SIX (6) FEET. OR MINIMUM VERTICAL SEPARATION BETWEEN THE CLOSEST TWO POINTS OF THE WATER OVER SEWER LINE IS TWELVE (12) INCHES.</div> <div>24. CHAPTER 553.851 OF THE FLORIDA STATUTES REQUIRES THAT AN EXCAVATOR NOTIFY ALL GAS UTILITIES A MINIMUM OF TWO (2) WORKING DAYS PRIOR TO EXCAVATING.</div> <div>25. THE CONTRACTOR SHALL NOTIFY THE APPROPRIATE UTILITY PROVIDERS 48 HOURS PRIOR TO ANY UTILITIES CONSTRUCTION.</div> <div>26. CONTRACTOR TO BE RESPONSIBLE FOR VERIFYING UTILITY SERVICE WITH EACH UTILITY COMPANY.</div> <div>27. ANY TREES AND / OR SHRUBS PLACED WITHIN WATER, SEWER, OR DRAINAGE EASEMENTS SHALL CONFORM TO THE CITY OF DELRAY BEACH STANDARD DETAILS, LD1.1 & LD1.2.</div> <div>28. WATER METER SIZES SHALL BE DESIGNED BY ENGINEER OF RECORD AND SHALL BE CHECKED AND AUTHORIZED BY CITY OF DELRAY BEACH UTILITIES DIVISION</div>

POTABLE WATER SCHEDULE
<div>1 EXISTING 8" DIP WATER MAIN</div> <div>2 PROPOSED 8"x6" TAPPING SLEEVE AND 6" TAPPING VALVE</div> <div>3 PROPOSED 41 L/F OF 6" DIP WATER LINE</div> <div>4 PROPOSED 6" 90° BEND</div> <div>5 PROPOSED 5 L/F OF 6" DIP WATER LINE</div> <div>6 RELOCATION OF EXISTING 6" FIRE HYDRANT ASSEMBLY</div> <div>7 SAMPLE POINT</div>

UTILITY LEGEND
<div>--- -- -- -- -- EXISTING STORM DRAINAGE</div> <div>--- -- -- -- -- EXISTING WATER MAIN</div> <div>--- -- -- -- -- EXISTING SANITARY SEWER</div> <div>--- -- -- -- -- PROPOSED SANITARY SEWER</div> <div>--- -- -- -- -- PROPOSED WATER LINE</div> <div>● PROPOSED SEWER MANHOLE</div> <div>○ EXISTING SEWER MANHOLE</div> <div>■ PROPOSED SEWER CLEANOUT</div> <div>▨ = PROPOSED EASEMENT</div> <div>▤ = PROPOSED AND/OR EXISTING EASEMENT TO REMAIN</div> <div>▥ = EXISTING EASEMENT TO BE VACATED</div>

Always call 811 two full business days before you dig

Sunshine811.com

www.sunshine811.com

JOB No.: D11914

cph

www.cphcorp.com

A Full Service A & E Firm

Architects
Engineers
Environmental
Landscape Architects
M / E / P
Planners
Structural
Surveyors
Traffic / Transportation

Offices in:
• Florida
• Puerto Rico
• Connecticut
• Maryland
• Texas

OPPIDAN
builder of towns, creator of values

Orchard
SUPPLY HARDWARE

DELRAY BEACH

COMPOSITE UTILITY PLAN
ORCHARD SUPPLY HARDWARE - DELRAY BEACH
CITY SITE PLAN REVIEW




510 LINTON BLVD
DELRAY BEACH, FL 33483

C-9
36-16121-00
Issue Date
REVISONS

DLR Group
Architecture Engineering Planning Interiors


© 2016, DLR Group Inc., a Florida corporation, ALL RIGHTS RESERVED

11/18/2016 6:50:07 AM

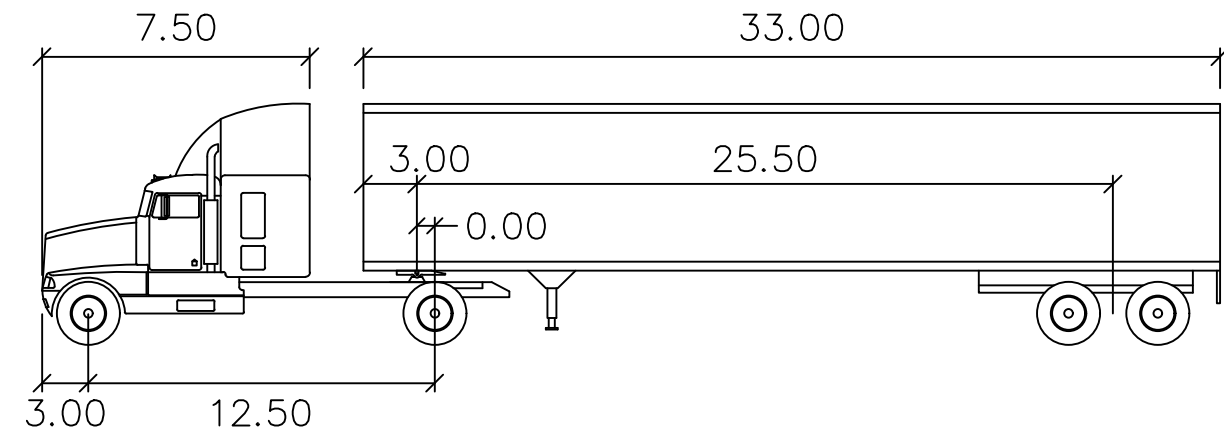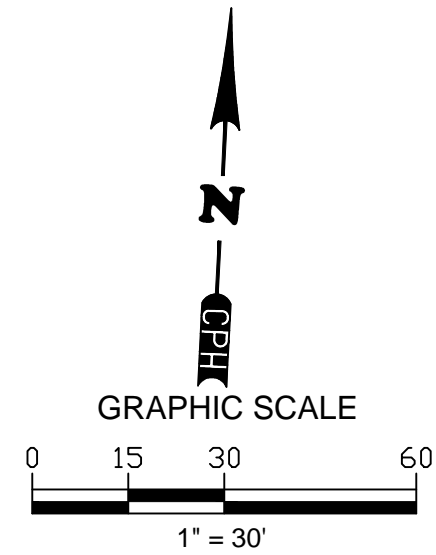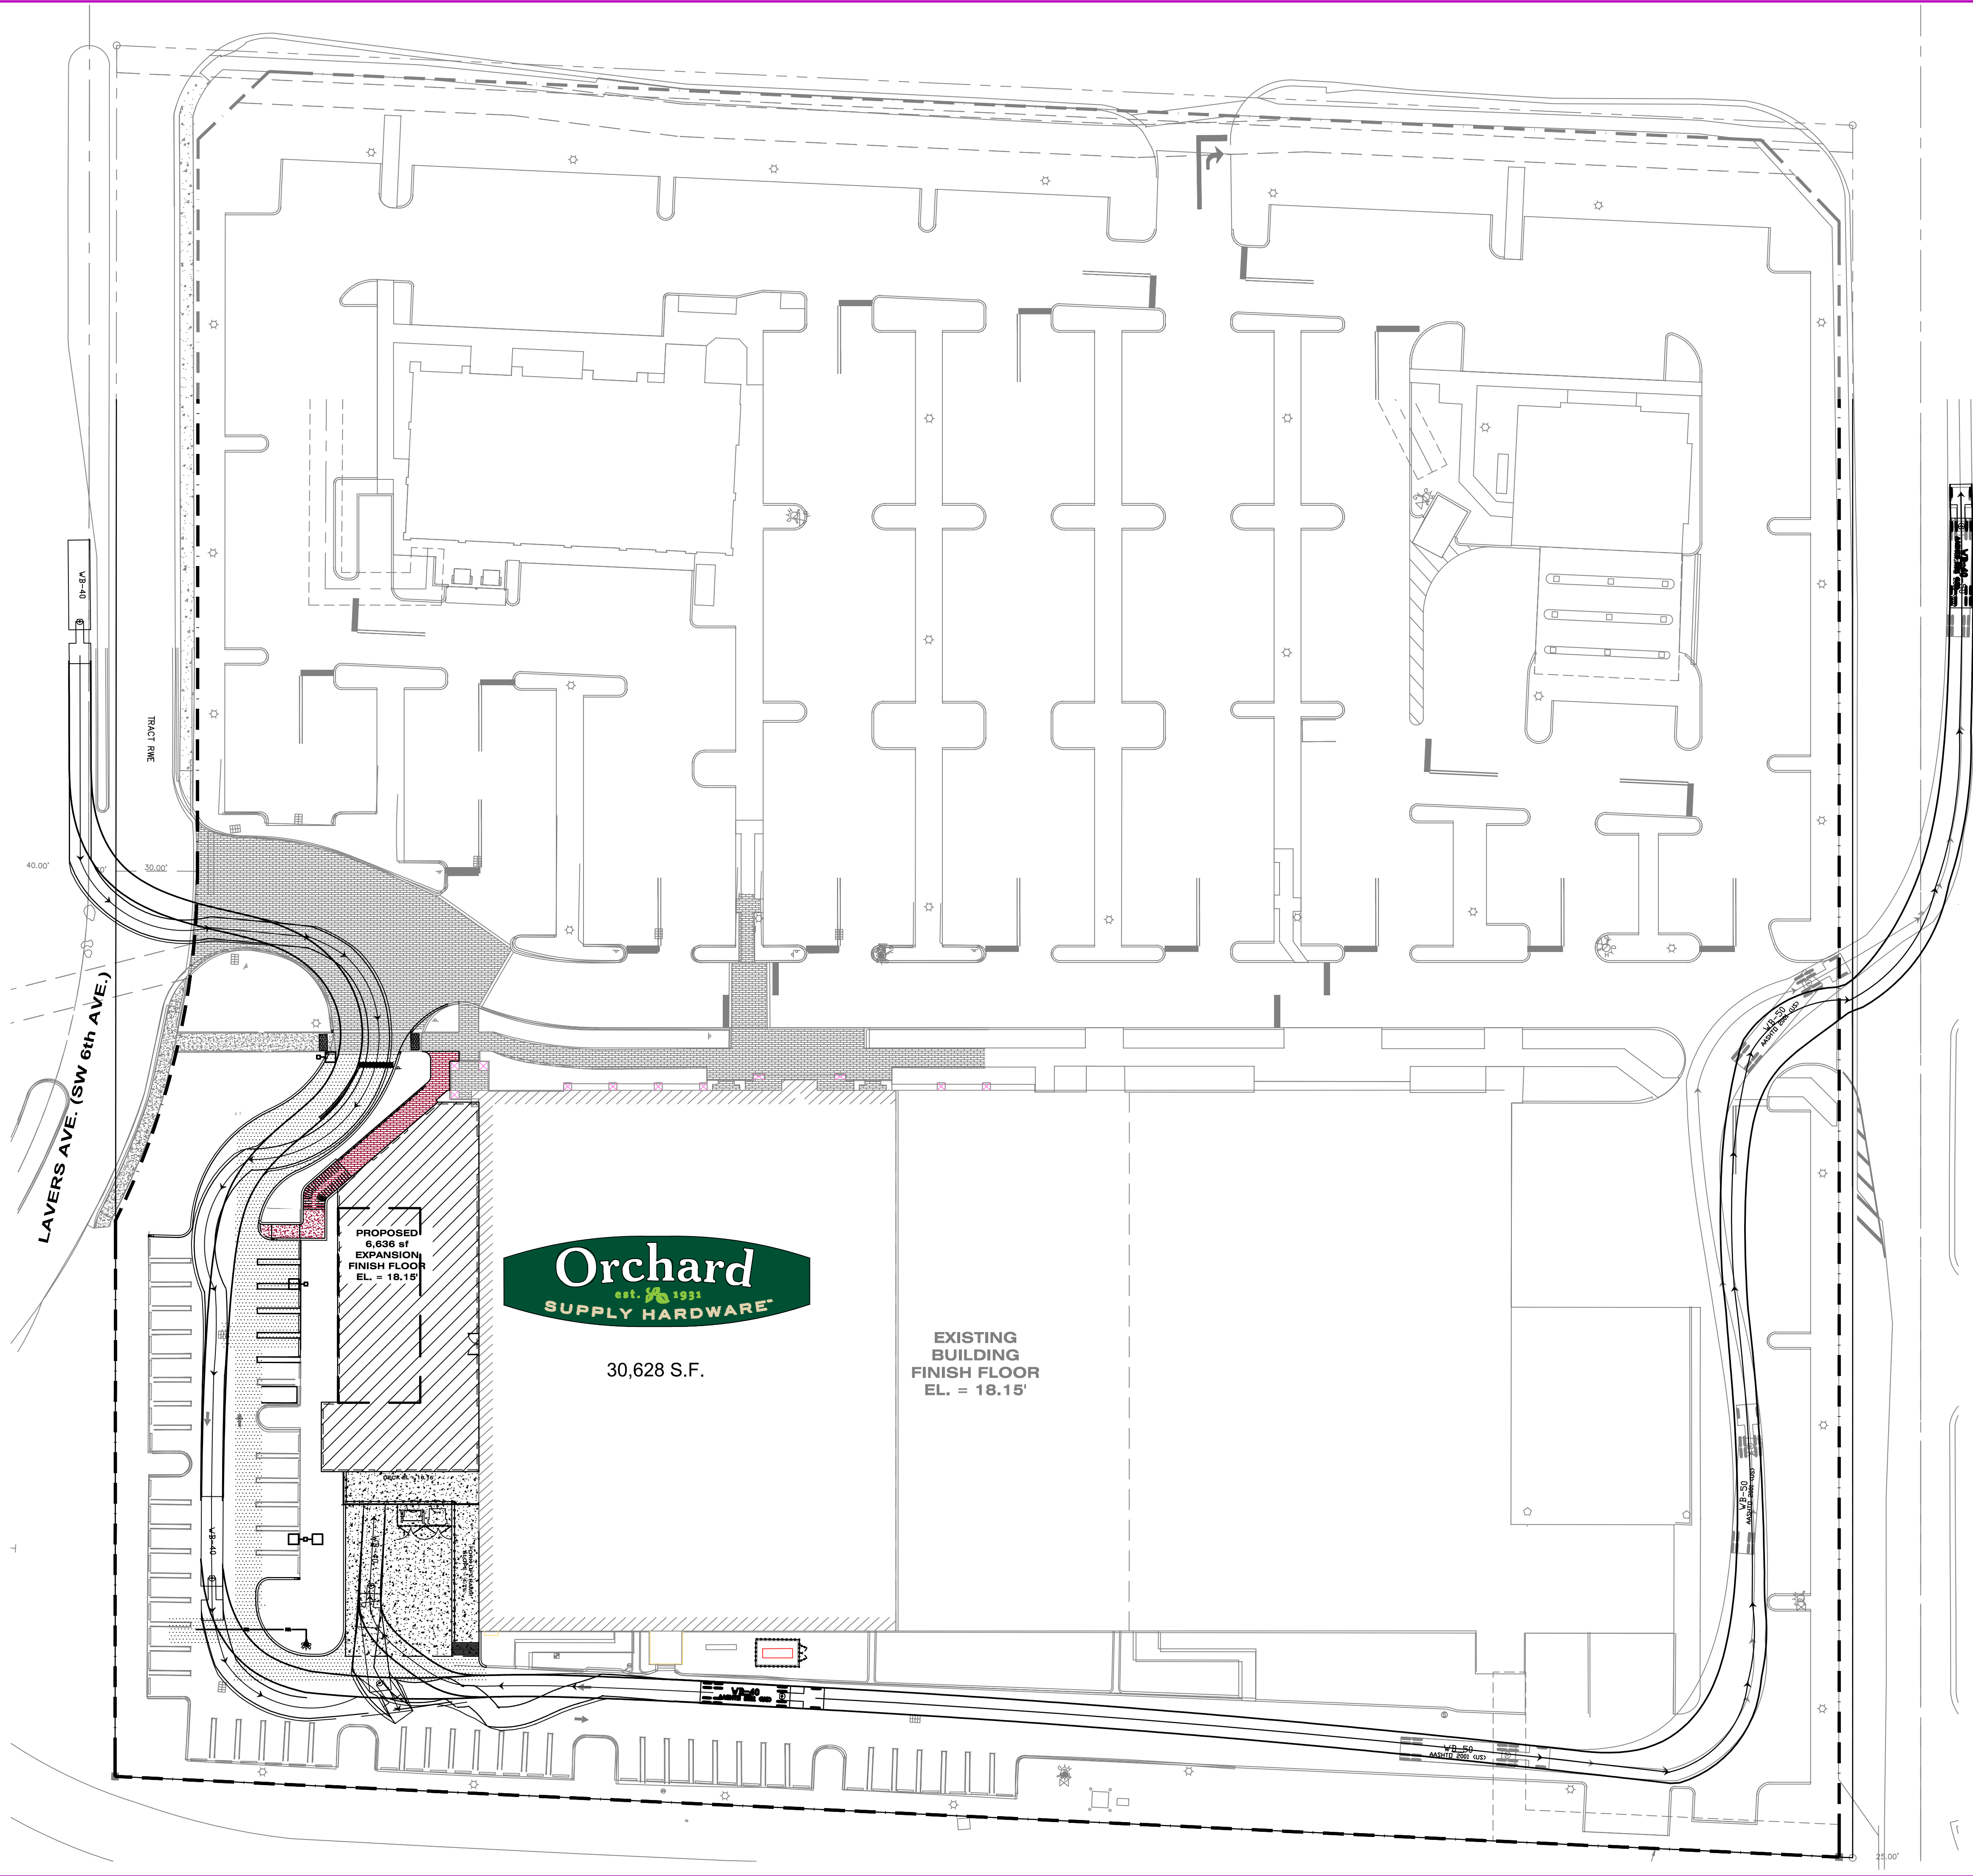

WB-40	feet		
Tractor Width	: 8.00	Lock to Lock Time	: 6.0
Trailer Width	: 8.00	Steering Angle	: 20.3
Tractor Track	: 8.00	Articulating Angle	: 70.0
Trailer Track	: 8.00		

WB-40 TRUCK PROFILE

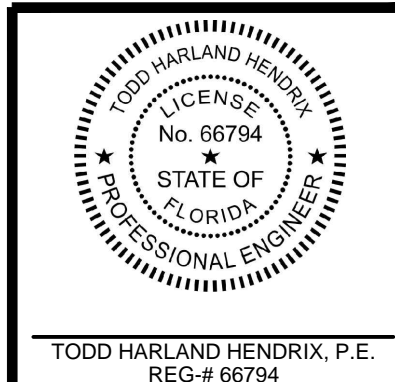

JOB No.: D11914

cph


www.cphcorp.com

A Full Service A & E Firm

Architects
Engineers
Environmental
Landscape Architects
M / E / P
Planners
Structural
Surveyors
Traffic / Transportation

Offices in:

- Florida
- Puerto Rico
- Connecticut
- Maryland
- Texas

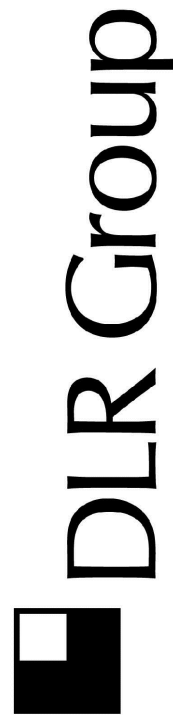

Architecture Engineering Planning Interiors

©2016, DLR Group Inc., a Florida corporation. ALL RIGHTS RESERVED

C-11

36-16121-00
Issue Date
REVISED

OVERALL SITE TRUCK ROUTE PLAN
ORCHARD SUPPLY HARDWARE - DELRAY BEACH
CITY SITE PLAN REVIEW

510 LINTON BLVD
DELRAY BEACH, FL 33483

DELRAY BEACH



LIGHTING FIXTURE SCHEDULE		
LIGHTING FIXTURE CATALOG NUMBERS ARE SERIES TYPE ONLY. PROVIDE TRIMS, BALLASTS, MOUNTING EQUIPMENT, FITTINGS AND LAMP AS REQUIRED BY THE SPECIFICATIONS AND PROJECT CONDITIONS FOR A COMPLETE INSTALLATION. THIS IS NOT A STANDALONE SCHEDULE AND FIXTURES MUST INCORPORATE ALL WORK INDICATED OR IMPLIED THROUGHOUT THROUGHOUT THE DRAWINGS AND SPECIFICATIONS.		
TYPE	SYMBOL	DESCRIPTION AND MANUFACTURER
		EXISTING DOUBLE HEAD SITE LIGHTING FIXTURE WITH TYPE 5 OPTICS.
A		MOUNTING HEIGHT: 25'-0" AFG TO BOTTOM OF FIXTURE LAMP: 400W PSMH LAMPING VOLTAGE: MVOLT MANUFACTURER: EMCO: EXISTING SITE LIGHTING SUBSTITUTIONS: <input type="radio"/> OR EQUAL <input type="radio"/> SUBJECT TO REVIEW <input type="radio"/> NO EQUAL
		EXISTING SINGLE HEAD SITE LIGHTING FIXTURE WITH TYPE 3 OPTICS.
B		MOUNTING HEIGHT: 25'-0" AFG TO BOTTOM OF FIXTURE LAMP: 400W PSMH LAMPING VOLTAGE: MVOLT MANUFACTURER: EMCO: EXISTING SITE LIGHTING SUBSTITUTIONS: <input type="radio"/> OR EQUAL <input type="radio"/> SUBJECT TO REVIEW <input type="radio"/> NO EQUAL
		EXISTING SINGLE HEAD SITE LIGHTING FIXTURE WITH TYPE 5 OPTICS.
C		MOUNTING HEIGHT: 25'-0" AFG TO BOTTOM OF FIXTURE LAMP: 400W PSMH LAMPING VOLTAGE: MVOLT MANUFACTURER: EMCO: EXISTING SITE LIGHTING SUBSTITUTIONS: <input type="radio"/> OR EQUAL <input type="radio"/> SUBJECT TO REVIEW <input type="radio"/> NO EQUAL
		EXISTING DOUBLE HEAD SITE LIGHTING FIXTURE WITH TYPE 5 OPTICS.
D		MOUNTING HEIGHT: 25'-0" AFG TO BOTTOM OF FIXTURE LAMP: 400W PSMH LAMPING VOLTAGE: MVOLT MANUFACTURER: EMCO: EXISTING SITE LIGHTING SUBSTITUTIONS: <input type="radio"/> OR EQUAL <input type="radio"/> SUBJECT TO REVIEW <input type="radio"/> NO EQUAL
X2		EXTERIOR RATED EMERGENCY LIGHTING UNIT POWERED FROM INTERIOR EXIT SIGN. COLOR BY ARCHITECT. MOUNTING HEIGHT: ABOVE DOOR LAMP: INCLUDED (LED) VOLTAGE: MVOLT MANUFACTURER: LITHONIA: ELA LED WP M12 SUBSTITUTIONS: <input type="radio"/> OR EQUAL <input type="radio"/> SUBJECT TO REVIEW <input type="radio"/> NO EQUAL
X6		EXTERIOR RATED EMERGENCY LIGHTING UNIT POWERED FROM INTERIOR EXIT SIGN. COLOR BY ARCHITECT. MOUNTING HEIGHT: ABOVE DOOR LAMP: INCLUDED (LED) VOLTAGE: MVOLT MANUFACTURER: BEGHILL: SEA 1 6V LED5W SUBSTITUTIONS: <input type="radio"/> OR EQUAL <input type="radio"/> SUBJECT TO REVIEW <input type="radio"/> NO EQUAL


SHEET NOTES	
1	EXISTING SITE LIGHTING SHALL HAVE (1) HEAD REMOVED AND THE WIRING CAPPED OFF. PROVIDE BLANK PLATE COVER FOR SIDE OF POLE WHERE THE LIGHT FIXTURE WAS REMOVED.

SITE LIGHTING PHOTOMETRIC VALUES			
AREA DESCRIPTION	AVERAGE FOOT-CANDLE	MAXIMUM FOOT-CANDLE	MINIMUM FOOT-CANDLE
PARKING LOT AREA	1.3 FC	3.5 FC	0.2 FC

BACKGROUND UPDATED
ADDED EXTERIOR EGRESS LIGHTING
PER FIRE DEPARTMENT COMMENTS

A	EXISTING SITE LIGHTING PHOTOMETRIC
E1.1	SCALE: 1" = 20'-0"

LAVER'S NORTH

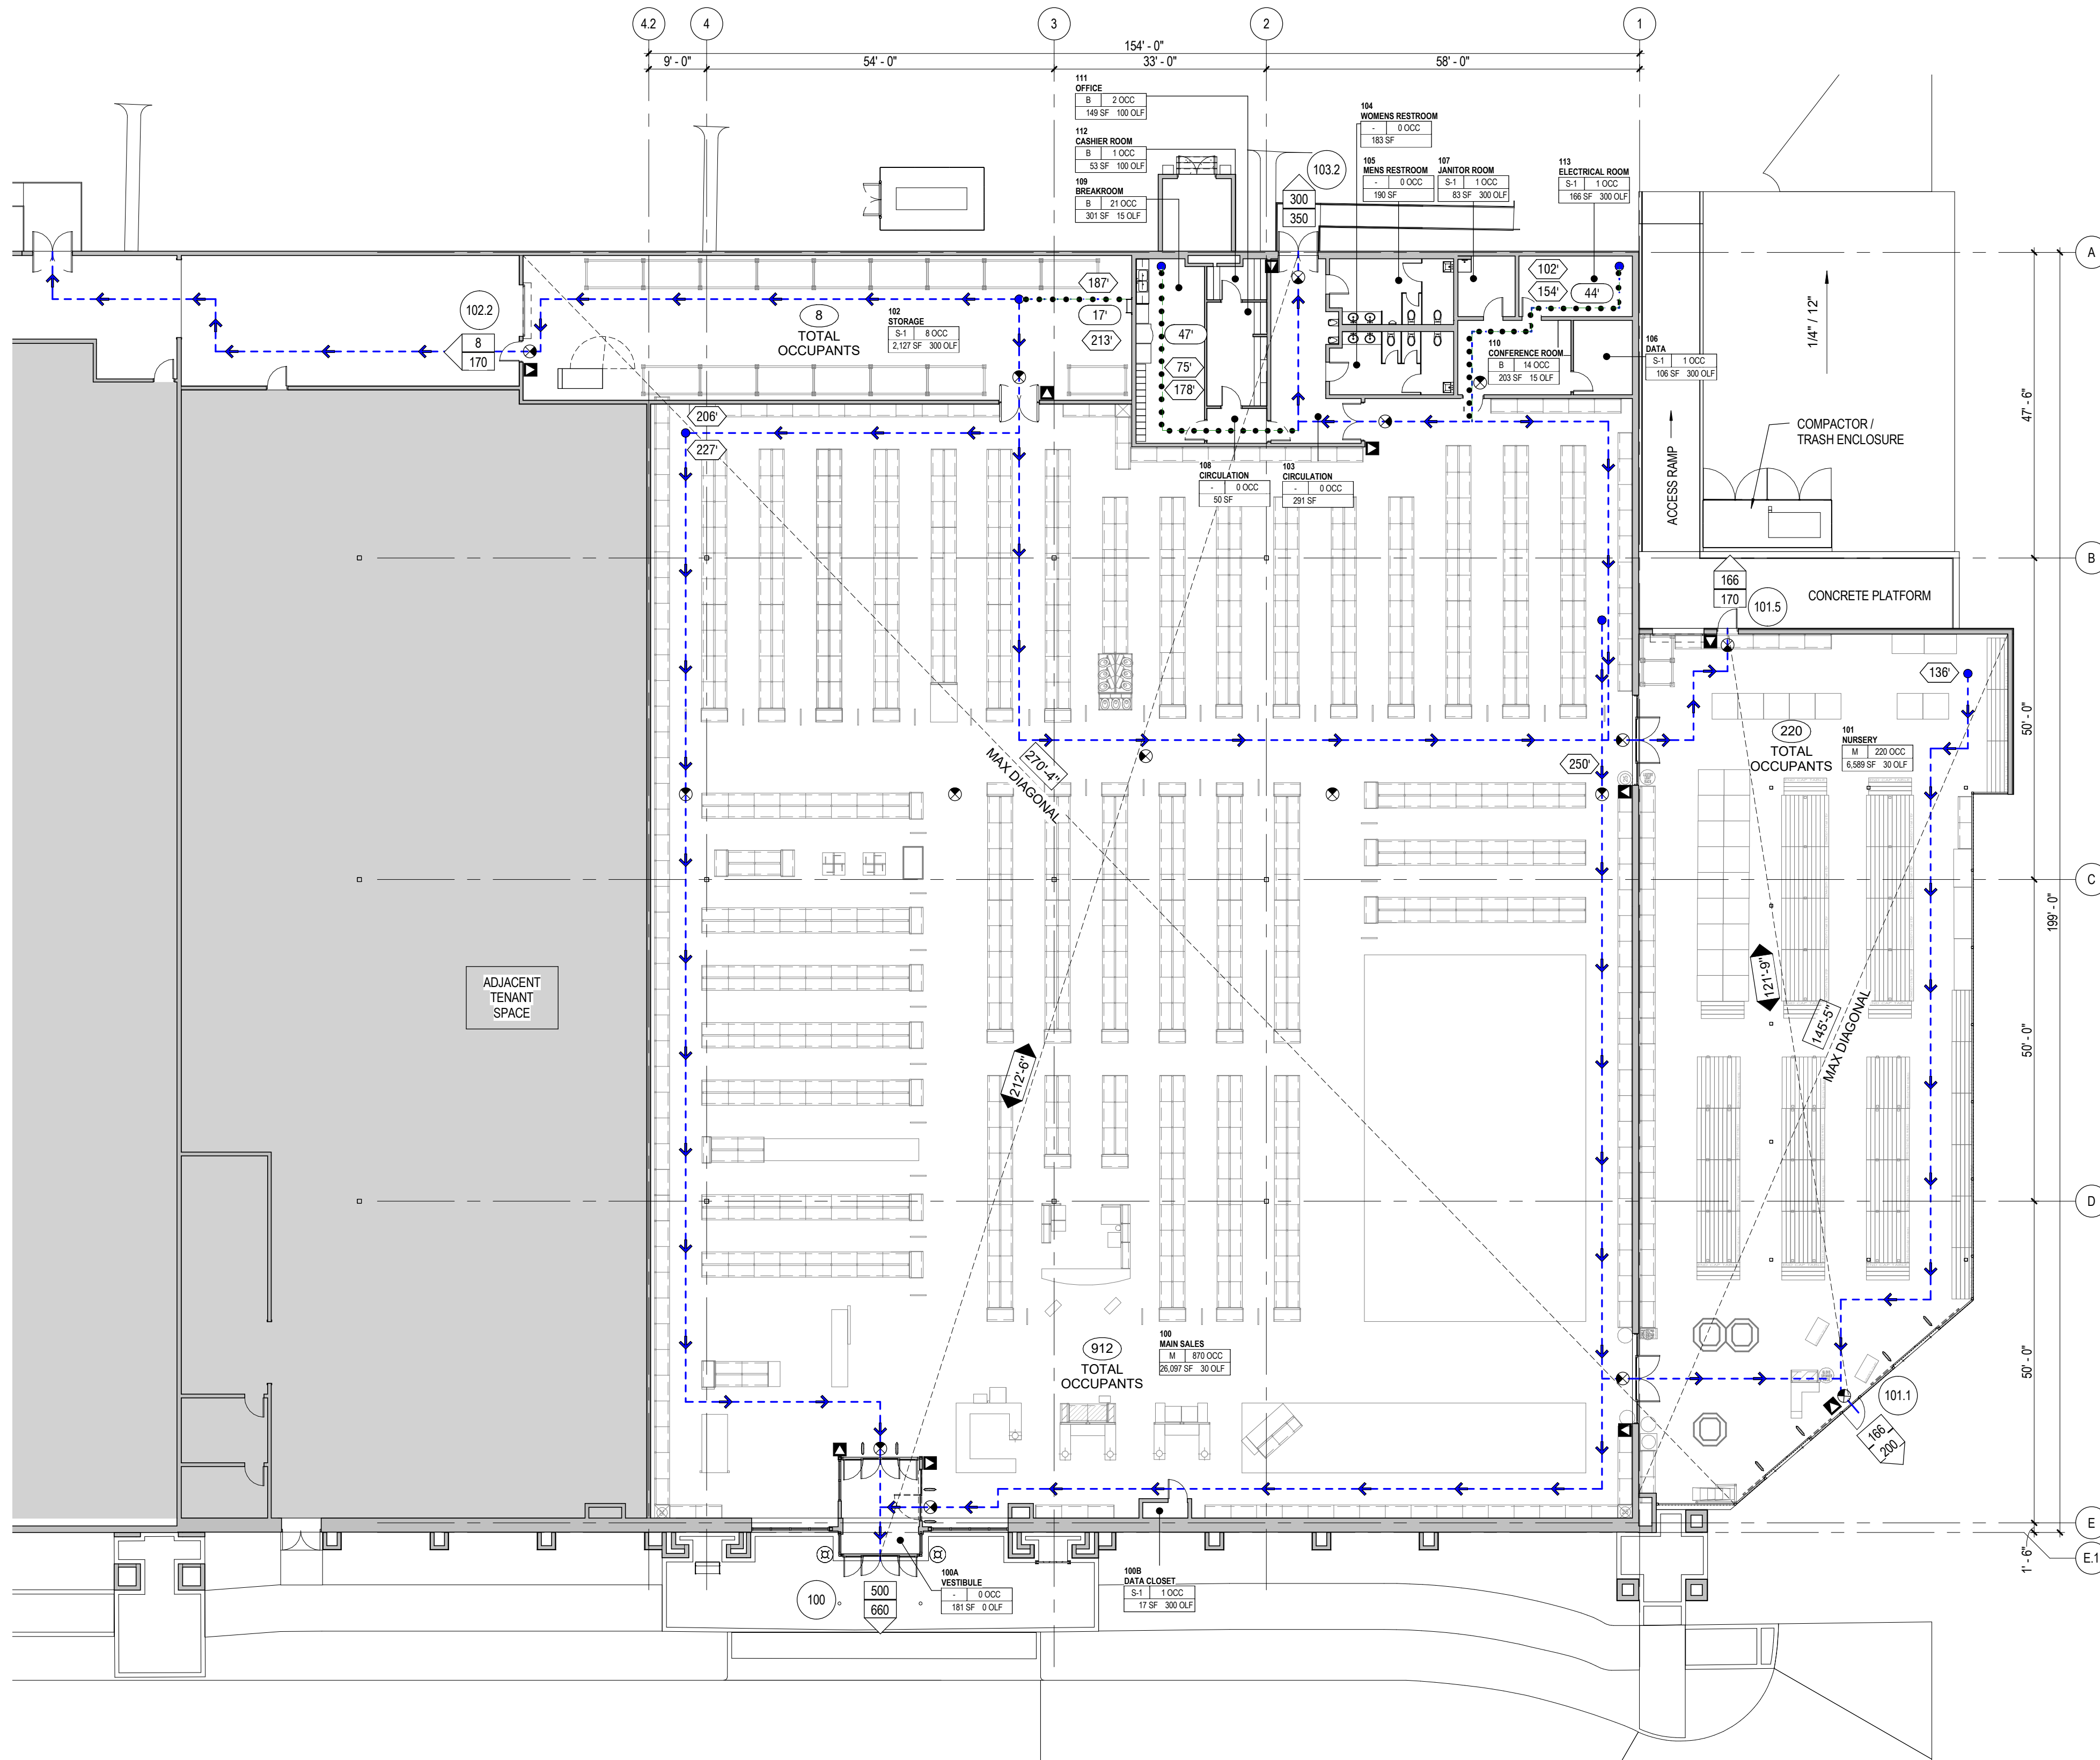

FLOOR PLAN
SCALE: 1/16" = 1'-0"
NORTH

OCCUPANCY SCHEDULE

NO	ROOM NAME	USE	OCCUPANCY	AREA	OLF	OCC
100	MAIN SALES	MERCANTILE (BASEMENT AND GRADE FLOOR AREA)	M	26,097 SF	30 SF	870
100A	VESTIBULE	(none)	-	181 SF		
100B	DATA CLOSET	MERCANTILE (STORAGE, STOCK AND SHIPPING AREA)	S-1	17 SF	300 SF	1
101	NURSERY	MERCANTILE (BASEMENT AND GRADE FLOOR AREA)	M	6,589 SF	30 SF	220
102	STORAGE	MERCANTILE (STORAGE, STOCK AND SHIPPING AREA)	S-1	2,127 SF	300 SF	8
103	CIRCULATION	(none)	-	291 SF		
104	WOMENS RESTROOM	(none)	-	183 SF		
105	MENS RESTROOM	(none)	-	190 SF		
106	DATA	ACCESSORY STORAGE / MECH EQUIPMENT ROOM	S-1	106 SF	300 SF	1
107	JANITOR ROOM	MERCANTILE (STORAGE, STOCK AND SHIPPING AREA)	S-1	83 SF	300 SF	1
108	CIRCULATION	(none)	-	50 SF		
109	BREAKROOM	ASSEMBLY TWO FIXED SEATS - UNCONCENTRATED	B	301 SF	15 SF	21
110	CONFERENCE ROOM	ASSEMBLY TWO FIXED SEATS - UNCONCENTRATED	B	203 SF	15 SF	14
111	OFFICE	BUSINESS AREA	B	149 SF	100 SF	2
112	CASHIER ROOM	BUSINESS AREA	B	53 SF	100 SF	1
113	ELECTRICAL ROOM	ACCESSORY STORAGE / MECH EQUIPMENT ROOM	S-1	166 SF	300 SF	1

OCCUPANCY SCHEDULE BY USE

UNUN	ROOM NAME	USE	OCCUPANCY	AREA	OLF	OCC
100A	VESTIBULE	(none)	-	181 SF		
103	CIRCULATION	(none)	-	291 SF		
104	WOMENS RESTROOM	(none)	-	183 SF		
105	MENS RESTROOM	(none)	-	190 SF		
108	CIRCULATION	(none)	-	50 SF		

109	BREAKROOM	ASSEMBLY TWO FIXED SEATS - UNCONCENTRATED	B	301 SF	15 SF	21
110	CONFERENCE ROOM	ASSEMBLY TWO FIXED SEATS - UNCONCENTRATED	B	203 SF	15 SF	14
111	OFFICE	BUSINESS AREA	B	149 SF	100 SF	2
112	CASHIER ROOM	BUSINESS AREA	B	53 SF	100 SF	1

100	MAIN SALES	MERCANTILE (BASEMENT AND GRADE FLOOR AREA)	M	26,097 SF	30 SF	870
101	NURSERY	MERCANTILE (BASEMENT AND GRADE FLOOR AREA)	M	6,589 SF	30 SF	220

100B	DATA CLOSET	MERCANTILE (STORAGE, STOCK AND SHIPPING AREA)	S-1	17 SF	300 SF	1
102	STORAGE	MERCANTILE (STORAGE, STOCK AND SHIPPING AREA)	S-1	2,127 SF	300 SF	8
106	DATA	ACCESSORY STORAGE / MECH EQUIPMENT ROOM	S-1	106 SF	300 SF	1
107	JANITOR ROOM	MERCANTILE (STORAGE, STOCK AND SHIPPING AREA)	S-1	83 SF	300 SF	1
113	ELECTRICAL ROOM	ACCESSORY STORAGE / MECH EQUIPMENT ROOM	S-1	166 SF	300 SF	1

PLUMBING FIXTURE REQUIREMENTS

MINIMUM NUMBER OF REQUIRED PLUMBING FIXTURES (TABLE 403.1)
*SEE A2.1 FOR ENLARGED RESTROOM PLAN, SEE 0.4 FOR NUMBER OF OCCUPANTS

	DESCRIPTION	OCC	# OF OCC	WATER CLOSETS		LAVATORIES		BATHTUB / SHOWERS	DRINKING FOUNTAIN	OTHER
				MALE	FEMALE	MALE	FEMALE			
REQUIRED	RETAIL STORE	M	570	1 PER 500		1 PER 750			1 PER 1000	
PROVIDED	RETAIL STORE	M	570	2	3	1	2	-	1	SERVICE SINK


EXIT ANALYSIS

NOTE: SEE PLANS THIS SHEET FOR OCCUPANT LOAD/CAPACITY

SALES / SUPPORT AREA (912 OCCUPANTS)
3 EXITS REQUIRED
4 EXITS PROVIDED (OCCUPANT CAPACITY)
DOOR 100: 132' / 0.2 = 660 OCCUPANT CAPACITY
DOOR 103: 70' / 0.2 = 350 OCCUPANT CAPACITY
DOOR 101: 140' / 0.2 = 700 OCCUPANT CAPACITY
DOOR 101.5: 34' / 0.2 = 170 OCCUPANT CAPACITY

NURSERY AREA (220 OCCUPANTS)
2 EXIT REQUIRED
2 EXIT PROVIDED (OCCUPANT CAPACITY)
DOOR 101: 140' / 0.2 = 700 OCCUPANT CAPACITY
DOOR 101.5: 34' / 0.2 = 170 OCCUPANT CAPACITY

STORAGE / RECEIVING AREA (8 OCCUPANTS)
1 EXIT REQUIRED
2 EXIT PROVIDED (OCCUPANT CAPACITY)
DOOR 102: 34' / 0.2 = 170 OCCUPANT CAPACITY
DOOR 101.5: 34' / 0.2 = 170 OCCUPANT CAPACITY

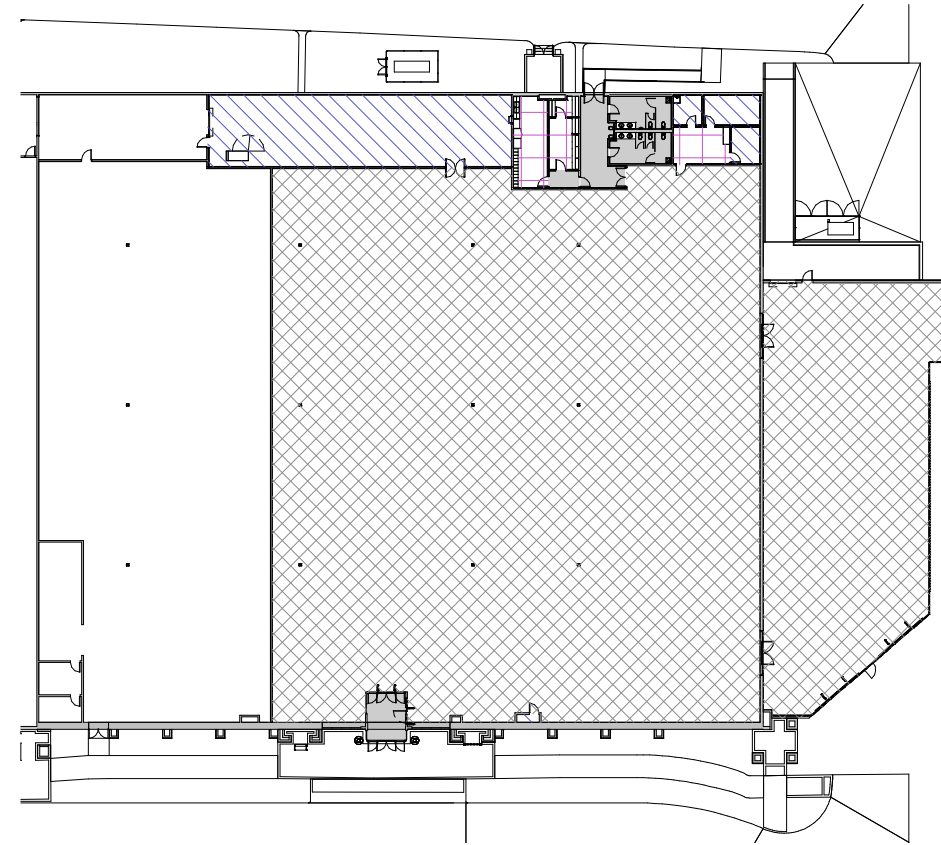

CODE PLAN - FLOOR PLAN
SCALE: 1" = 60'-0"

APPLICABLE CODES

APPLICABLE CODES
BUILDING CODE: FLORIDA BUILDING CODE 5TH EDITION (2014)
FIRE CODE: FLORIDA FIRE PREVENTION CODE 5TH EDITION
FLORIDA SPECIFIC NFPA 1 12TH EDITION AND FLORIDA
SPECIFIC NFPA 101 LIFE SAFETY CODE, 12TH EDITION
ACCESSIBILITY: FLORIDA BUILDING CODE 5TH EDITION (2014) ACCESSIBILITY
EXISTING BUILDING: FLORIDA BUILDING CODE 5TH EDITION (2014) EXISTING BUILDING
ENERGY: FLORIDA BUILDING CODE 5TH EDITION (2014) ENERGY CONSERVATION
MECHANICAL: FLORIDA BUILDING CODE 5TH EDITION (2014) MECHANICAL
PLUMBING: FLORIDA BUILDING CODE 5TH EDITION (2014) PLUMBING
ELECTRICAL: 2011 NATIONAL ELECTRIC CODE

LEGEND NOTES

LEGEND NOTES ARE COMMON TO ALL
SOME NOTES MAY NOT APPLY TO THIS SHEET

CODE PLAN GENERAL NOTES

- THE MEANS OF EGRESS, INCLUDING THE EXIT DISCHARGE, SHALL BE ILLUMINATED AT ALL TIMES THE BUILDING SPACE SERVED BY THE MEANS OF EGRESS IS OCCUPIED. THE MEANS OF EGRESS ILLUMINATION LEVEL SHALL NOT BE LESS THAN 1 FOOT-CANDLE (1 LUX) AT THE WALKING SURFACE.
- HORIZONTAL SLIDING DOORS SHALL MEET THE REQUIREMENTS OF FBC 1008.1.4.3.
- THE MAIN EXTERIOR DOOR OR DOORS ARE PERMITTED TO BE EQUIPPED WITH KEY-OPERATED LOCKING DEVICES FROM THE EGRESS SIDE PROVIDED: THE LOCKING DEVICE IS READILY DISTINGUISHABLE AS LOCKED; A READILY VISIBLE DURABLE SIGN IS POSTED ON THE EGRESS SIDE ON OR ADJACENT TO THE DOOR STATING: "THIS DOOR TO REMAIN UNLOCKED WHEN BUILDING IS OCCUPIED." THE SIGN SHALL BE IN LETTERS 1 INCH (25 MM) HIGH ON A CONTRASTING BACKGROUND.
- EXIT SIGNS SHALL BE INTERNALLY OR EXTERNALLY ILLUMINATED AT ALL TIMES.
- THE FACE OF AN EXIT SIGN ILLUMINATED FROM AN EXTERNAL SOURCE SHALL HAVE AN INTENSITY OF NOT LESS THAN 5 FOOT-CANDLES.
- TO ENSURE CONTINUED ILLUMINATION FOR A DURATION OF NOT LESS THAN 90 MINUTES IN CASE OF PRIMARY POWER LOSS, THE SIGN ILLUMINATION MEANS SHALL BE CONNECTED TO AN EMERGENCY POWER SYSTEM PROVIDED FROM STORAGE BATTERIES.
- WHERE TWO EXITS OR EXIT ACCESS DOORWAYS ARE REQUIRED FROM ANY PORTION OF THE EXIT ACCESS, THE EXIT DOORS OR EXIT ACCESS DOORWAYS SHALL BE PLACED A DISTANCE APART EQUAL TO NOT LESS THAN ONE-THIRD OF THE LENGTH OF THE MAXIMUM OVERALL DIAGONAL DIMENSION OF THE BUILDING OR AREA TO BE SERVED MEASURED IN A STRAIGHT LINE BETWEEN EXIT DOORS OR EXIT ACCESS DOORWAYS WHERE A BUILDING IS EQUIPPED THROUGHOUT WITH AN AUTOMATIC SPRINKLER SYSTEM, WHERE ACCESS TO THREE OR MORE EXITS IS REQUIRED, AT LEAST TWO EXIT DOORS OR EXIT ACCESS DOORWAYS SHALL BE ARRANGED IN THIS MANNER.
- IN OCCUPANCIES IN GROUPS B, M, AND S, WHERE THE BUILDING IS EQUIPPED THROUGHOUT WITH AN AUTOMATIC SPRINKLER SYSTEM, THE LENGTH OF THE DEAD-END CORRIDORS SHALL NOT EXCEED 50 FEET.

SPACES WITH ONE EXIT

FBC TABLE 1015.1	
OCCUPANCY	MAXIMUM OCCUPANT LOAD
M	49
S	29

THREE OR MORE EXITS

FBC TABLE 1015 / FPPC 7.4.1.2	
OCCUPANTS	NUMBER OF EXITS
SEE "SPACES WITH ONE EXIT"	1
≥ ONE EXIT ≤ 500	2
501 < X ≤ 1000	3
≥ 1000	4

EXIT ACCESS TRAVEL DISTANCE

FBC TABLE 1016.2 / FPPC 36.2.6.2	
OCCUPANCY	WITH SPRINKLER SYSTEM (FEET)
M, S-1	250

COMMON PATH OF EGRESS TRAVEL

TABLE 1014.3	
OCCUPANCY	WITH SPRINKLER SYSTEM (FEET)
B, S	100
ALL OTHERS	75


DEAD END CORRIDOR

FBC TABLE 1014.3 / FPPC 36.3.5.2.1
IN OCCUPANCIES IN GROUPS M AND S, WHERE THE BUILDING IS EQUIPPED THROUGHOUT WITH AN AUTOMATIC SPRINKLER SYSTEM IN ACCORDANCE WITH FBC SECTION 903.3.1.1 / FPPC 9.7.1.1(1), THE LENGTH OF THE DEAD-END CORRIDORS SHALL NOT EXCEED 50 FEET.

SYMBOL LEGEND

- UNOCCUPIED SPACE
- OCCUPANCY TYPE B
- OCCUPANCY TYPE M
- OCCUPANCY TYPE S-1
- COMBINED OCCUPANT LOAD AT A GIVEN DOOR OR STAIR (THE CAPACITY OF DOORS ARE DETERMINED AS FOLLOWS: CLEAR OPENING WIDTH IN INCHES DIVIDED BY 0.2 THE CAPACITY OF STAIRS ARE DETERMINED AS FOLLOWS: WIDTH IN INCHES DIVIDED BY 0.3)
- COMBINED OCCUPANT LOAD OF FIRE AREA
- MAXIMUM DIAGONAL DISTANCE
- DISTANCE BETWEEN EXITS
- DISTANCE TO EXIT
- DISTANCE OF COMMON PATH
- (E) 1-HR EXIT ENCLOSURE
- COMMON PATH TRAVEL
- EXIT SIGN SEE E3.4
- ACCESSIBLE ROUTE
- FIRE EXTINGUISHER WITH 75' RADIUS
- WALL MOUNTED SIGNAGE


C:\Revit\36-16121-00\OSHA-CENTRAL_Tiered.rvt
2/1/2017 5:02:32 PM

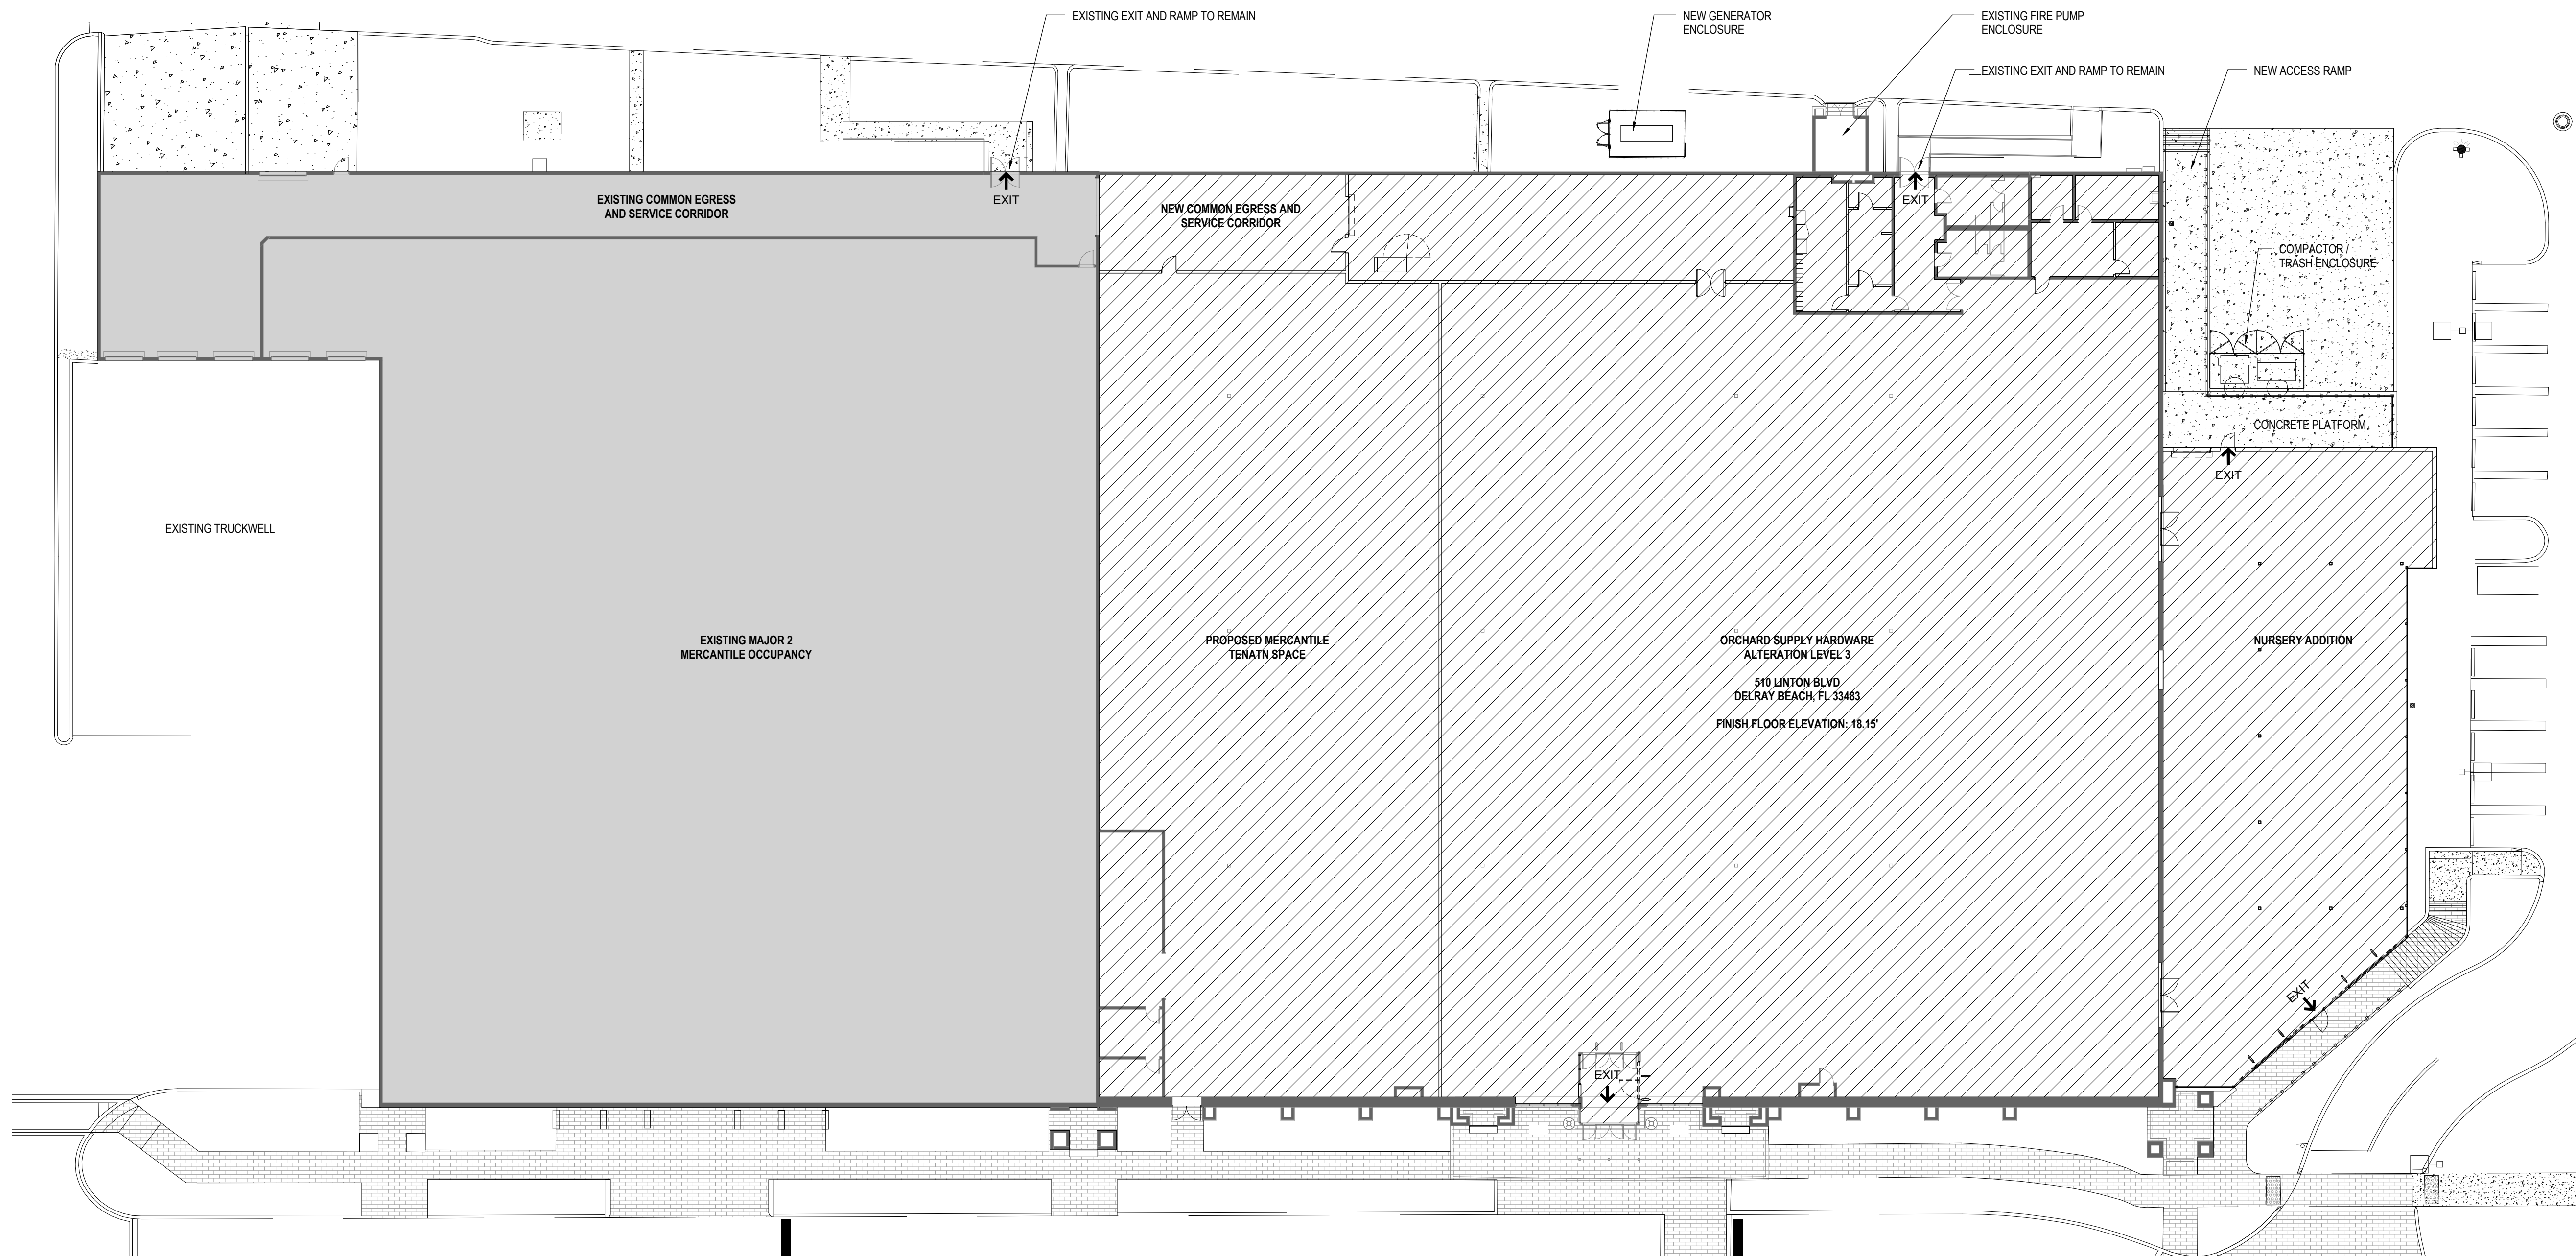

OVERALL FLOOR PLAN


SCALE: 1" = 20'-0"


C:\Revit\36-16121-00-OSHA-CENTRAL_Tiered.rvt
2/1/2017 5:02:32 PM



FLOOR PLAN

SCALE: 1/16" = 1'-0"

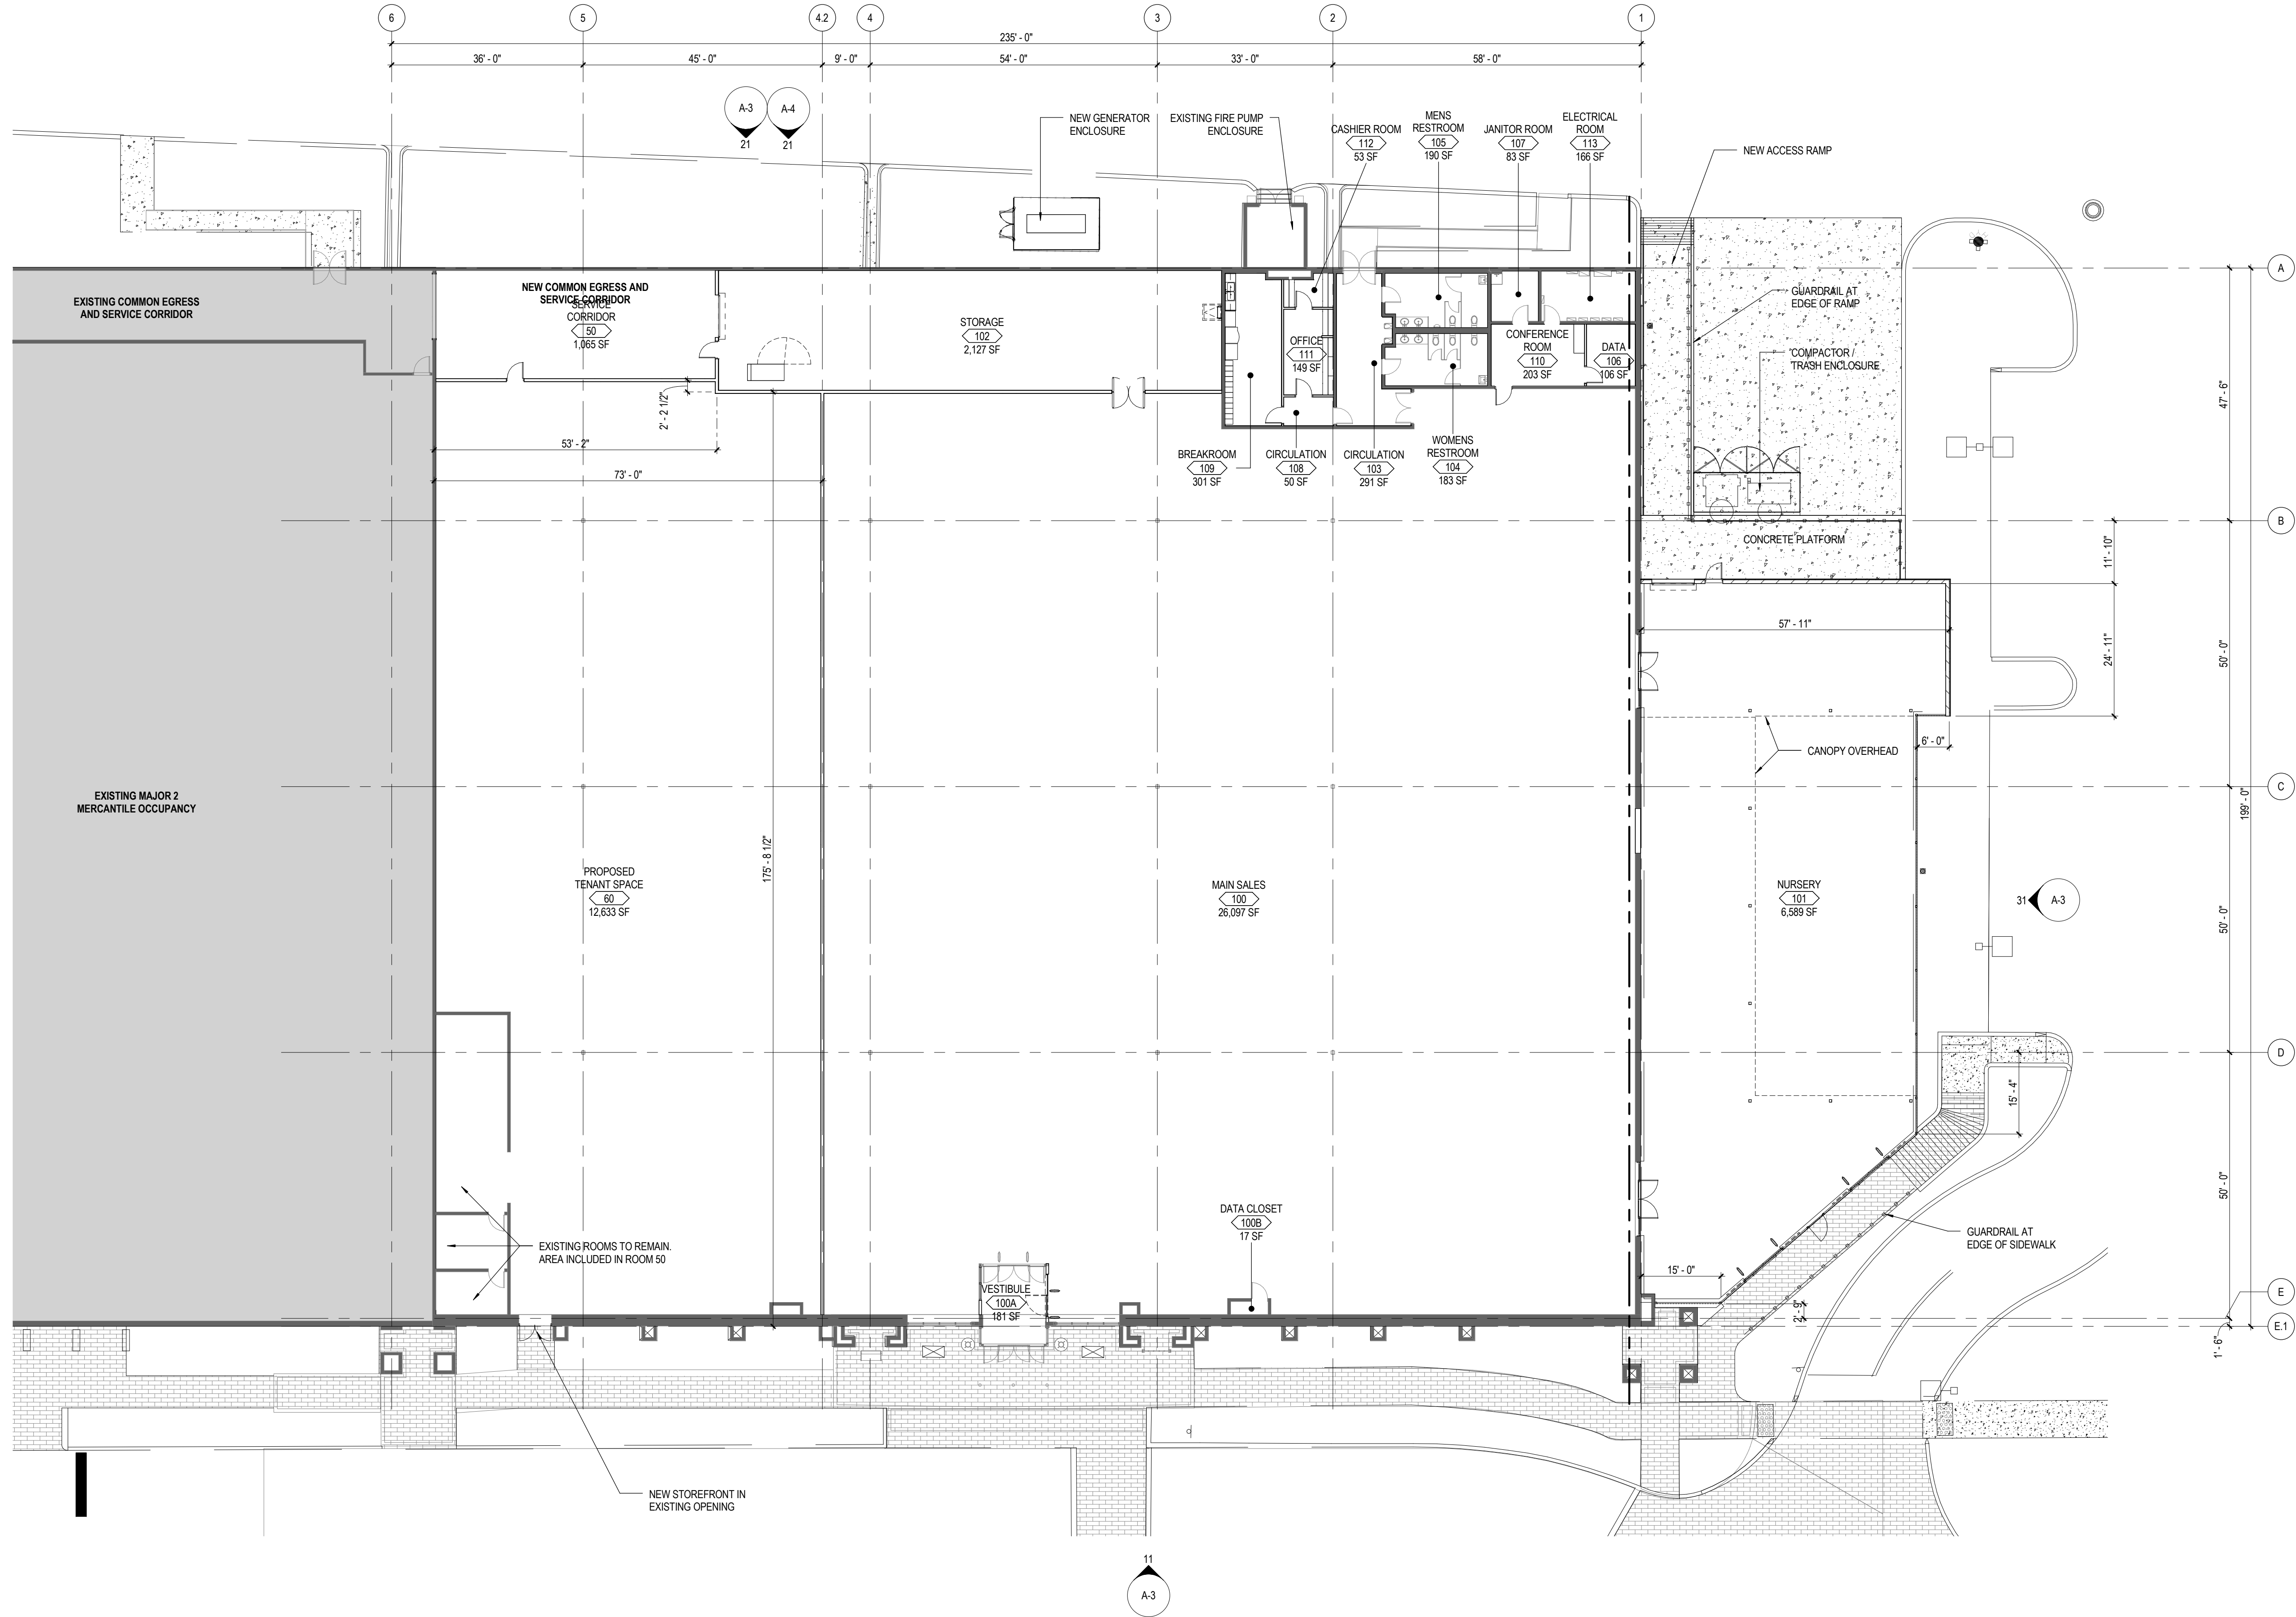

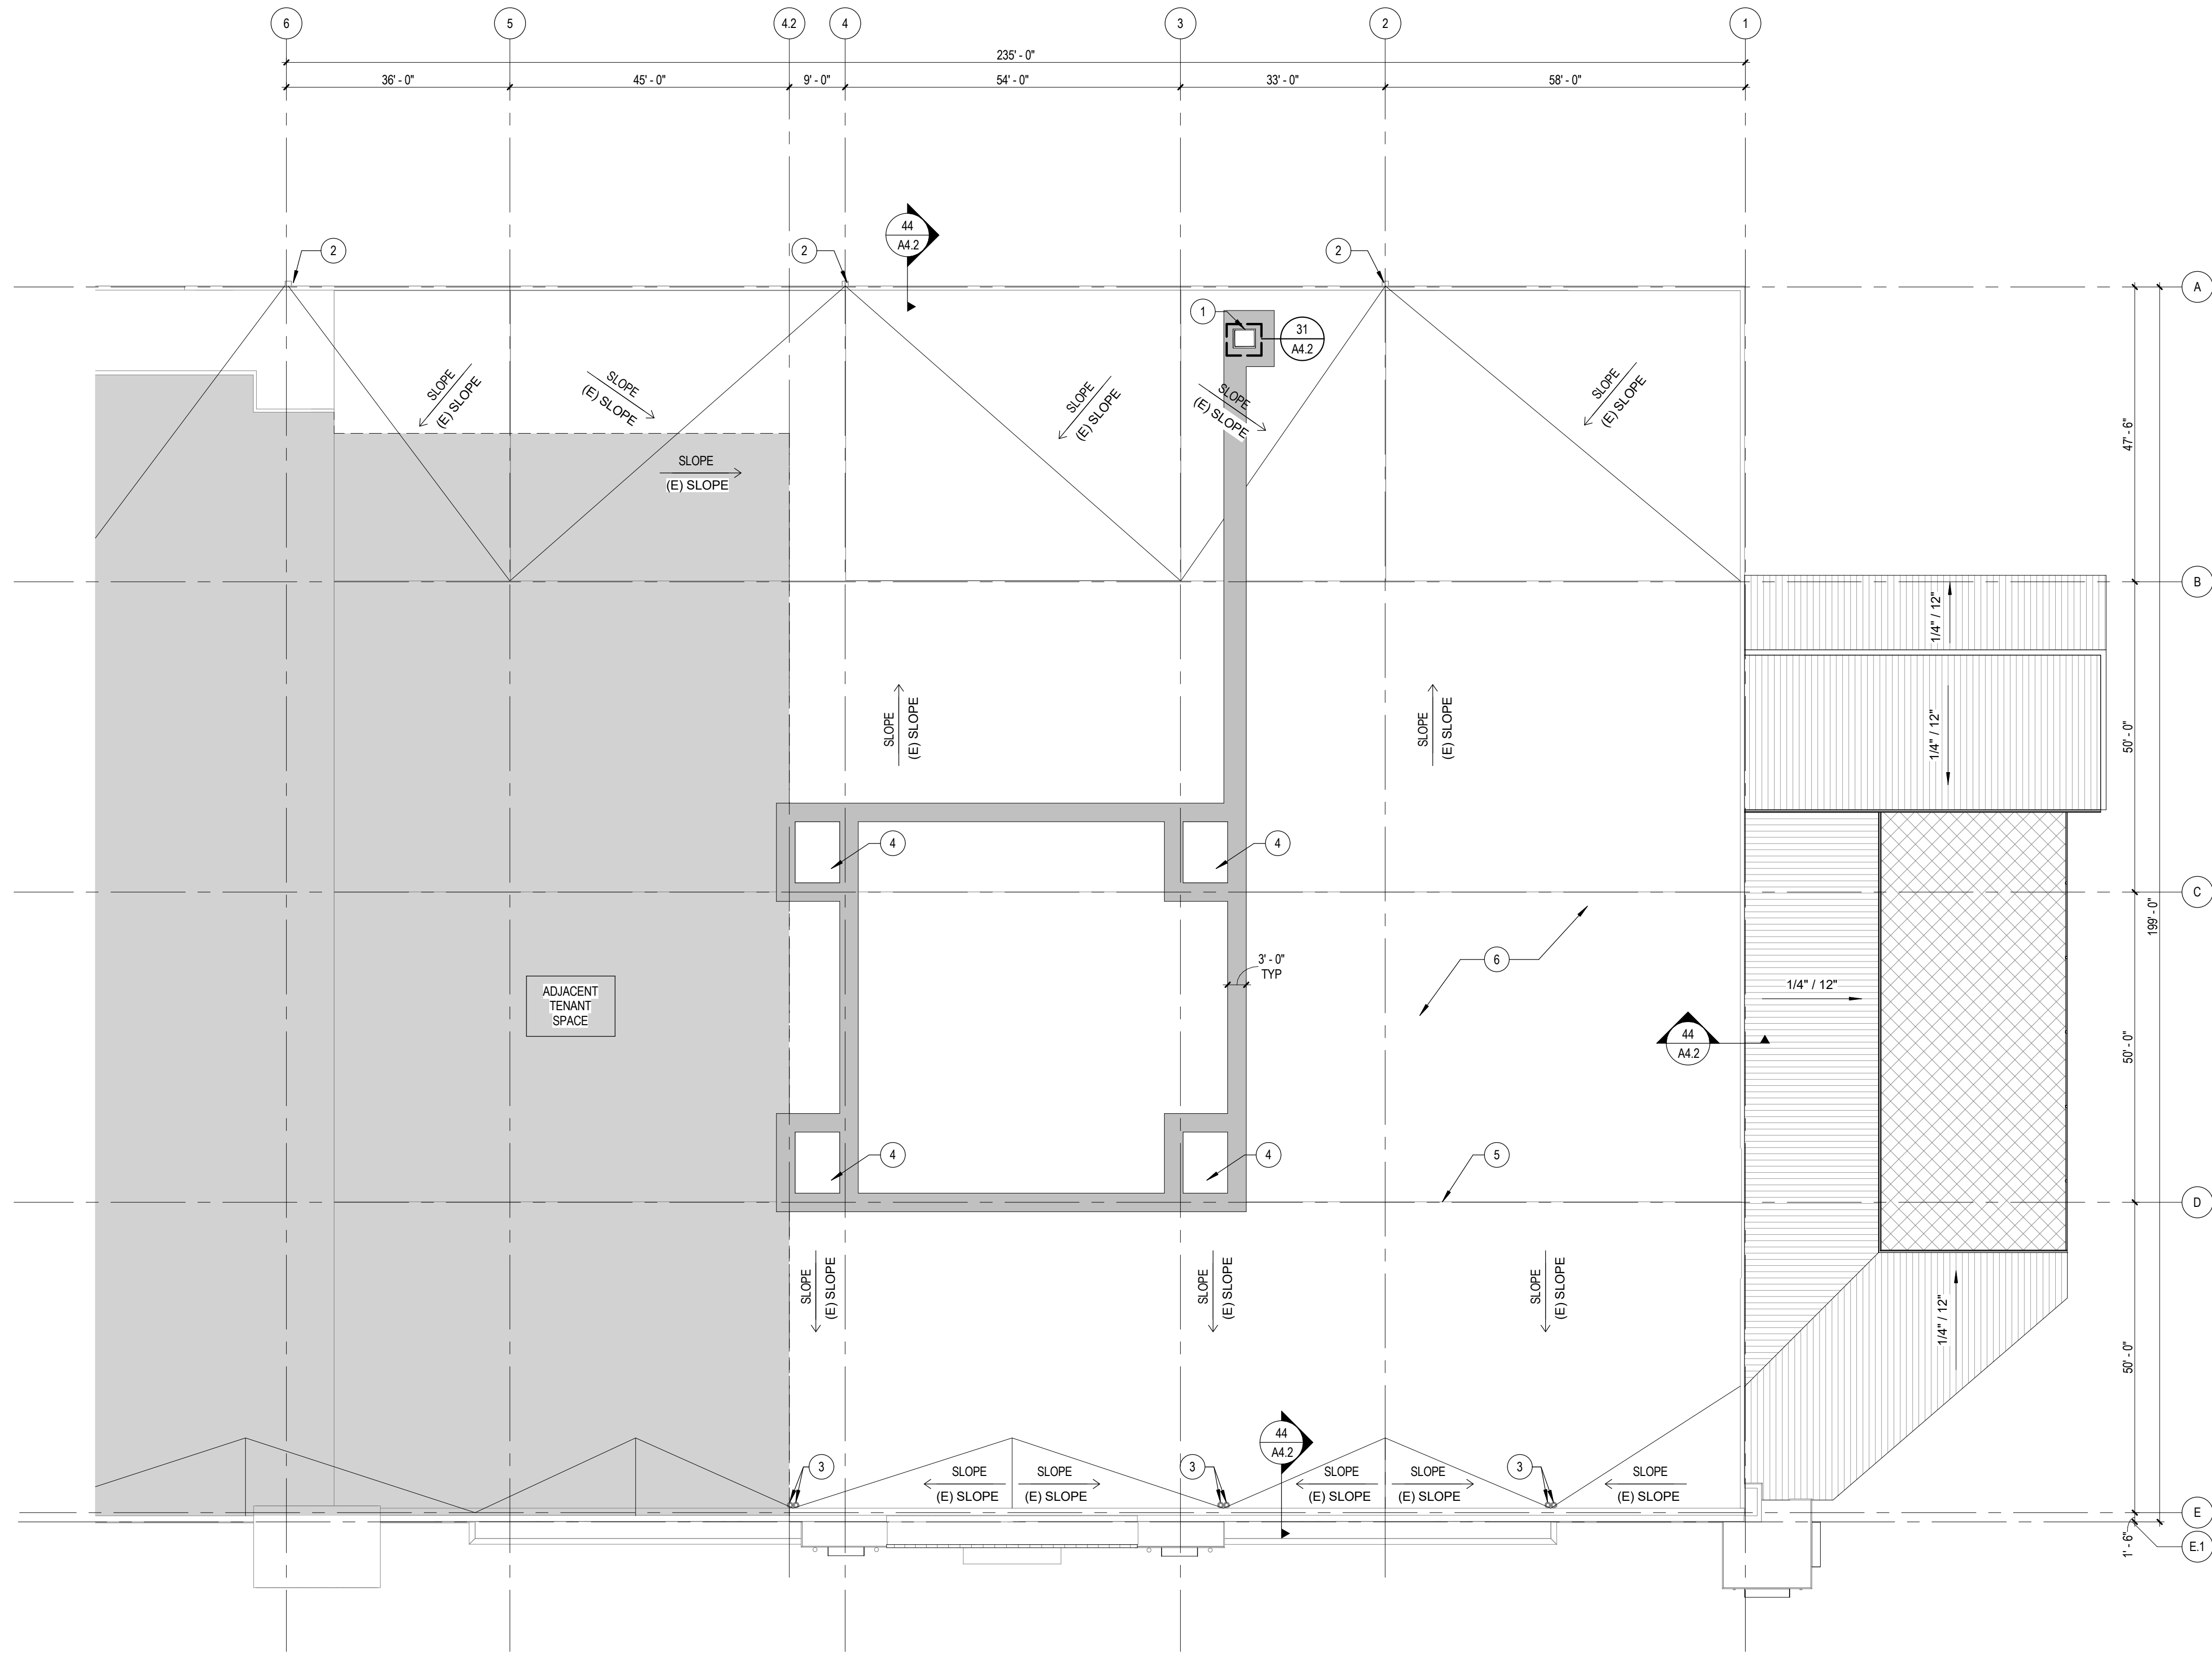

LEGEND NOTES

LEGEND NOTES ARE COMMON TO ALL
SOME NOTES MAY NOT APPLY TO THIS SHEET

ROOF PLAN GENERAL NOTES:

- ROOF PLAN NOTES APPLY TO ALL ROOF PLAN SHEETS.
- ALL ROOF CURBS TO BE A MINIMUM OF 8" ABOVE ROOFING LEVELS. PROVIDE TAPERED INSULATION ROOF SADDLES AT ROOF CURBS TO PROVIDE APPROPRIATE DRAINAGE.
- SEE STRUCTURAL FOR FRAMING AROUND ROOF PENETRATIONS.
- COORDINATE THE SIZE AND LOCATION OF ROOF PENETRATIONS FOR MECHANICAL AND ELECTRICAL EQUIPMENT. REFER TO MECHANICAL AND ELECTRICAL DRAWINGS FOR PENETRATIONS NOT SHOWN ON THIS SHEET.
- FLASH DRAINS, CURBS, VENTS AND STACKS PER MANUFACTURER'S RECOMMENDATIONS IF DETAIL NOT SHOWN ON PLANS.








FLOOR PLAN KEYNOTES

NOT ALL ARE USED


(NO)

- (E) 30' X 36' ROOF HATCH. ADD SAFETY RAILING AT ROOF HATCH. SEE SPECIFICATION 077200
- (E) 8'X6' GALVANIZED SHEET METAL DOWNSPOUT TYPICAL
- (E) 6'X6' ROOF DRAINS TYPICAL
- (E) ROOF TOP MECHANICAL EQUIPMENT WITH 3" SACRIFICIAL WALKWAY PAD. LOCATED AT APPROXIMATE LOCATION TO PROVIDE PENETRATIONS TO AVOID STRUCTURE
- (E) RIDGE AT 29'-0"
- (E) ROOF TO REMAIN


ROOF LEGEND

- | | |
|---|----------------------------------|
|  | ROOF CHANGE IN ELEVATION |
|  | ROOF INDICATOR |
|  | GALVANIZED CORRUGATED METAL ROOF |
|  | RETRACTABLE SHADE CLOTH |
|  | (E) SLOPED ROOF |
|  | GUTTER |
|  | ROOF DRAIN |


C:\revit\36-16121-00\OSHA-CENTRAL_11terico.rvt
2/2/2017 4:03:32 PM

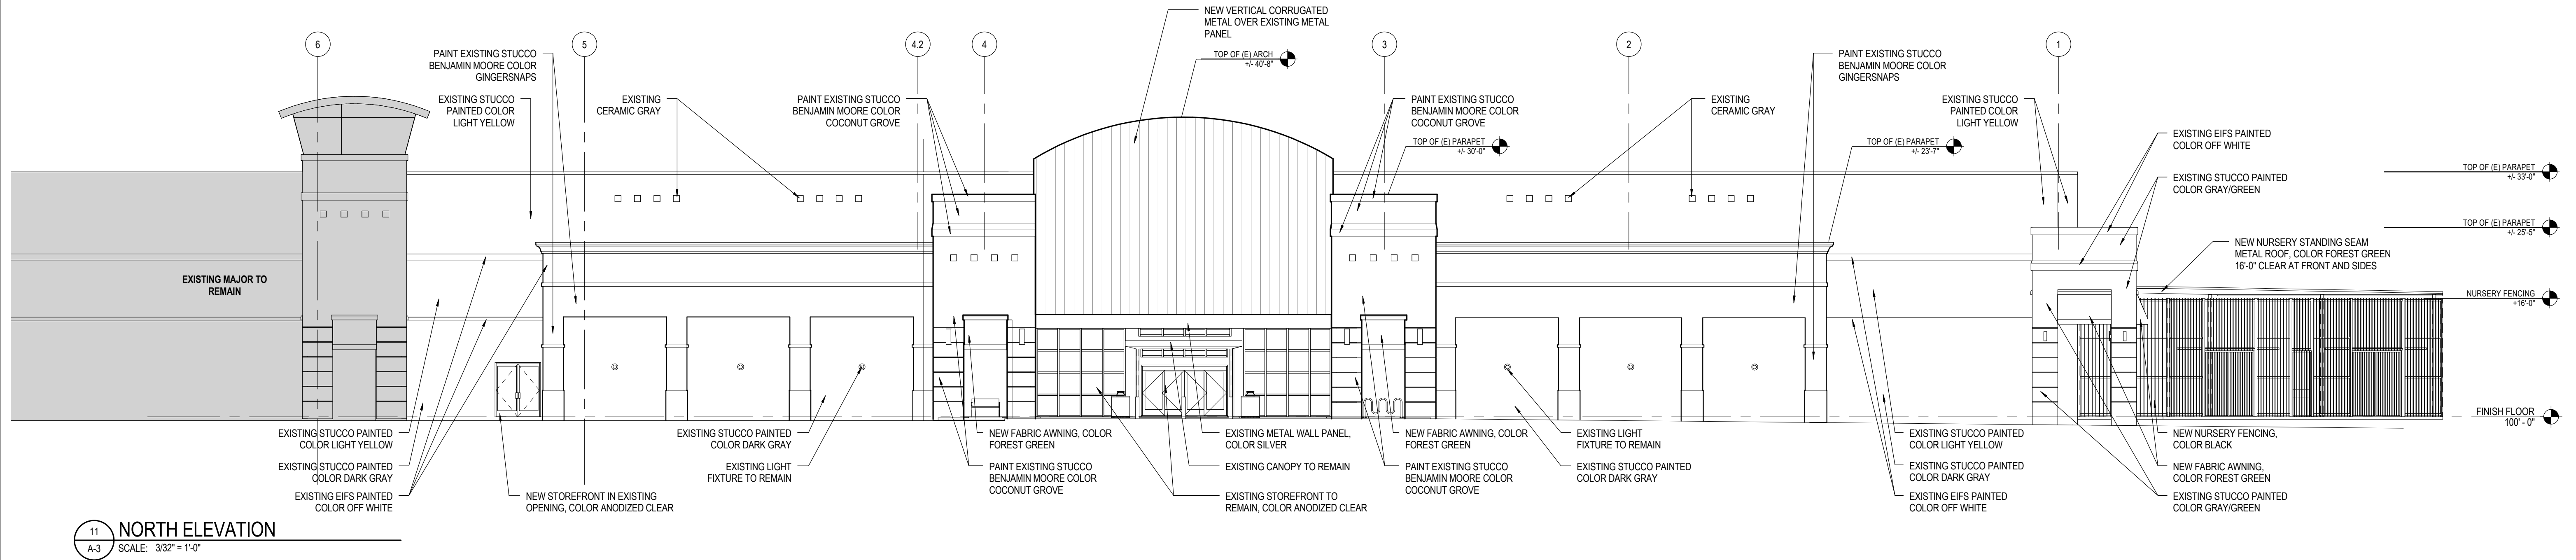

11 NORTH ELEVATION
SCALE: 3/32" = 1'-0"

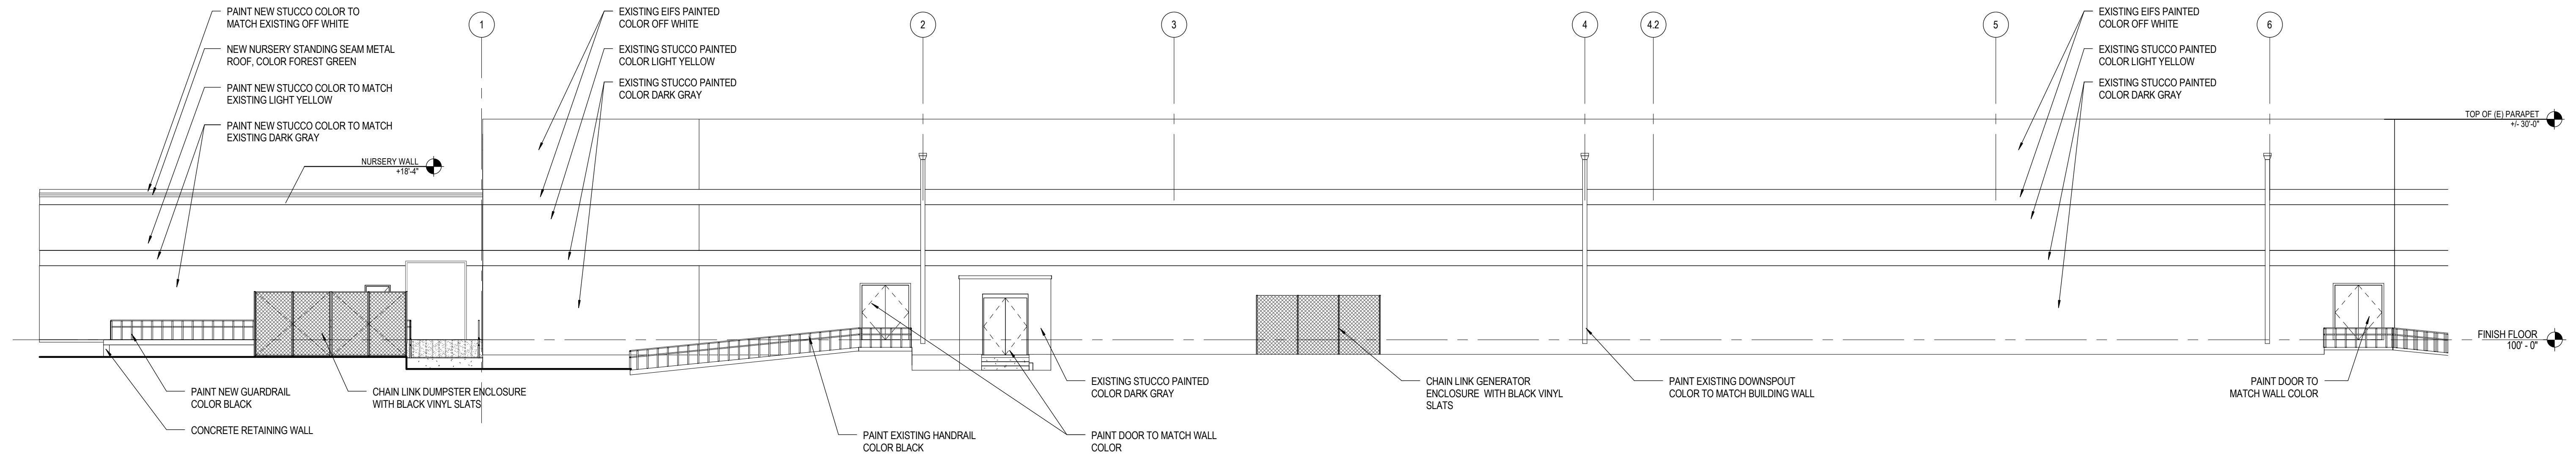

21 SOUTH ELEVATION
SCALE: 3/32" = 1'-0"

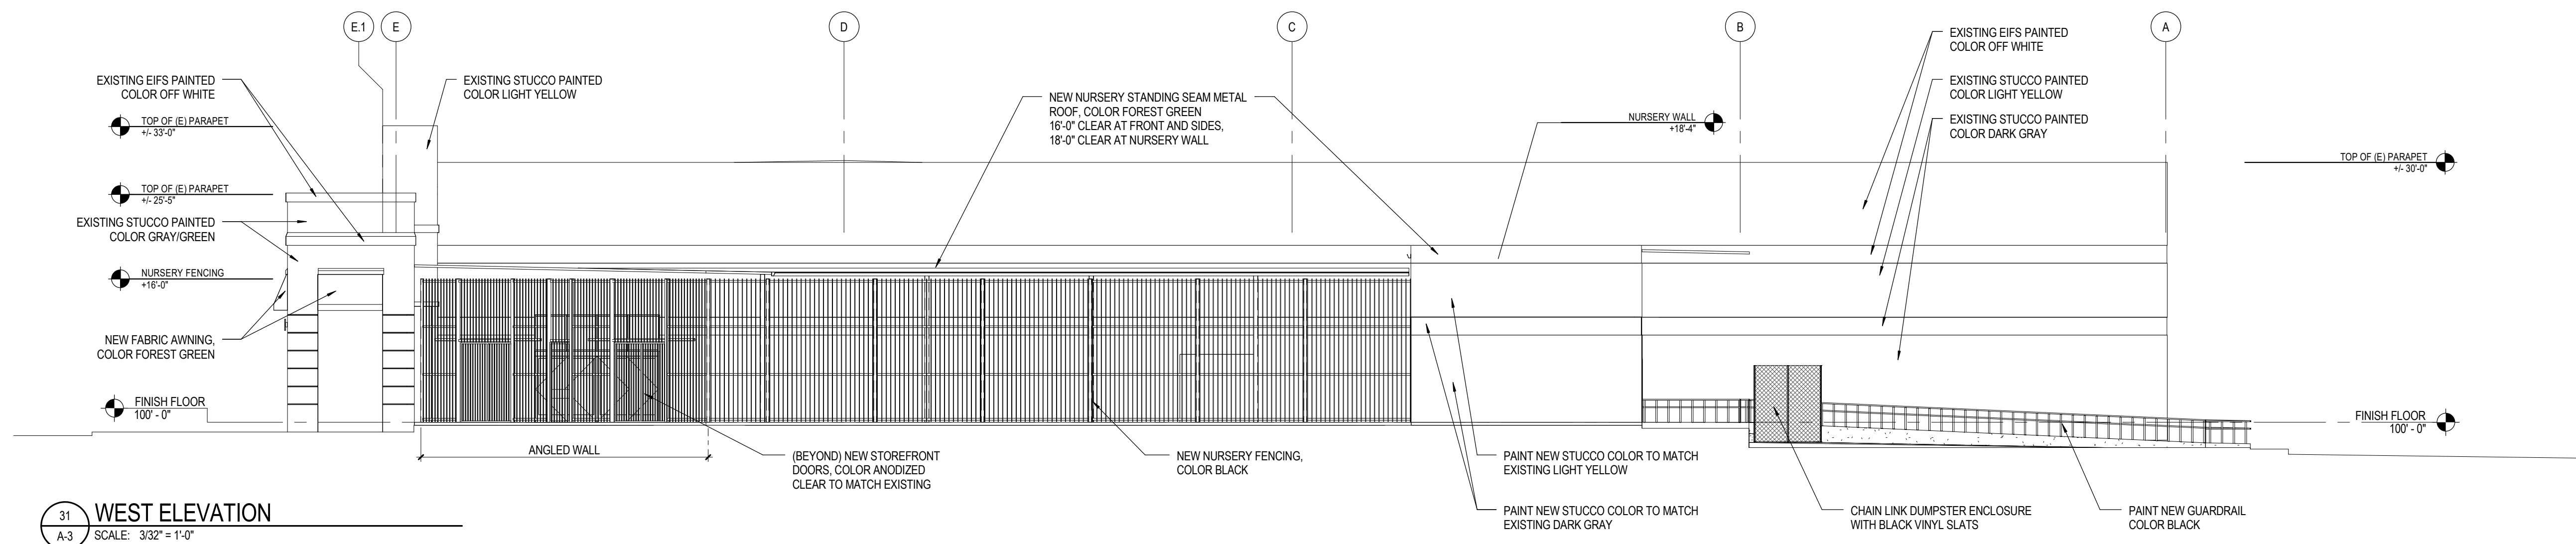



31 WEST ELEVATION
SCALE: 3/32" = 1'-0"

1/18/2016 6:50:07 AM

\\01131360\dwg\031314\c7-01\0314\c7-01.dwg, 3/1/2017 9:15:55 AM, L1

LAVERS AVE. (SW 6th AVE.)

LAVERS CIR.

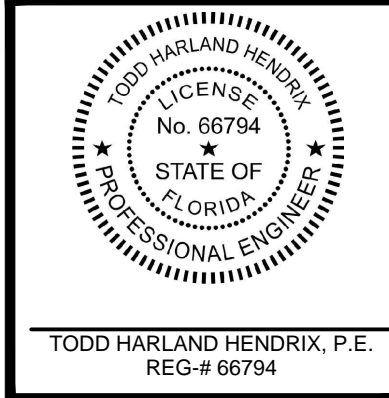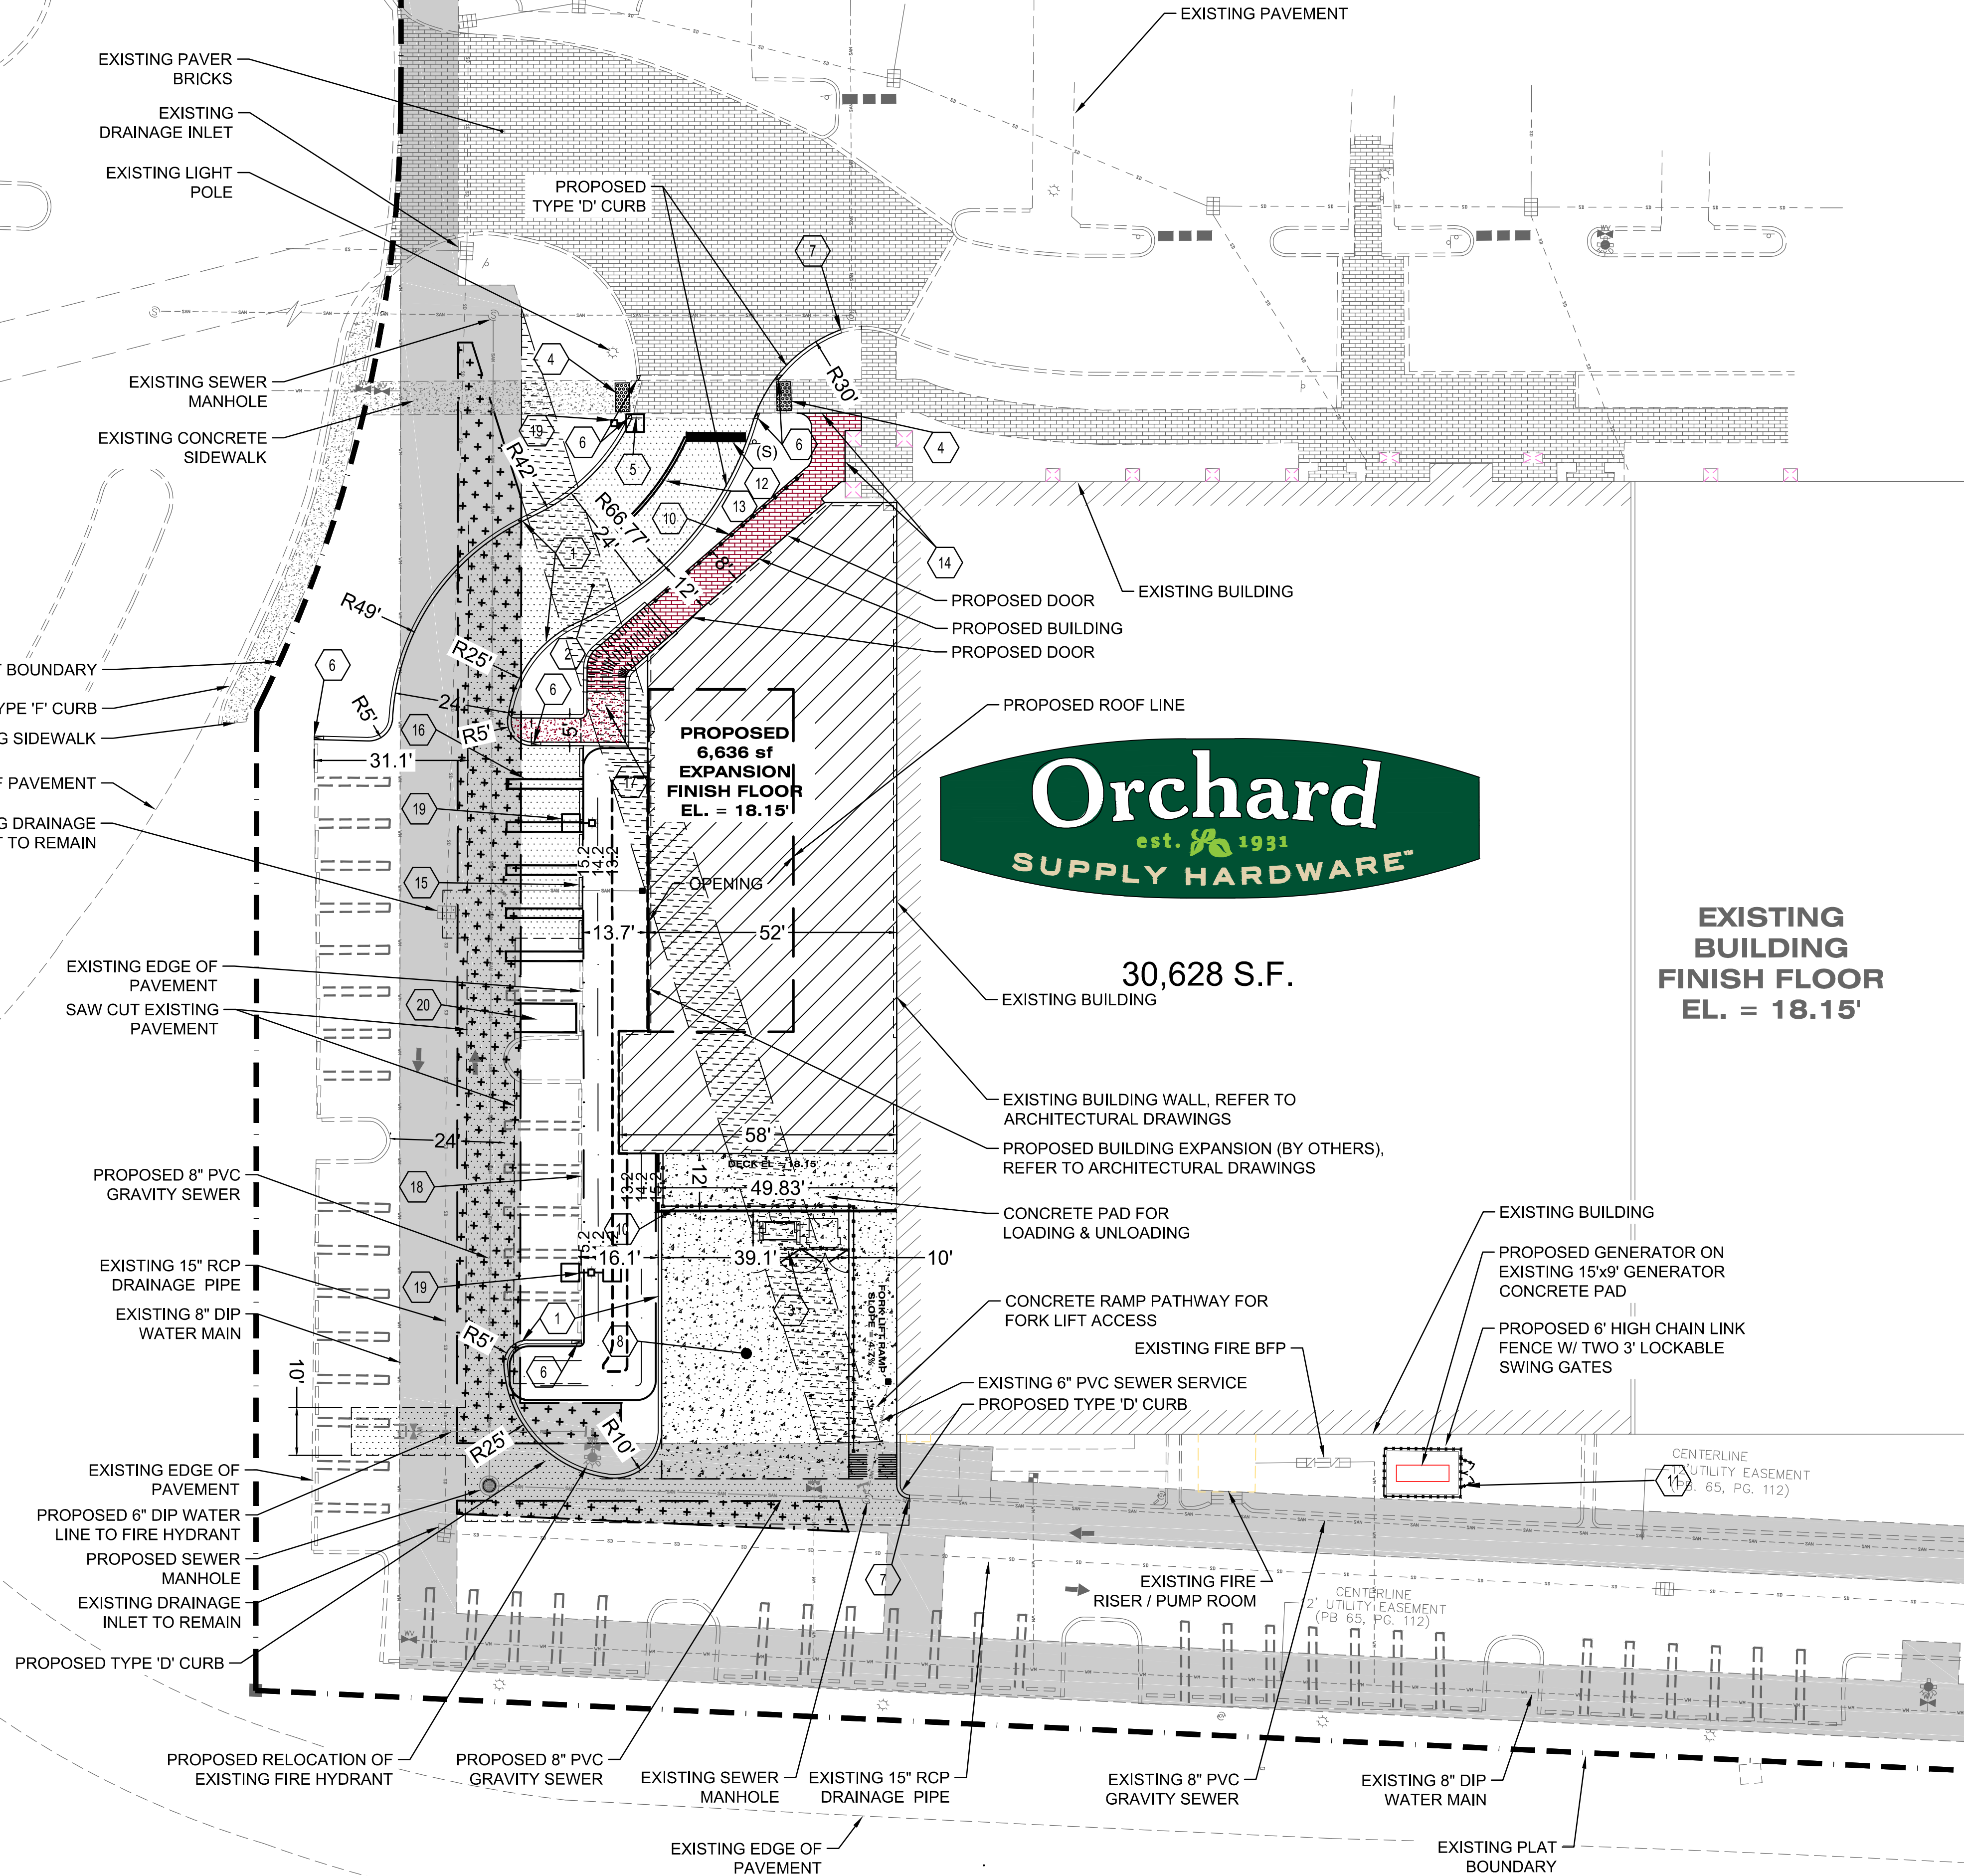

JOB No.: D11914


cph

www.cphcorp.com

A Full Service A & E Firm

Architects
Engineers
Environmental
Landscape Architects
M / E / P
Planners
Structural
Surveyors
Traffic / Transportation

Offices in:
• Florida
• Puerto Rico
• Connecticut
• Maryland
• Texas

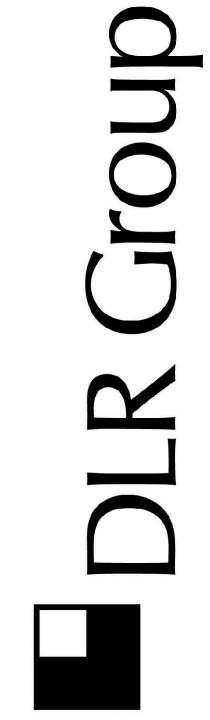

© 2016, DLR Group Inc., a Florida corporation. ALL RIGHTS RESERVED

C-7

36-16121-00
Issue Date
REVISIONS

SITE DIMENSION PLAN
ORCHARD SUPPLY HARDWARE - DELRAY BEACH

510 LINTON BLVD.
DELRAY BEACH, FL 33483

CITY SITE PLAN REVIEW



DELRAY BEACH

GENERAL NOTES


1. 3/4" EMPTY CONDUIT TO LOCATIONS SHOWN AT THE LOT PERIMETER FOR LOT LIGHTING IS BY THE GENERAL CONTRACTOR. LIGHTING FIXTURES, BASES, POLES, CONDUIT, AND WIRING ARE BY THE OWNER/OPERATOR.
2. PROPOSED UTILITIES ARE SHOWN IN SCHEMATIC ONLY. EXACT LOCATIONS SHALL BE DETERMINED TO ALLOW FOR THE MOST ECONOMICAL INSTALLATION.
3. THE CONTRACTOR SHALL COORDINATE WITH ALL UTILITY COMPANIES TO DETERMINE EXACT POINT OF SERVICE CONNECTION AT EXISTING UTILITY. REFER TO THE BUILDING ELECTRICAL AND PLUMBING DRAWINGS FOR UTILITY SERVICE ENTRANCE LOCATIONS, SIZES, AND CIRCUITING.
4. ALL ELEVATIONS SHOWN ARE IN REFERENCE TO THE BENCHMARK AND MUST BE VERIFIED BY THE GENERAL CONTRACTOR AT GROUND BREAK.
5. FINISH WALK AND CURB ELEVATIONS SHALL BE 6" ABOVE FINISH PAVEMENT.
6. ALL LANDSCAPE AREAS SHALL BE ROUGH GRADED TO 6" BELOW TOP OF ALL WALKS AND CURBS. FINISH GRADING, LANDSCAPING, AND SPRINKLER SYSTEMS ARE BY THE OWNER/OPERATOR.
7. LOT LIGHTING CONCRETE FOOTINGS TO CONFORM WITH THE SOILS REPORT RECOMMENDATIONS FOR THIS PARTICULAR SITE.
8. DIMENSIONS SHOWN ARE TO THE FACE OF CURB UNLESS SHOWN (BOC) WHICH INDICATES BACK OF CURB.
9. ALL STRIPING SHALL BE IN CONFORMANCE WITH LOCAL AGENCY REQUIREMENTS.
10. ADJUST ALL MANHOLE RINGS AND CLEAN OUT COVERS TO BE FLUSH WITH FINISHED GRADE. ALL PARTS TO BE TRAFFIC BEARING (AASHTO H-20 LOADING).
11. ENSURE ACCESSIBILITY STICKERS ARE PLACED ON ALL APPLICABLE DOORS.
12. TRANSITIONS TO BE FLUSH ALL ALONG THE ACCESSIBLE ROUTE. CONTRACTOR SHALL ENSURE THE MAXIMUM CONSTRUCTED LEVEL TRANSITION AT EVERY JOINT DOES NOT EXCEED THE MAXIMUM ALLOWABLE UNDER THE ADA. AFTER SETTLEMENT, EXPANSION, CONTRACTION, ETC. CHANGES IN LEVEL OF 1/4" HIGH MAXIMUM SHALL BE PERMITTED TO BE VERTICAL. CHANGES IN LEVEL BETWEEN 1/4" HIGH MINIMUM AND 1/2" HIGH MAXIMUM SHALL BE BEVELED WITH A SLOPE NOT STEEPER THAN 1:2.
13. FILL EXPANSION / CONTROL JOINT WITH EXTERIOR GRADE CONCRETE EXPANSION JOINT CAULKING. FILL ENTIRE LENGTH OF JOINT SUCH THAT ANY CHANGE IN ELEVATION DOES NOT EXCEED 1/4" IN ELEVATION FROM THE ADJACENT CONCRETE SURFACES WHEN CAULKING HAS CURED. FOR JOINTS WITH VOIDS DEEPER THAN 1/2", INSTALL CONTINUOUS FIBERBOARD EXPANSION JOINT FILLER BELOW CAULKING TO SUPPORT CAULKING ABOVE.
14. ALL ON SITE PAVEMENT TO BE DOUBLE STRIPED.

KEYNOTES LEGEND

- 1 CONCRETE CURB - SEE DETAIL RT 6.1 ON C-10
- 2 ASPHALT PAVING - SEE DETAIL #5 ON C-10A
- 3 DUMPSTER LAYOUT - SEE DETAIL #7 ON C-10A
- 4 PROPOSED DETECTABLE WARNING, 3" DEEP TRUNCATED DOMES TO BE OVERLAY PAD. - SEE DETAIL RT 10.3 ON C-10
- 5 MATCH EXISTING SIDEWALK.
- 6 PROPOSED FLARED END CURB - SEE DETAIL RT 6.2 ON C-10
- 7 SAW CUT EXISTING CURB AND MATCH PROPOSED CURB INTO EXISTING CURB.
- 8 PROPOSED HEAVY DUTY CONCRETE PAVEMENT, SEE DETAIL #4 ON C-10A
- 9 PROPOSED PARKING STRIPING - SEE DETAIL #11 ON C-10
- 10 PROPOSED HAND RAIL, (REFER TO ARCHITECTURAL PLANS FOR DETAILS)
- 11 PROPOSED GENERATOR FENCE - SEE DETAIL #7 ON C-10A
- 12 24" WIDE THERMOPLASTIC SOLID WHITE PAINTED STOP BAR, FDOT 17346 (TYP.)
- 13 6" WIDE DOUBLE YELLOW LINE (TYP.)
- 14 PROPOSED PAVER BRICK SIDEWALK TO MATCH EXISTING.
- 15 EXISTING WHEEL STOP TO BE REUSED.
- 16 PROPOSED PARKING STRIPE, SEE DETAIL RT 4.2a ON C-10
- 17 PROPOSED 8' WIDE CONC. SIDEWALK/RAMP.
- 18 PROPOSED CONC. SIDEWALK TO BE FLUSH WITH PROPOSED AND EXISTING PAVEMENT
- 19 PROPOSED LIGHT POLE OR MODIFICATION TO EXISTING
- 20 PROPOSED CART CORRAL

SITE LEGEND

- EXISTING PAVER BRICKS
- PROPOSED PAVER BRICKS
- EXISTING CONCRETE
- PROPOSED CONCRETE
- PROPOSED ASPHALT PAVEMENT
- PROPOSED BUILDING
- PROPOSED & EXISTING EASEMENT TO REMAIN
- EXISTING EASEMENT TO BE VACATED
- (S) = STOP SIGN (R1-1)

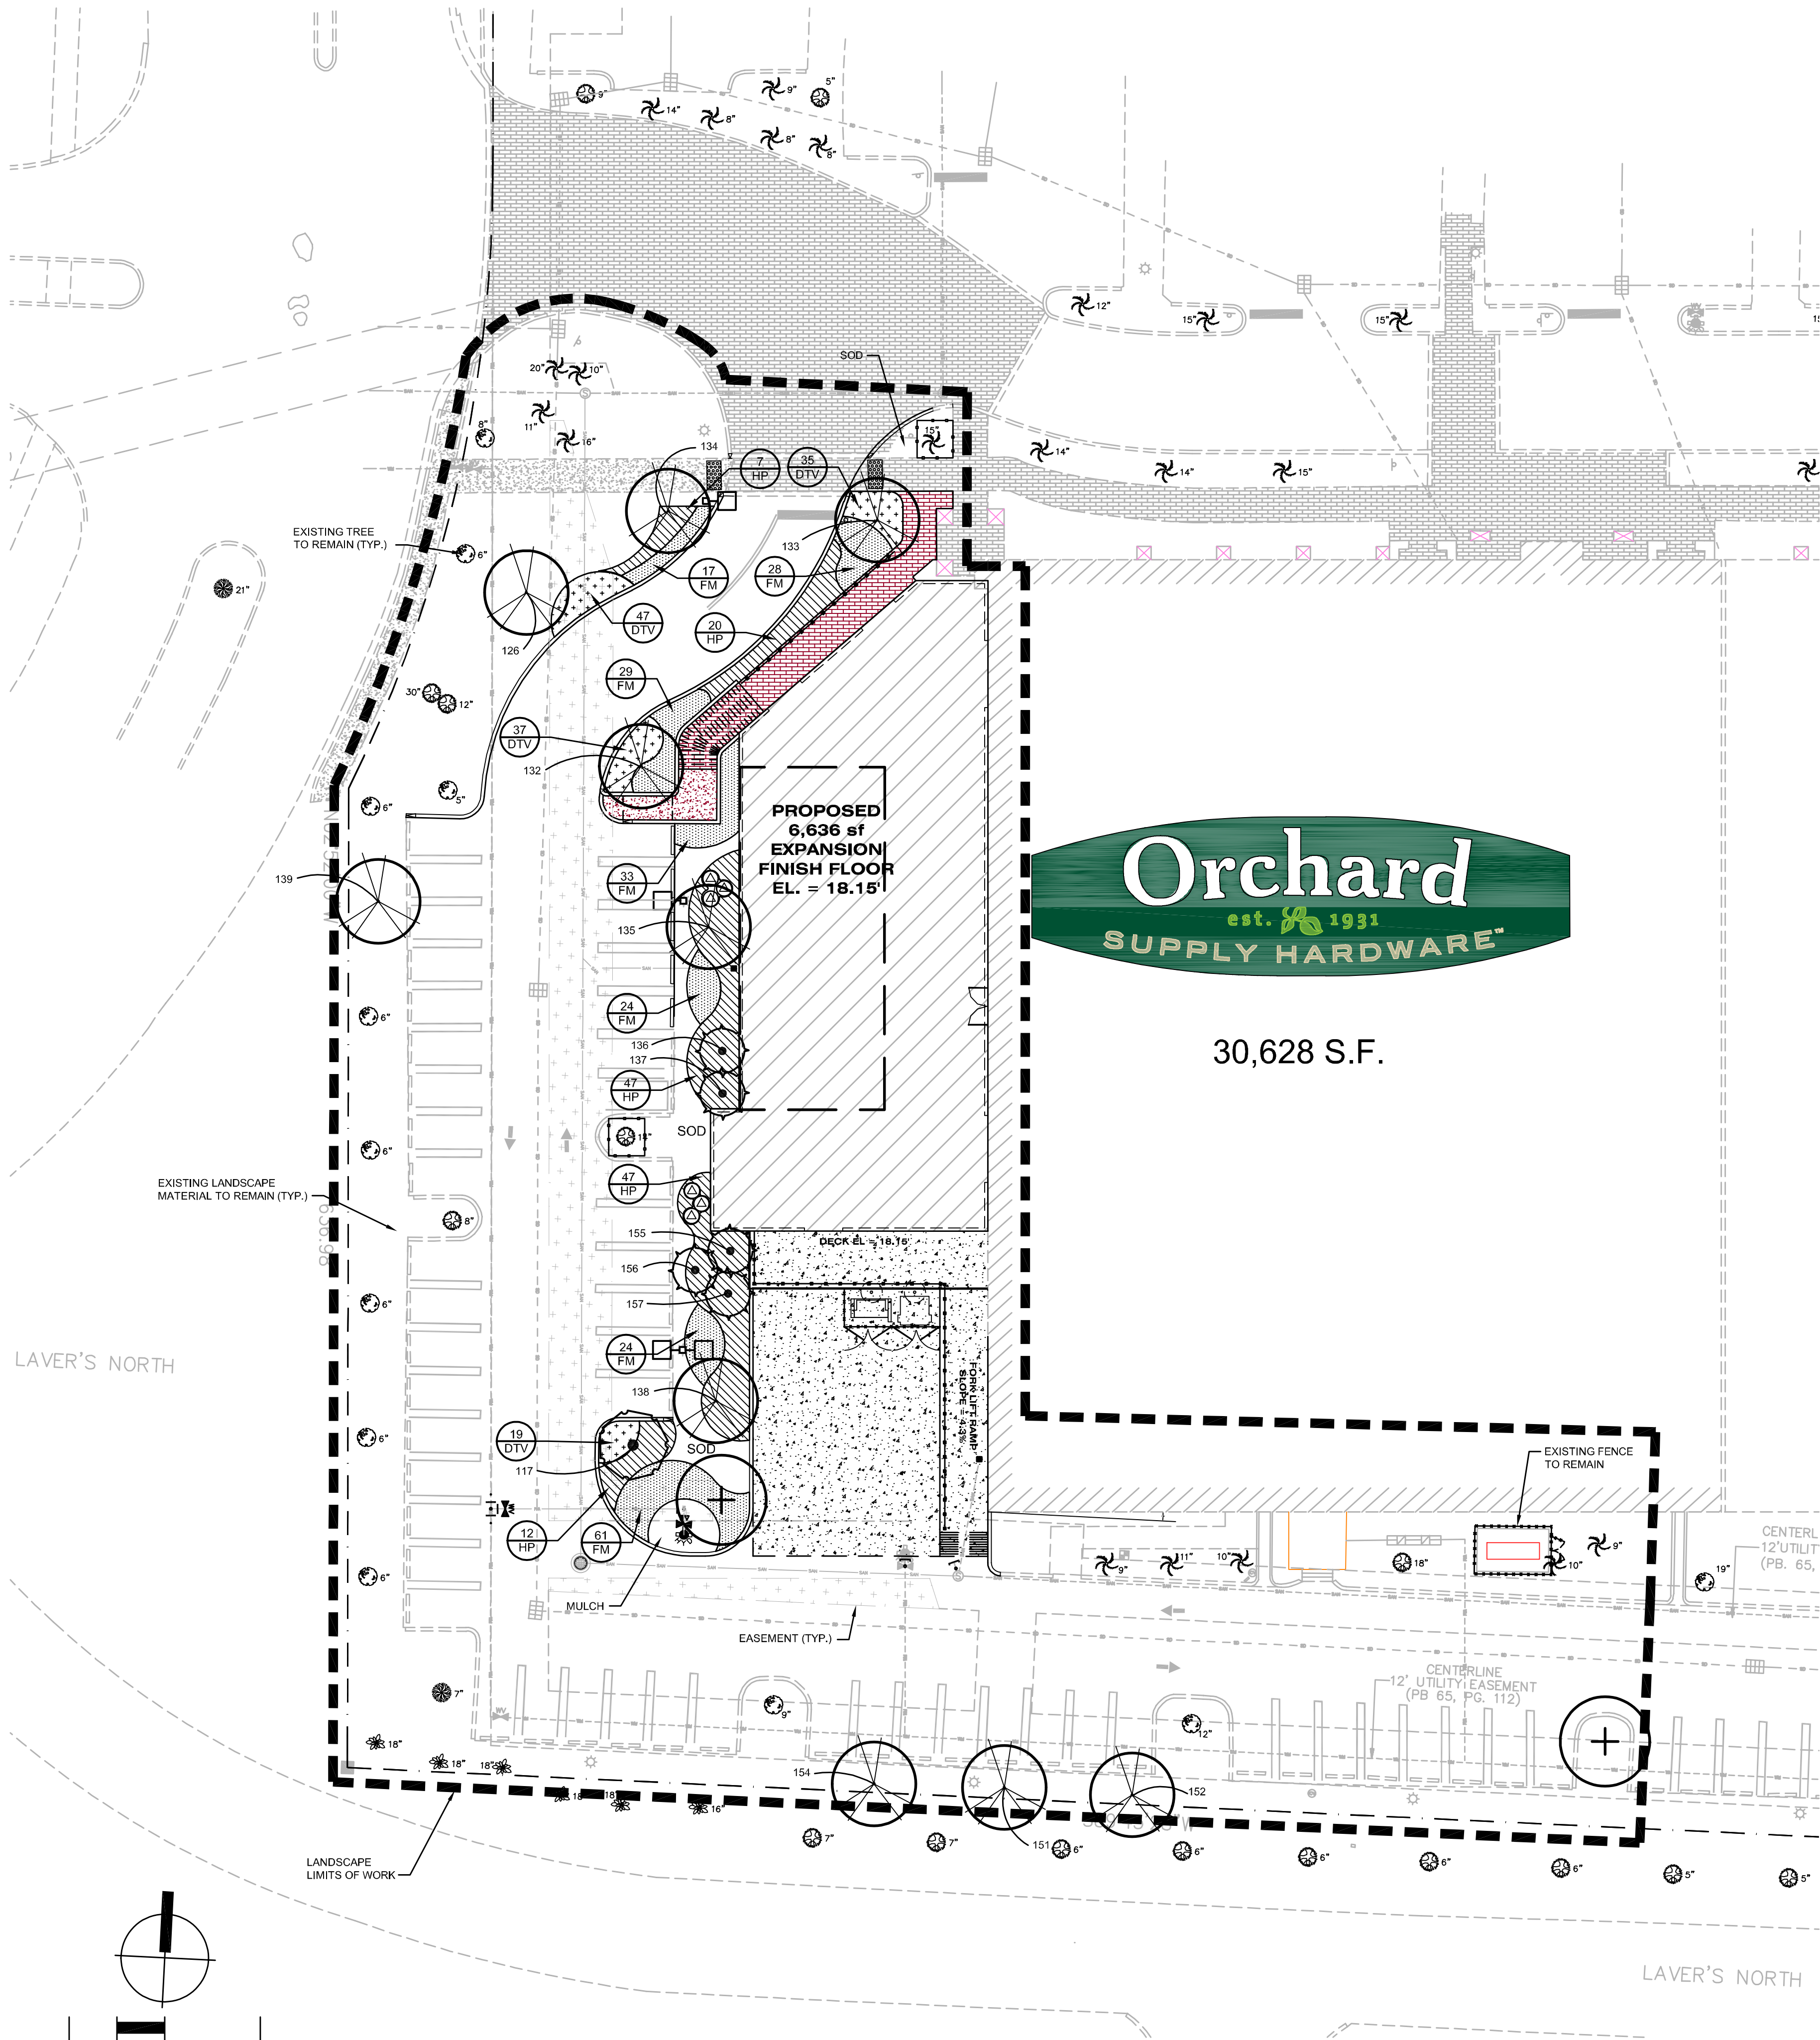

PLANT LIST				
SYM.	COMMON NAME	BOTANICAL NAME	DESCRIPTION	QTY
TREES				
RM	RELOCATED MAHOGANY	MAHOGANY SWIETENIA	REFER TO TRP	1
RQ	RELOCATED OAK	QUERCUS VIRGINIANA	REFER TO TRP	10
RP	RELOCATED PALM	SABAL PALMETTO	REFER TO TRP	5
QV	LIVE OAK	QUERCUS VIRGINIANA	4" CAL., 16" MIN OA HT, 7' MIN SPRD	2
EX	EXISTING TREES	EXISTING TREES	REFER TO TRP	-
SHRUBS				
CA	QUEEN EMMA CRINUM LILY	CRINUM ASIATICUM 'QUEEN EMMA'	7 GAL, 3'H X 30" SPR	6
GROUNDCOVER				
DTV	VARIEGATED FLAX LILY	DIANELLA TASMANICA 'VARIEGATA'	1 GAL, 12" H X 4" SPR, 18" OC	138
FM	GREEN ISLAND FICUS	FICUS MICROCARPA 'GREEN ISLAND'	3 GAL., 14" H X 14" SPR, 24" O.C.	216
HP	FIREBUSH	HAMELIA PATENS	3 GAL, 18" H X 9" SPR, 3' OC	133
SOD	ST. AUGUSTINE GRASS	STENOTAPHRUM SECUNDATUM	SOLID SOD, CONTRACTOR TO VERIFY QTY.	

NOTE:
PLANT DESCRIPTIONS ARE FOR MINIMUM ACCEPTABLE SPECIFICATIONS. ALL CRITERIA LISTED FOR CONTAINER SIZE, CALIPER, HEIGHT, SPREAD, ETC. MUST BE MET FOR PLANT MATERIAL ACCEPTANCE. FOR EXAMPLE, IF A THREE GALLON SHRUB DOES NOT MEET THE HEIGHT OR SPREAD SPECIFICATION, IT WILL NOT BE ACCEPTED.
IF SPECIFIED PLANTS ARE UNAVAILABLE AT TIME OF CONSTRUCTION, CONTRACTOR MAY REPLACE SPECIFIED PLANTS WITH PLANTS APPROVED BY LANDSCAPE ARCHITECT AND CITY STAFF.
ALL OPEN SPACE AREAS WITHIN THE PROPERTY SHALL BE SODDED UNLESS PAVED, SEEDED AND MULCHED OR PLANTED WITH SHRUBS AND GROUND COVER.
ALL LANDSCAPED AREAS WILL BE 100% IRRIGATED WITH A CENTRAL AUTOMATIC IRRIGATION SYSTEM INCLUDING A RAIN SENSOR.
CONTRACTOR TO MODIFY EXISTING IRRIGATION SYSTEM TO INSURE ADEQUATE IRRIGATION FOR ALL NEW PLANT MATERIAL.
CONTRACTOR SHALL REPLACE ANY EXISTING SOD OR OTHER PLANT MATERIALS DAMAGED DURING CONSTRUCTION IN AREAS THAT ARE OUTSIDE PROPOSED LANDSCAPE AS SHOWN ON THE PLAN.
ANY TREES OR SHRUBS PLACED WITHIN WATER, SEWER OR DRAINAGE EASEMENTS SHALL CONFORM TO THE CITY OF DELRAY BEACH STANDARD DETAILS; LD 1.1 & LD 1.2 ON SHEET L-2.

LDR 4.6.16(D)(4)(B) - TREES SHALL NOT BE PLANTED WITHIN TEN (10) FEET OF ANY UNDERGROUND UTILITIES

LANDSCAPE CALCULATION FORM
MULTIPLE FAMILY, COMMERCIAL & INDUSTRIAL

CITY OF DELRAY BEACH

(561) 243-7200

A	TOTAL LOT AREA	52,719	S.F.
B	STRUCTURES, PARKING, WALKWAYS, DRIVES, ETC.	36,724	S.F.
C	TOTAL PERVIOUS LOT AREA	15,995	S.F.
D	AREA OF SHRUBS AND GROUND COVERS REQUIRED	4798.5	S.F.
E	AREA OF SHRUBS AND GROUND COVERS PROVIDED	2557 *	S.F.
F	NATIVE VEGETATION REQUIRED	1199,825	S.F.
G	NATIVE VEGETATION PROVIDED	1270 *	S.F.
H	TOTAL PAVED VEHICULAR USE AREA	21,024	S.F.
I	TOTAL INTERIOR LANDSCAPE AREA REQUIRED	2102.4	S.F.
J	TOTAL INTERIOR LANDSCAPE AREA PROVIDED	2119	S.F.
K	TOTAL INTERIOR SHADE TREES REQUIRED	16,8192	TREES
L	TOTAL INTERIOR SHADE TREES PROVIDED	17	TREES
M	TOTAL LINEAR FEET SURROUNDING PARKING OR VEHICULAR USE AREAS*	567	L.F.
N	TOTAL NUMBER OF PERIMETER TREES REQUIRED	18.9	TREES
O	TOTAL NUMBER OF PERIMETER TREES PROVIDED	19 (15 EXISTING; 4 RELOCATED)	TREES
P	TOTAL NUMBER OF EXISTING TREES TO BE SAVED OF SITE	51	TREES
Q	TOTAL NUMBER OF NATIVE TREES REQUIRED	17,8596	TREES
R	TOTAL NUMBER OF NATIVE TREES PROVIDED	36	TREES
S	TOTAL NUMBER OF TREES ON PLAN PROVIDED	69	TREES

NOTE: AREA CALCULATIONS ARE BASED ON LIMITS OF LANDSCAPE WORK LINE DELINEATED ON PLAN, UNLESS SPECIFIED OTHERWISE.

*SHRUB AND GROUNDCOVER AREAS ARE BASED SOLELY ON PROPOSED LANDSCAPE MATERIAL AND DOES NOT REFLECT ANY EXISTING SHRUB OR GROUNDCOVER AREA TO REMAIN.